



Water Usage from large dams comprising the Western Cape Water Supply System

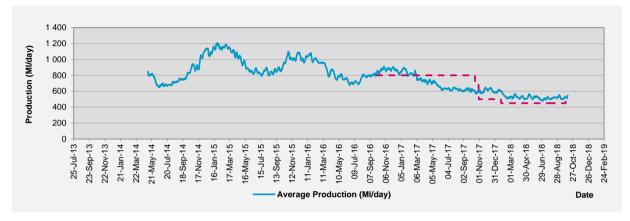

Western Cape Water Supply System (WCWSS) weekly drought monitoring

This graph depicts total dam storage against potential system risk scenarios. The previous graph monitored the dam level draw down against the 2017 rainfall conditions under different restriction levels.

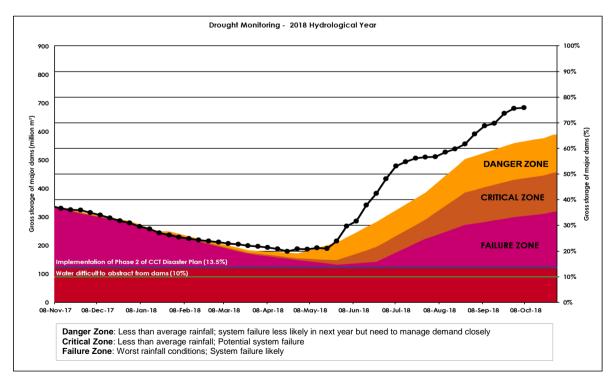

Water stored in major dams comprising Western Cape Water Supply System (WCWSS)


		STORAGE							
MAJOR DAMS	CAPACITY	%	%	%	%	%	%		
	MI	08 October 2018	Previous week	2017	2016	2015	2014		
BERG RIVER	130 010	99.4	100.1	66.4	73.1	89.4	99.6		
STEENBRAS LOWER	33 517	91.9	93.8	45.2	65.8	87.5	94.8		
STEENBRAS UPPER	31 767	87.7	91.1	99.9	92.6	92.0	100.5		
THEEWATERSKLOOF	480 188	58.8	58.0	28.3	52.8	76.9	100.8		
VOËLVLEI	164 095	96.2	95.0	26.8	71.6	47.4	100.1		
WEMMERSHOEK	58 644	95.1	95.8	45.6	67.9	69.8	96.2		
TOTAL STORED	898 221	684 030	681 360	339 641	557 554	662 818	898 123		
% STORAGE		76.2	75.9	37.8	62.1	73.8	100.0		

NOTES:


1) Capacity of the major dams of the Western Cape Water Supply System is 99.6% and that of the minor dams 0.4% of the combined capacity of the major and minor dams. Kindly note that all the Major Dams show gross capacity.

2) All figures are for 08 October for each year except for those in the second column, which gives the figures for the previous week of this year.

3) The last 10% of a dam's water is difficult to use, the useable water in the dam is approximately 10% less than the dam level.

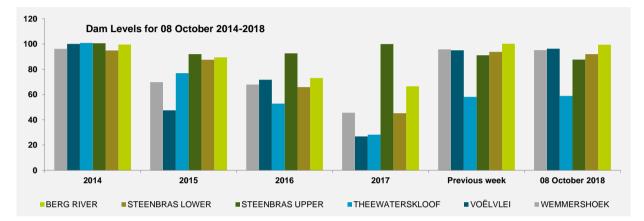

Ten year graph Indicating volume of water stored in major dams Comprising Western Cape Water Supply System (WCWSS)

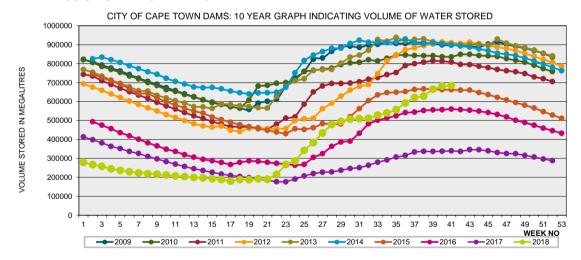

Water stored in minor dams within Cape Town

	STORAGE							
MINOR DAMS	CAPACITY %		%	%	%	%	%	
	MI	08 October 2018	Previous week	2017	2016	2015	2014	
ALEXANDRA (Table Mountain)	126	95.6	100.0	73.7	42.1	36.3	76.9	
DE VILLIERS (Table Mountain)	243	99.8	99.8	94.5	91.1	96.9	86.1	
HELY-HUTCHINSON (Table Mountain)	925	99.7	99.8	100.2	99.8	100.5	94.6	
KLEINPLAATS (Simon's Town)	1 368	98.4	99.6	66.8	95.8	84.8	93.6	
LAND-EN-ZEEZICHT (Helderberg)	451	100.0	100.0	98.7	69.0	51.1	0.0	
LEWIS GAY (Simon's Town)	182	100.5	100.9	93.6	78.8	100.5	71.3	
VICTORIA (Table Mountain)	128	100.4	101.2	100.4	100.0	101.5	99.3	
WOODHEAD (Table Mountain)	954	85.2	92.2	88.3	99.9	68.6	60.8	

Making progress possible. Together.

www.capetown.gov.za



Water usage from large dams comprising the Western Cape Water Supply System

The above graph tracks City of Cape Town (CCT) water usage against the Department of Water and Sanitation (DWS) restriction requirement against our unrestricted demand (or past usage).

Water Quality Sample Pass Rate

Month	Water Quality Compliance (%)	Target (%)
Jun-17	99.65	98
Jul-17	99.62	98
Aug-17	99.59	98
Sep-17	99.57	98
Oct-17	99.57	98
Nov-17	99.49	98
Dec-17	99.44	98
Jan-17	99.43	98
Feb-18	99.38	98
Mar-18	99.38	98
Apr-18	99.26	98
May-18	99.20	98
Jun-18	99.07	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis. The latest available is for June).

Rainfall

RAINFALL (mm)	01-Oct	02-Oct	03-Oct	04-Oct	05-Oct	06-Oct	07-Oct	Oct	
								Total*	LT Average
Blackheath Upper	2.5	0.0	0.0	0.0	0.0	0.0	0.0	2.5	32.0
Brooklands	4.0	0.0	0.0			0.0		4.0	46.7
Newlands	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.5	95.4
Steenbras	4.8	0.0	0.0			0.0		4.8	63.8
Table Mountain (Woodhead)	5.5	0.0	0.0	0.0	0.0	0.0		5.5	107.6
Theewaterskloof	3.5	0.0	0.0			0.0		3.5	42.2
Tygerberg	1.8	0.0	0.0	0.0	0.0	0.0	0.0	1.8	30.0
Voëlvlei		0.0	0.0			0.0		0.0	27.7
Wemmershoek	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	46.7
Wynberg	0.7	0.0	0.0			0.0		0.7	66.0
	Not	es: *Total/c	umulative ra	ainfall for mo	onth indicate	ed above			
			LT: L	ong Term					

www.capetown.gov.za

Making progress possible. Together.