



Disclaimer: The data depicted above is indicative and has been based on the City's own assessment of water use from the WCWSS. It is subject to official verification by the National Department of Water and Sanitation.



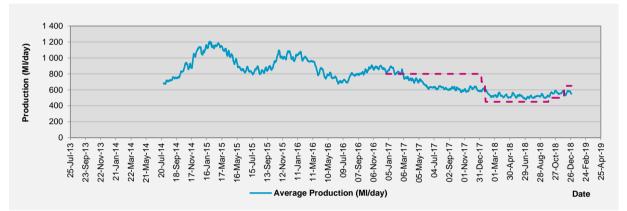

Western Cape Water Supply System (WCWSS) weekly drought monitoring

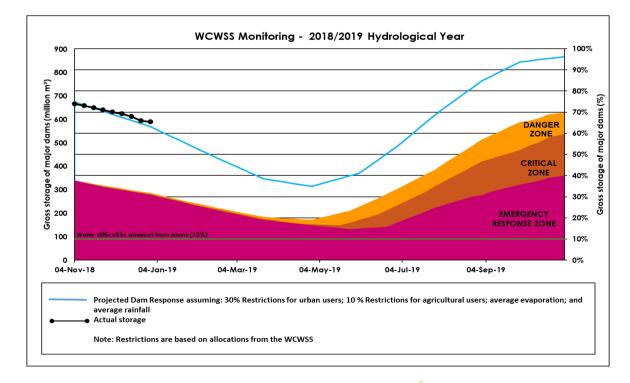

This graph depicts total dam storage against potential system risk scenarios.

Making progress possible. Together.

www.capetown.gov.za

-	-						
	STORAGE						
MAJOR DAMS	CAPACITY	%	%	%	%	%	%
	MI	31 December 2018	Previous week	2017	2016	2015	2014
BERG RIVER	130 010	89.8	85.6	59.3	58.7	65.8	88.1
STEENBRAS LOWER	33 517	68.3	70.1	50.8	38.9	61.3	63.1
STEENBRAS UPPER	31 767	70.1	70.3	95.0	76.9	77.5	99.3
THEEWATERSKLOOF	480 188	50.8	51.8	18.5	40.5	59.8	85.4
VOËLVLEI	164 095	84.3	85.8	22.4	52.9	31.1	81.9
WEMMERSHOEK	58 644	78.4	79.8	51.8	42.4	59.5	76.3
TOTAL STORED	898 221	590 437	593 550	280 290	420 046	503 648	756 556
% STORAGE		65.7	66.1	31.2	46.8	56.1	84.2


Water stored in major dams comprising Western Cape Water Supply System (WCWSS)

NOTES:


1) Capacity of the major dams of the Western Cape Water Supply System is 99.6% and that of the minor dams 0.4% of the combined capacity of the major and minor dams. Kindly note that all the Major Dams show gross capacity.

2) All figures are for 31 December for each year except for those in the second column, which gives the figures for the previous week of this year.

3) The last 10% of a dam's water is difficult to use, the useable water in the dam is approximately 10% less than the dam level.

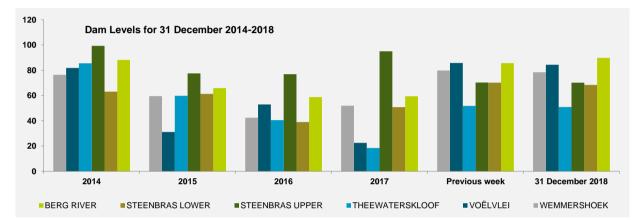

Ten year graph Indicating volume of water stored in major dams Comprising Western Cape Water Supply System (WCWSS)

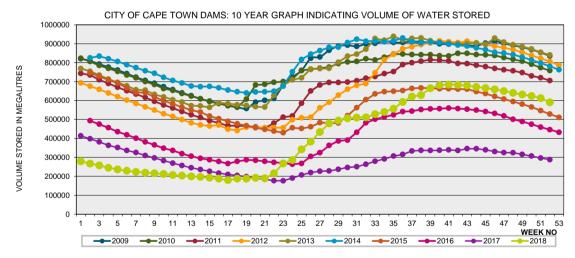


Water stored in minor dams within Cape Town

	STORAGE							
MINOR DAMS	CAPACITY	%	%	%	%	%	%	
	MI	31 December 2018	Previous week	2017	2016	2015	2014	
ALEXANDRA (Table Mountain)	126	51.5	53.3	47.5	33.9	30.5	43.0	
DE VILLIERS (Table Mountain)	243	53.6	59.1	80.0	73.4	73.1	63.5	
HELY-HUTCHINSON (Table Mountain)	925	99.5	98.3	96.8	98.6	98.5	40.0	
KLEINPLAATS (Simon's Town)	1 368	79.0	81.0	55.7	61.9	57.0	50.1	
LAND-EN-ZEEZICHT (Helderberg)	451	100.0	100.0	100.0	83.7	58.8	0.0	
LEWIS GAY (Simon's Town)	182	55.7	61.1	91.7	64.5	79.3	78.0	
VICTORIA (Table Mountain)	128	86.8	87.8	93.9	92.7	92.7	84.7	
WOODHEAD (Table Mountain)	954	76.7	75.7	91.4	99.1	63.7	67.5	

Making progress possible. Together.

www.capetown.gov.za

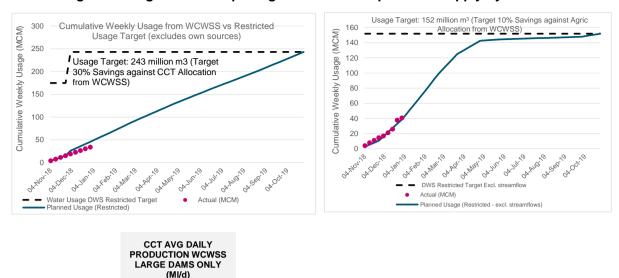

Water usage from large dams comprising the Western Cape Water Supply System

The above graph tracks City of Cape Town (CCT) water usage against the Department of Water and Sanitation (DWS) restriction requirement against our unrestricted demand (or past usage). Restriction targets have changed asof 1 December 2018. CCT has been restricted at 30% against the WCWSS approved allocation to the CCT.

Water Quality Sample Pass Rate

20

Month	Water Quality Compliance (%)	Target (%)
Sep-17	99.57	98
Oct-17	99.57	98
Nov-17	99.49	98
Dec-17	99.44	98
Jan-18	99.43	98
Feb-18	99.38	98
Mar-18	99.38	98
Apr-17	99.26	98
May-18	99.20	98
Jun-18	99.07	98
Jul-18	99.12	98
Aug-18	99.07	98
Sep-18	99.08	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis. The latest available is for September).

Rainfall

RAINFALL (mm)	24-Dec	25-Dec	26-Dec	27-Dec	28-Dec	29-Dec	30-Dec	Dec	
								Total*	LT Average
Blackheath Upper	0.0	0.0	10.0	0.0	0.0	0.0	0.0	16.8	16.6
Brooklands	0.0	1.0	9.0			0.0		28.0	22.2
Newlands	0.0	24.5	3.0	0.0	0.0	0.0	0.0	125.5	54.0
Steenbras	0.0	0.0	10.0			0.0		33.2	34.6
Table Mountain (Woodhead)	0.0	18.0	10.0	0.0	0.0	0.0		70.9	65.6
Theewaterskloof	0.0	0.0	7.8			0.0		9.8	19.9
Tygerberg	0.0	1.5	5.2	0.0	0.0	0.0	0.0	18.6	16.1
Voëlvlei	0.0	0.0	18.0			0.0		28.0	18.2
Wemmershoek	0.0	0.0	16.0	0.0	0.0	0.0	0.0	31.8	29.3
Wynberg	0.0	20.0	0.0			0.0		61.8	28.0
	Not	es : *Total/c		ainfall for mo ong Term	onth indicate	ed above			

www.capetown.gov.za

Making progress possible. Together.