



Overall Water Usage

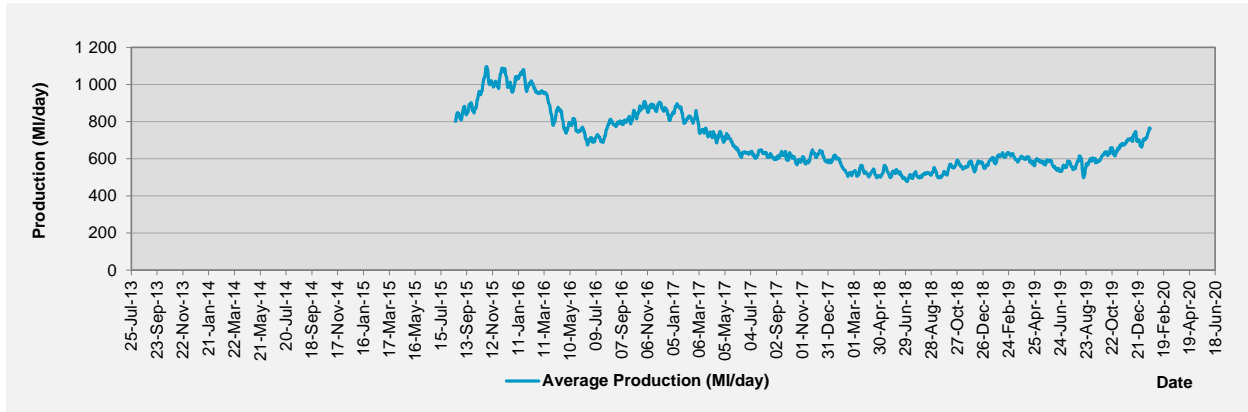

Western Cape Water Supply System (WCWSS) Dam Storage Tracking

This graph depicts total dam storage against potential system risk scenarios.

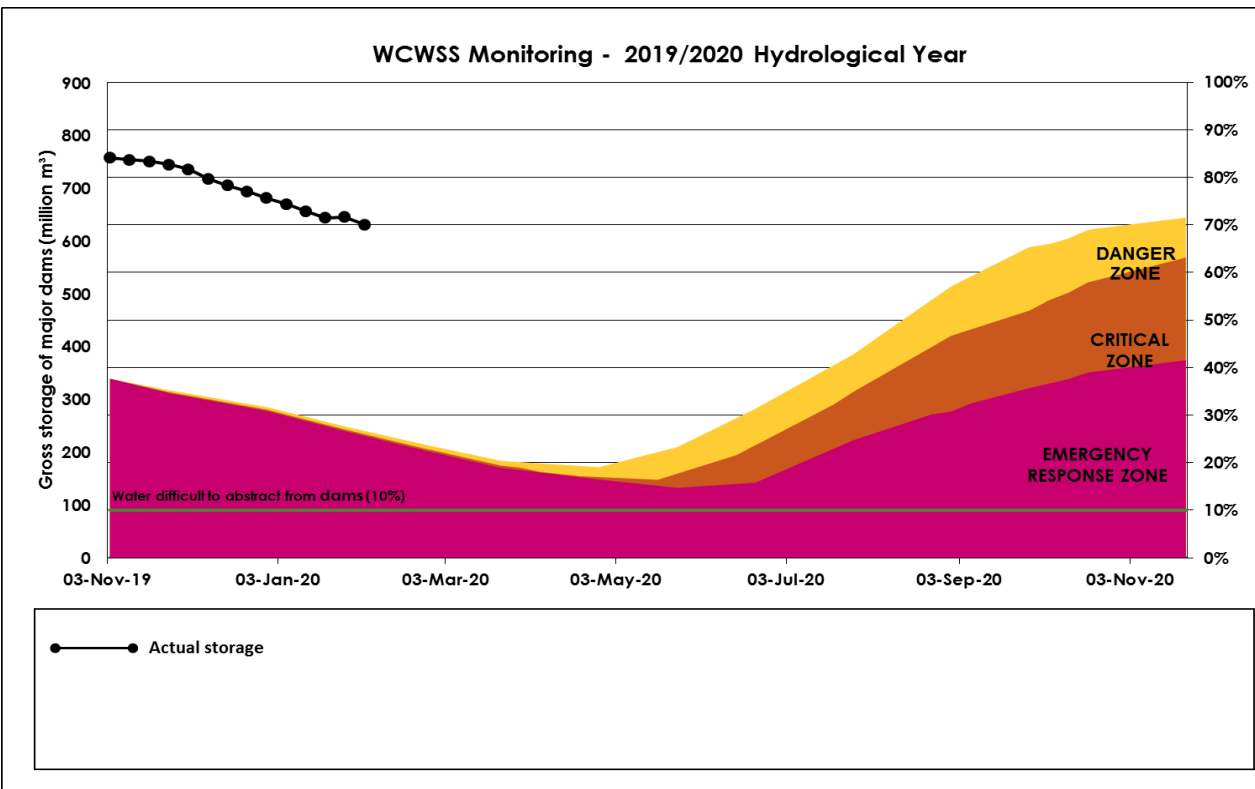

Water stored in major dams

MAJOR DAMS	STORAGE						
	CAPACITY	%		%		%	
	MI	03 February 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	83.9	85.5	81.8	53.5	48.0	47.7
STEENBRAS LOWER	33 517	76.5	78.9	58.1	42.9	44.8	47.4
STEENBRAS UPPER	31 767	99.4	99.7	70.4	82.6	57.1	77.2
THEEWATERSKLOOF	480 188	63.8	65.4	45.8	12.7	33.2	49.4
VOËLVLEI	164 095	71.4	73.1	74.3	17.6	40.7	25.4
WEMMERSHOEK	58 644	71.3	73.0	69.3	51.1	36.5	55.5
TOTAL STORED	898 221	631 855	646 151	530 822	230 094	343 376	413 761
% STORAGE		70.3	71.9	59.1	25.6	38.2	46.1


NOTES:

1) Capacity of the major dams of the Western Cape Water Supply System is 99.6% and that of the minor dams 0.4% of the combined capacity of the major and minor dams. Kindly note that all the Major Dams show gross capacity.


2) All figures are for 03 February for each year except for those in the second column, which gives the figures for the previous week of this year.

3) The last 10% of a dam's water is difficult to use, the useable water in the dam is approximately 10% less than the dam level.

4) Kindly note that when Steenbras Upper spills, it spills into Steenbras lower

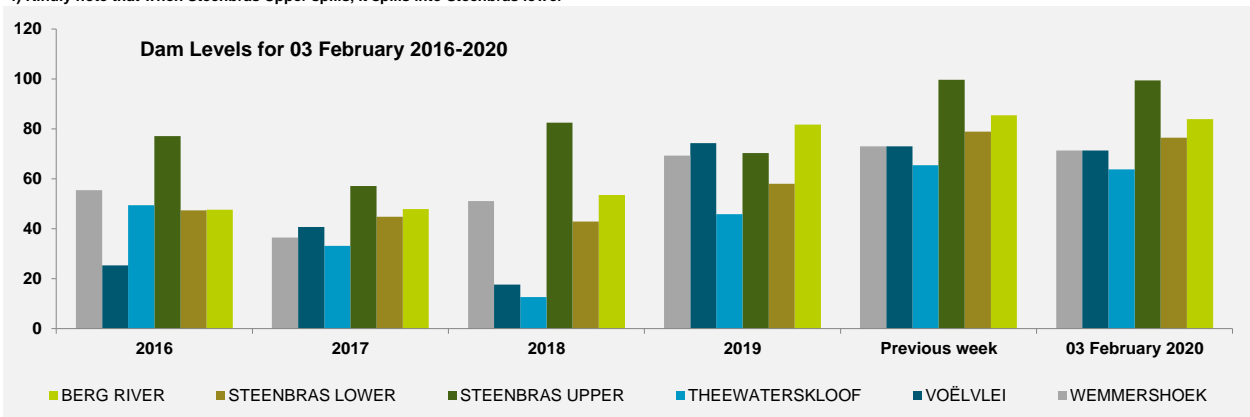

Ten year comparative graph indicating volume of water stored

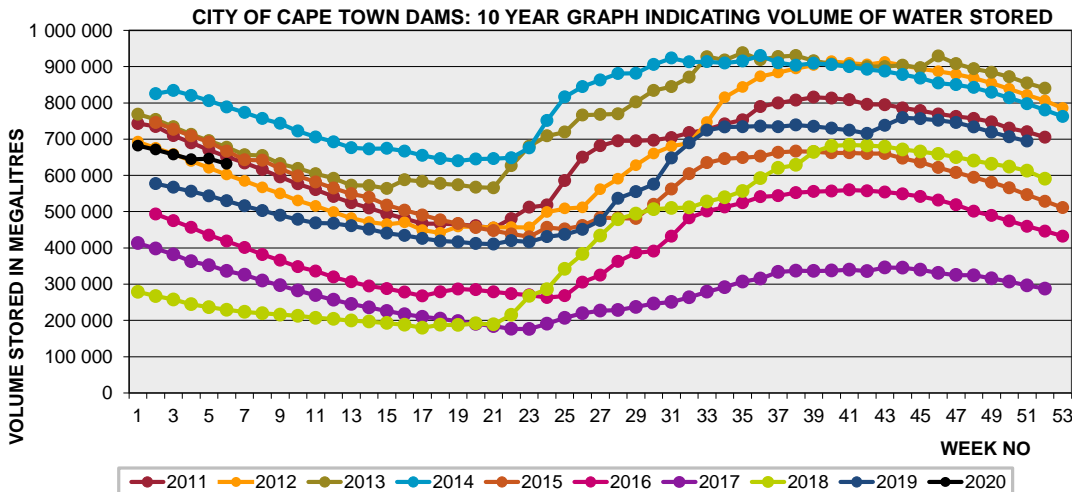

Water stored in minor dams within Cape Town

MINOR DAMS	STORAGE						
	CAPACITY	%		%		%	
	MI	03 February 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	39.7	41.5	28.1	39.6	32.6	47.1
DE VILLIERS (Table Mountain)	243	97.3	98.6	44.4	78.8	62.7	71.6
HELY-HUTCHINSON (Table Mountain)	925	62.6	64.7	97.3	97.6	97.3	89.6
KLEINPLAATS (Simon's Town)	1 368	58.7	61.4	70.2	48.1	54.9	49.5
LAND-EN-ZEEZICHT (Helderberg)	451	77.1	79.4	91.3	96.2	85.8	21.9
LEWIS GAY (Simon's Town)	182	11.1	13.1	14.9	93.2	58.4	37.4
VICTORIA (Table Mountain)	128	85.4	87.5	79.6	87.8	85.8	55.7
WOODHEAD (Table Mountain)	954	61.9	67.7	58.3	94.0	98.6	62.5

Water Quality Sample Pass Rate

Month	Water Quality Compliance (%)	Target (%)
Oct-18	99.05	98
Nov-18	98.99	98
Dec-18	99.00	98
Jan-19	99.00	98
Feb-19	99.05	98
Mar-19	99.01	98
Apr-19	99.10	98
May-19	99.08	98
Jun-19	99.09	98
Jul-19	99.04	98
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis. The latest available is for December).

Rainfall

RAINFALL (mm)	27-Jan	28-Jan	29-Jan	30-Jan	31-Jan	01-Feb	02-Feb	JAN	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.0	13.5
Brooklands	0.0	0.0	1.0	0.0	0.0	0.0	0.0	17.0	28.2
Newlands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	9.5	43.7
Steenbras	0.0	0.0	0.0	0.0	0.0	0.0	0.0	34.2	30.6
Table Mountain (Woodhead)	0.0	0.0	0.0	0.0	0.0	0.0		21.5	56.6
Theewaterskloof	0.0	0.0	0.0	0.0	0.0	0.0	0.0	108.7	21.8
Tygerberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	10.8	12.5
Voëlvlei	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4.0	14.1
Wemmershoek	0.0	0.0	0.0	0.0	0.0	0.0	0.0	21.1	20.0
Wynberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	7.4	22.2

Notes: *Total/cumulative rainfall for month indicated above
LT: Long Term

LT Average Revised and Updated
Total* Month Rainfall Corrected