


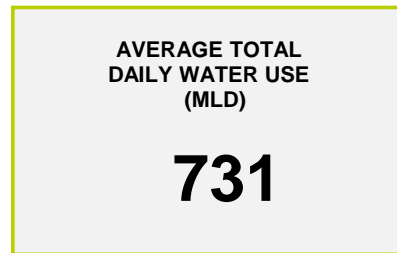


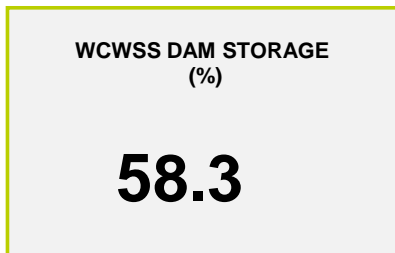


## Headline Statistics

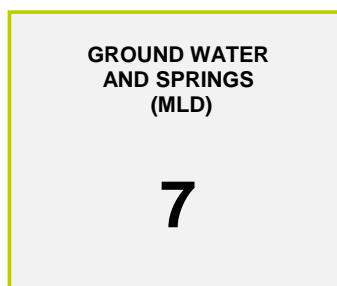

## Water Production from Different Sources

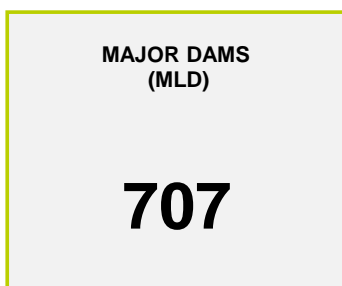

## Overall Water Usage Trend (2010 - Present)

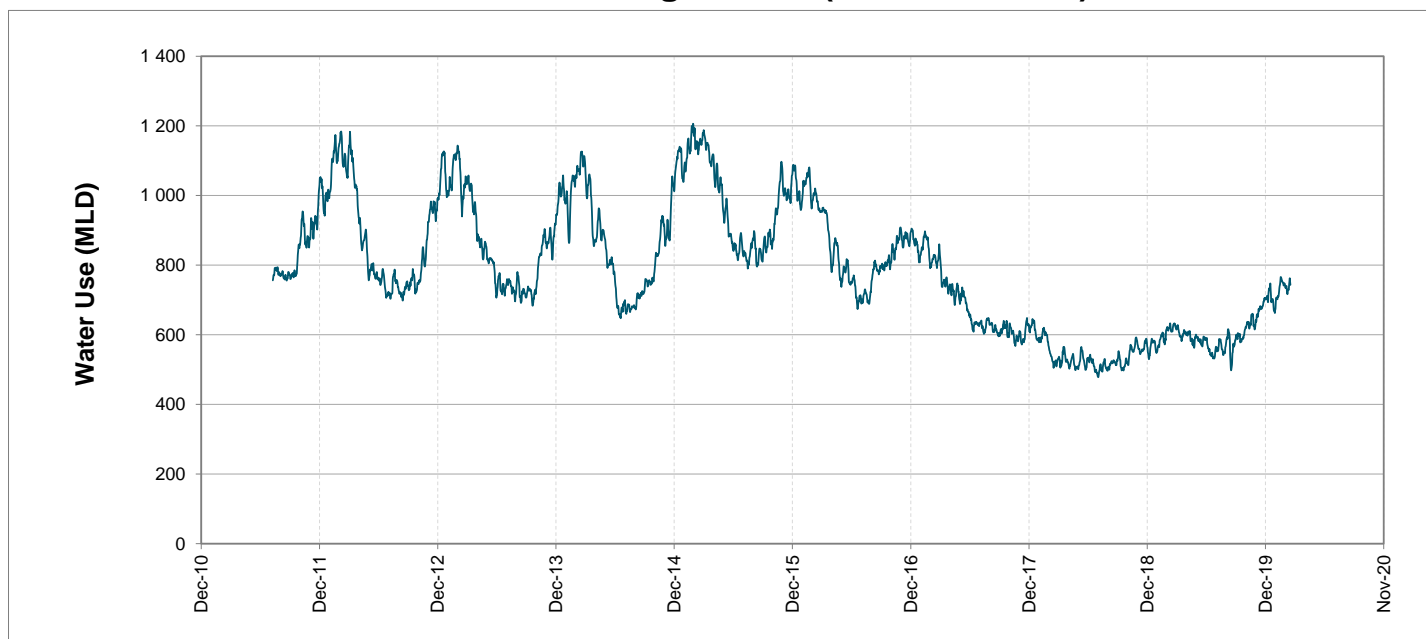

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


# Water Stored in Major Dams (WCWSS)

Overall Percentage Full **58.3%**


Weekly Change **-1.6%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	30 March 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	68.9	70.5	71.7	45.5	35.8	25.1
STEENBRAS LOWER	33 517	60.3	62.0	47.3	37.3	30.8	42.8
STEENBRAS UPPER	31 767	97.1	97.4	69.6	82.3	54.4	59.6
THEEWATERSKLOOF	480 188	54.2	55.5	39.4	10.6	21.9	34.5
VOËLVLEI	164 095	55.3	57.4	61.5	14.4	24.5	19.9
WEMMERSHOEK	58 644	55.0	57.1	55.1	44.0	35.9	49.9
<b>TOTAL STORED</b>	<b>898 221</b>	<b>523 930</b>	<b>537 801</b>	<b>453 508</b>	<b>198 133</b>	<b>240 546</b>	<b>293 543</b>
<b>% STORAGE</b>		<b>58.3%</b>	<b>59.9%</b>	<b>50.5%</b>	<b>22.1%</b>	<b>26.8%</b>	<b>32.7%</b>




## WCWSS Storage Record (2008 - Present)

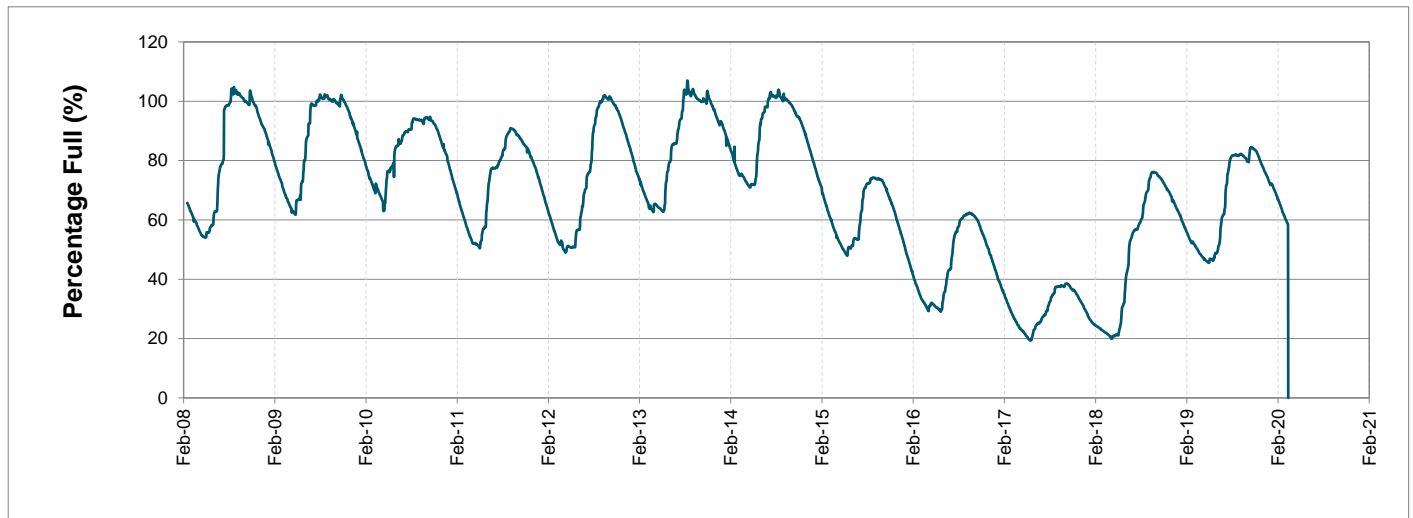

## WCWSS Comparative Storage Graph (5 Years)

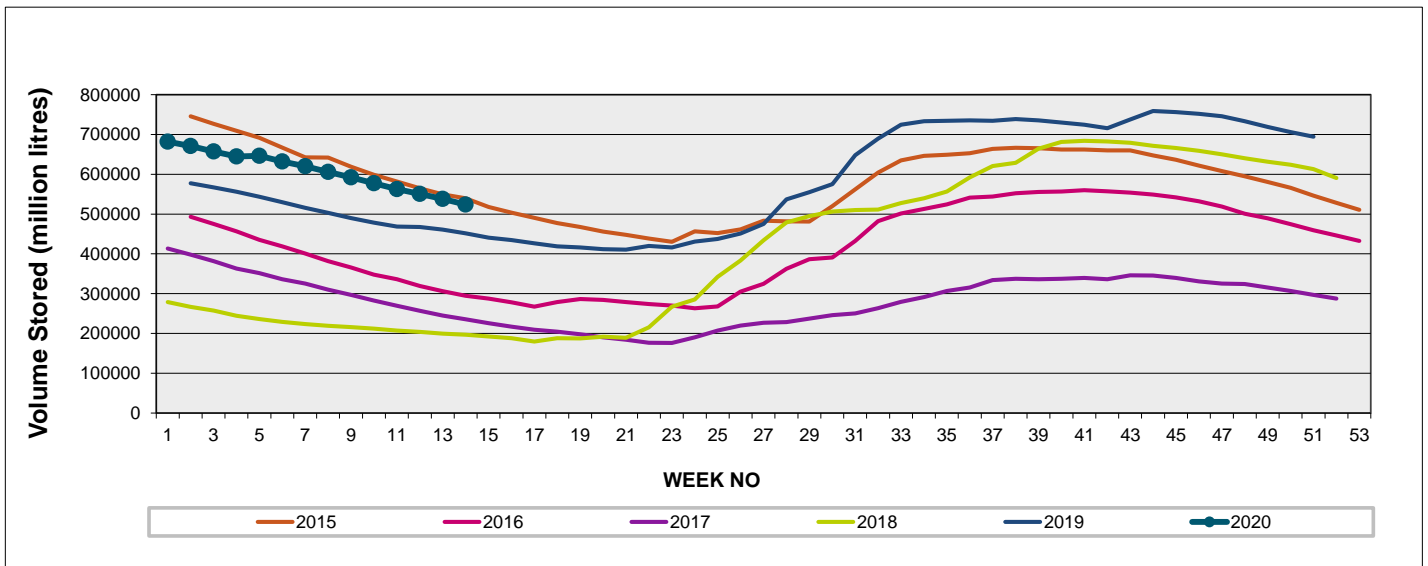

# WCWSS Dam Storage and Water Use Tracking

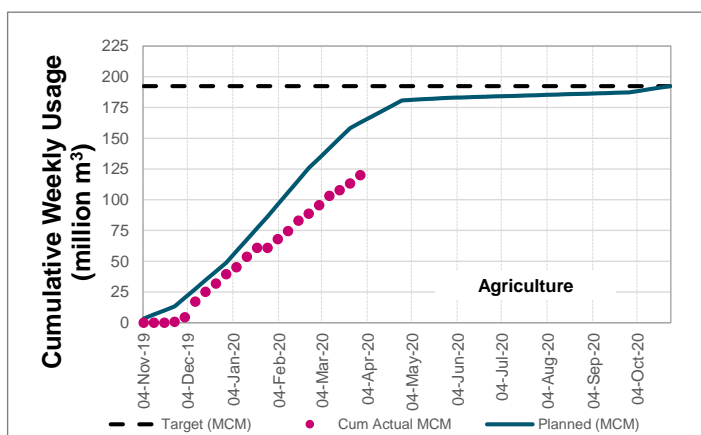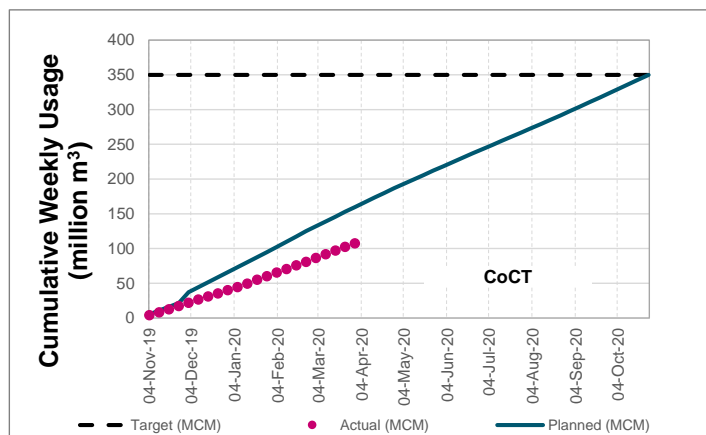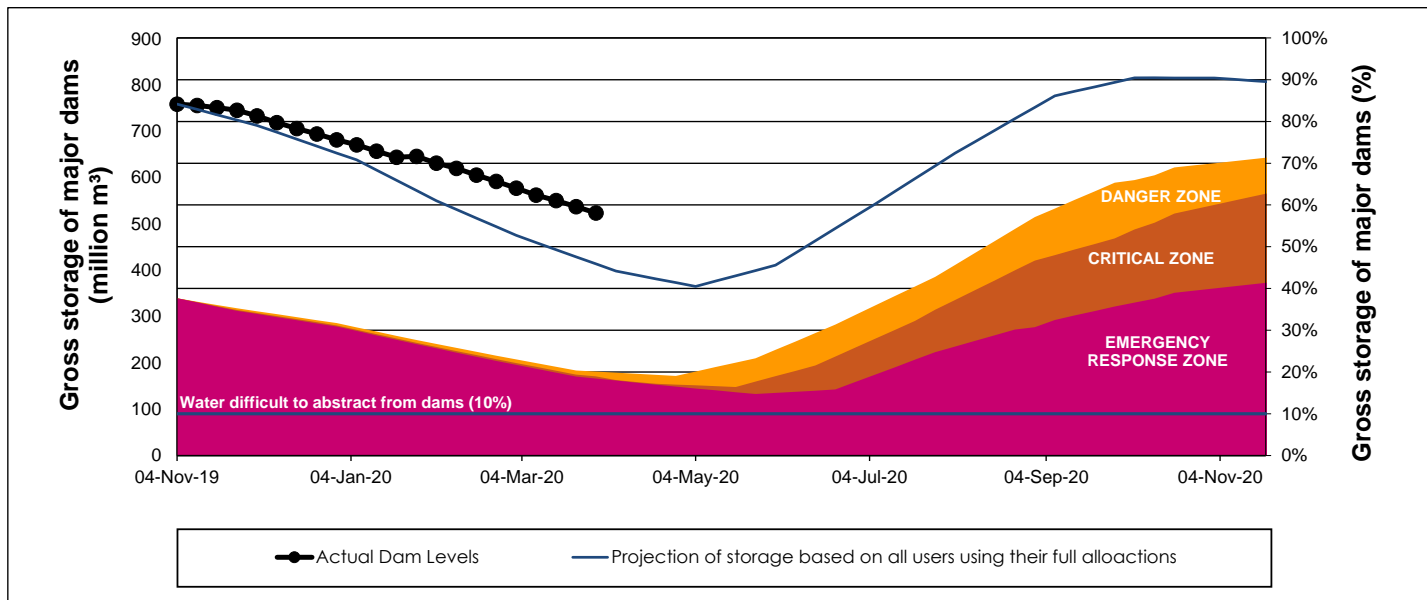

## Water Stored in Minor Dams

Overall Percentage Full **46.4**

Weekly Change **-0.56**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	30 March 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	35.1	35.4	0.0	46.7	32.6	36.9
DE VILLIERS (Table Mountain)	243	93.5	94.0	60.5	55.0	47.7	67.6
HELY-HUTCHINSON (Table Moun)	925	0.0	0.0	28.6	88.6	94.2	77.1
KLEINPLAATS (Simon's Town)	1 368	40.3	41.0	46.3	39.2	42.7	33.2
LAND-EN-ZEEZICHT (Helderberg)	451	62.4	63.9	98.2	95.1	84.8	14.3
LEWIS GAY (Simon's Town)	182	0.0	0.0	0.0	50.5	29.8	4.8
VICTORIA (Table Mountain)	128	75.5	75.5	0.0	66.1	74.6	49.3
WOODHEAD (Table Mountain)	954	87.0	87.7	50.3	56.2	96.1	75.0
<b>Total Stored</b>	<b>4 377</b>	<b>2031.2</b>	<b>2055.6</b>	<b>1967.8</b>	<b>2689.4</b>	<b>3061.2</b>	<b>2229.1</b>
<b>Percentages stored</b>		<b>46.4</b>	<b>47.0</b>	<b>45.0</b>	<b>61.4</b>	<b>69.9</b>	<b>50.9</b>


## Rainfall Recorded

RAINFALL (mm)	23-Mar	24-Mar	25-Mar	26-Mar	27-Mar	28-Mar	29-Mar	Mar	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	19.2
Brooklands	0.0	0.0	2.0	0.0	0.0	0.0	0.0	4.5	35.6
Newlands	0.0	0.0	3.0	0.0	0.0	0.0	0.0	5.0	47.0
Steenbras	0.0	0.0	7.2	0.0	0.0	0.0	0.0	12.0	40.2
Table Mountain (Woodhead)	0.0	0.0	10.5	0.0	0.0	0.0	0.0	13.0	58.5
Theewaterskloof	0.0	0.0	2.2	0.0	0.0	0.0	0.0	29.5	25.3
Tygerberg	0.0	0.0	1.3	0.0	0.0	0.0	0.0	1.3	15.0
Voëlvllei	0.0	0.0	4.5	0.0	0.0	0.0	0.0	4.5	12.1
Wemmershoek	0.0	0.0	1.5	0.0	0.0	0.0	0.0	1.5	29.9
Wynberg	0.0	0.0	2.2	0.0	0.0	0.0	0.0	2.2	26.3

Notes: \*Total/cummulative rainfall for month indicated above  
LT: Long Term

## Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountaneous location

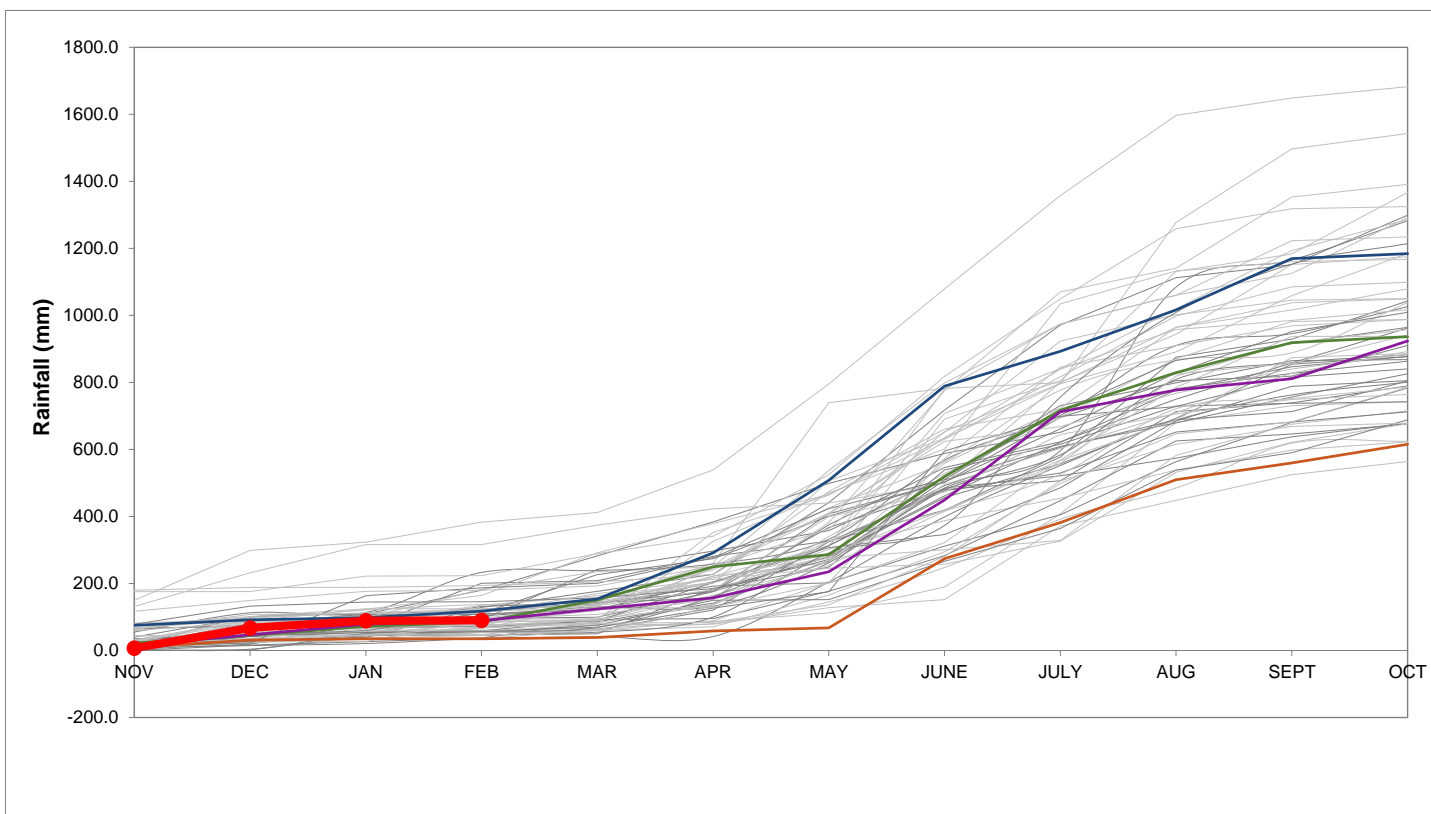

## Drinking Water Quality

### SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Dec-18	99.00	98
Jan-19	99.00	98
Feb-19	99.05	98
Mar-19	99.01	98
Apr-19	99.10	98
May-19	99.08	98
Jun-19	99.09	98
Jul-19	99.04	98
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98
Nov-19	99.14	98
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98

#### Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)