


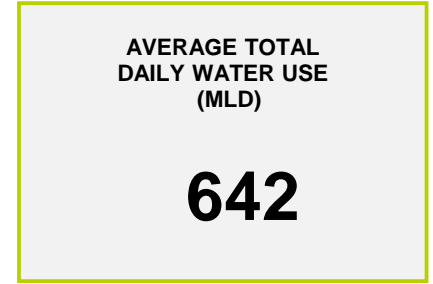


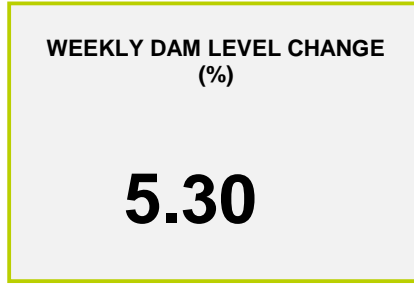


Headline Statistics

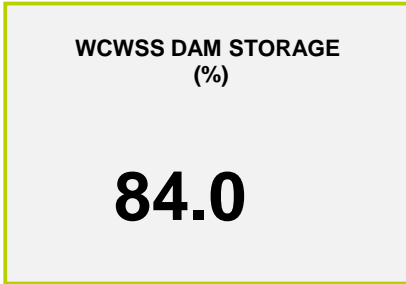

Water Production from Different Sources

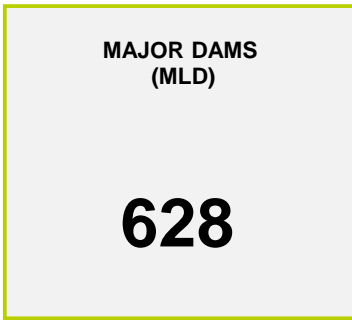

Overall Water Usage Trend (2010 - Present)

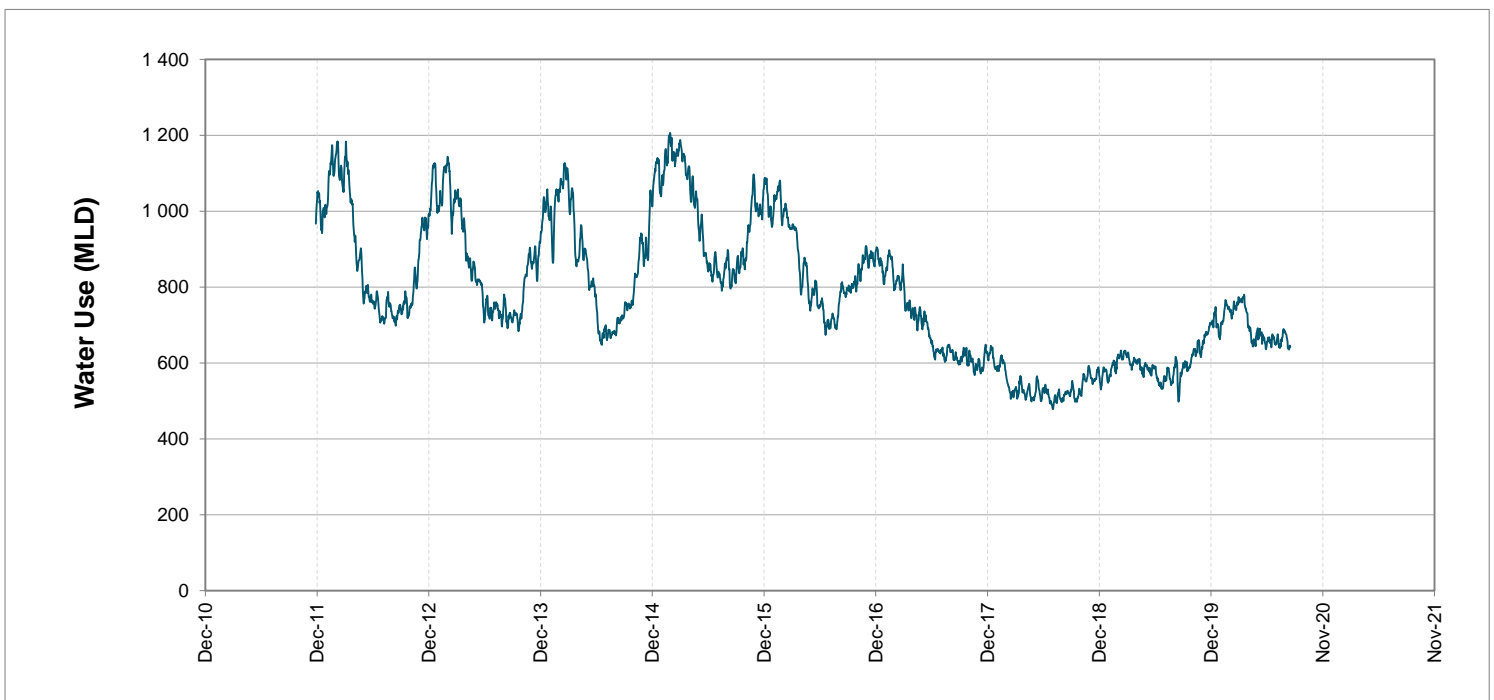

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **84.0%**


Weekly Change **5.3%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	17 August 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	101.2	100.5	100.5	89.2	50.7	64.8
STEENBRAS LOWER	33 517	91.7	80.9	100.6	62.7	29.7	64.2
STEENBRAS UPPER	31 767	100.9	100.6	98.8	100.8	94.8	99.5
THEEWATERSKLOOF	480 188	80.7	73.6	71.7	43.8	24.9	50.4
VOËLVLEI	164 095	76.6	73.6	85.1	63.8	22.7	58.4
WEMMERSHOEK	58 644	80.5	74.3	87.0	83.2	40.2	69.3
TOTAL STORED	898 221	754 690	707 329	730 819	532 829	286 312	515 983
% STORAGE		84.0%	78.7%	81.4%	59.3%	31.9%	57.4%




WCWSS Storage Record (2008 - Present)

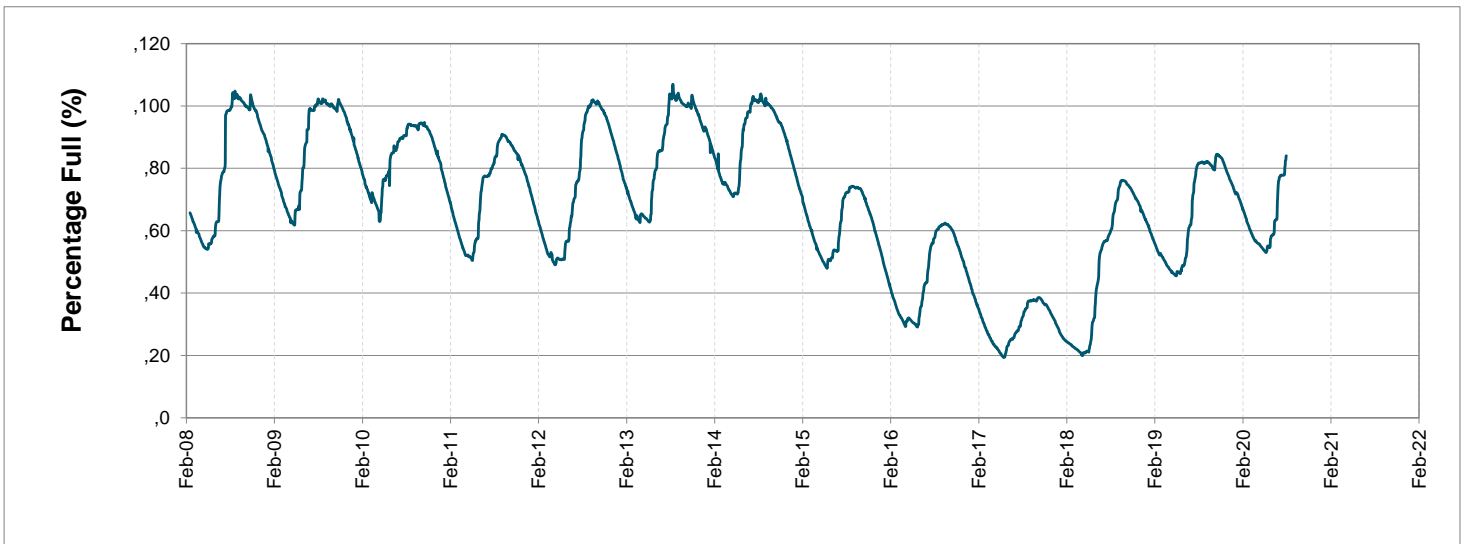

WCWSS Comparative Storage Graph (5 Years)

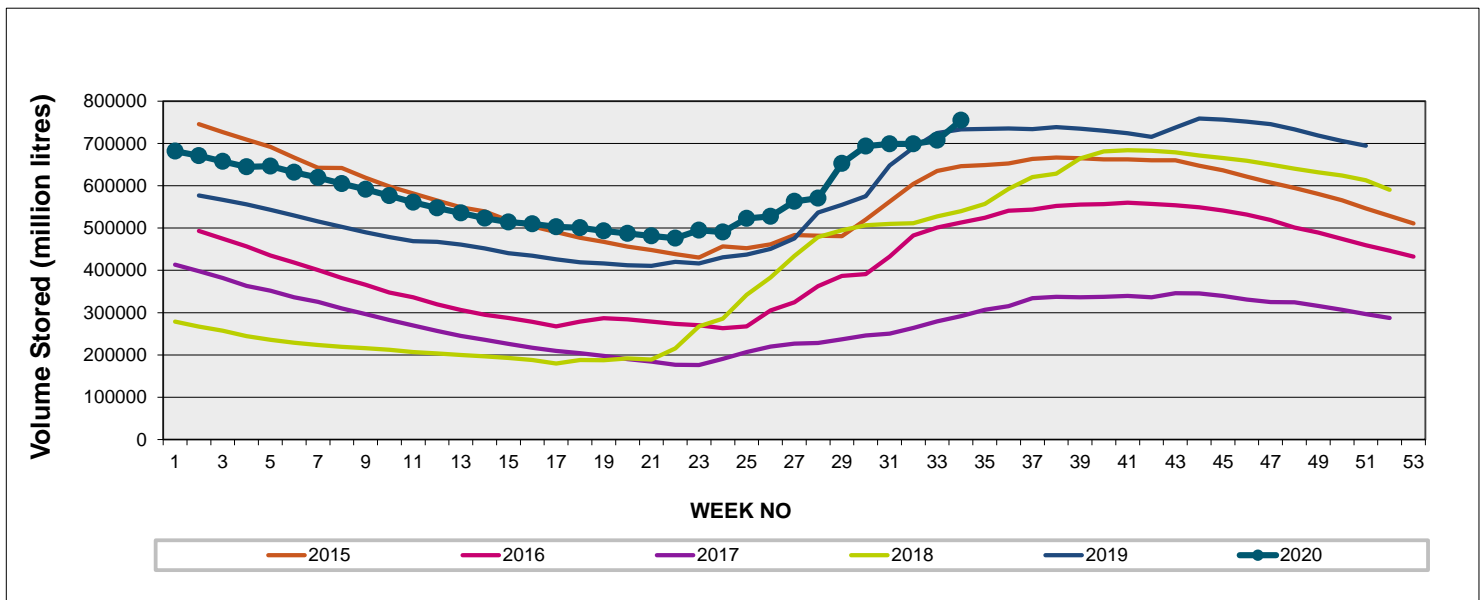

WCWSS Dam Storage and Water Use Tracking

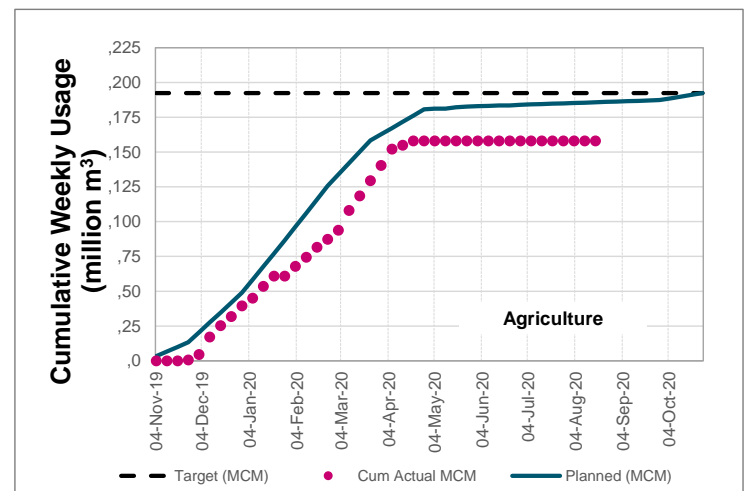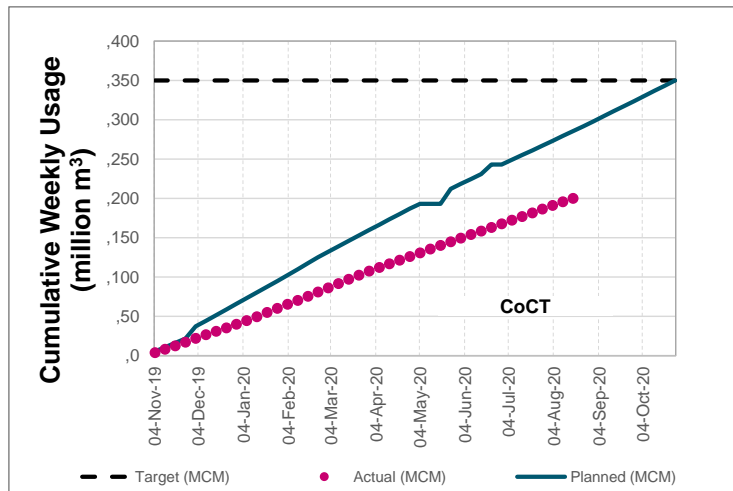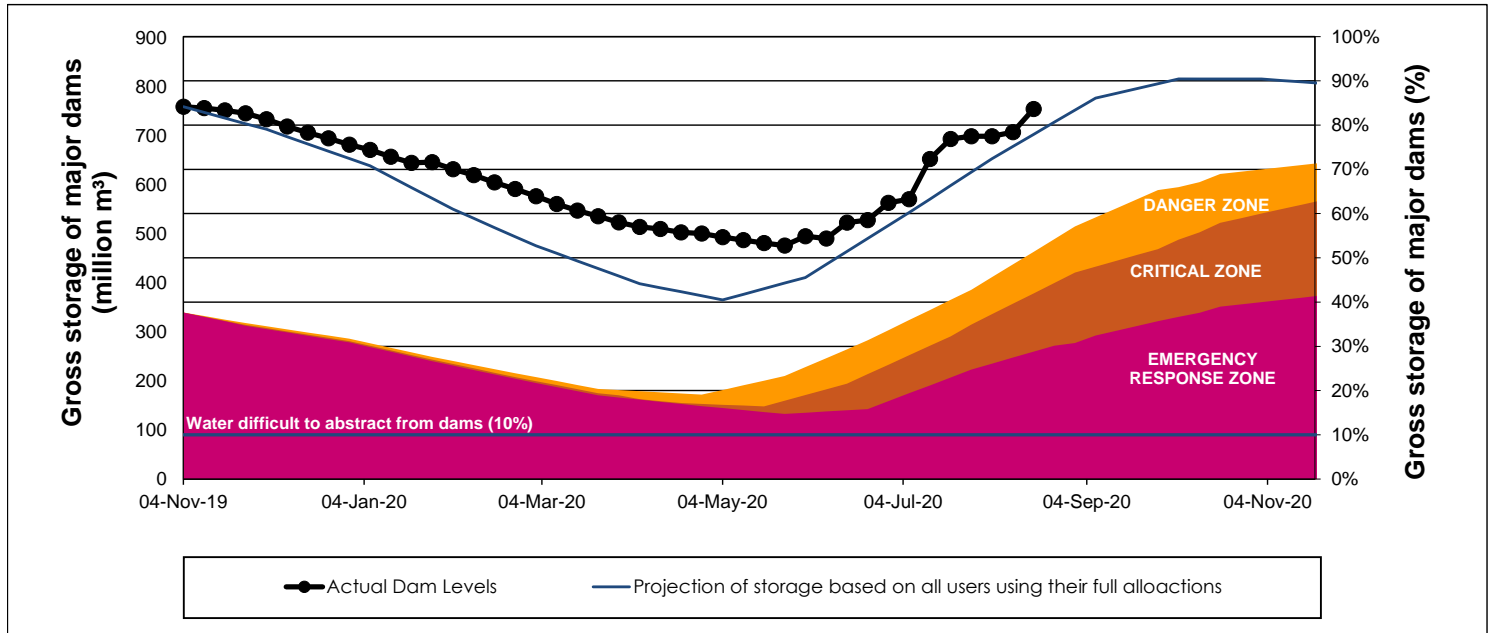

Water Stored in Minor Dams

Overall Percentage Full **89.4**

Weekly Change **4.03**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	17 August 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	98.3	78.8	57.0	78.1	68.4	46.6
DE VILLIERS (Table Mountain)	243	101.2	100.3	100.2	99.1	77.2	100.0
HELY-HUTCHINSON (Table Mountain)	925	100.7	101.4	100.2	98.0	101.2	100.2
KLEINPLAATS (Simon's Town)	1 368	74.1	65.2	79.2	80.6	50.7	89.3
LAND-EN-ZEEZICHT (Helderberg)	451	83.5	79.5	77.5	100.0	65.9	51.0
LEWIS GAY (Simon's Town)	182	92.6	82.2	97.2	62.3	96.3	100.9
VICTORIA (Table Mountain)	128	102.3	100.8	101.2	100.4	102.3	82.7
WOODHEAD (Table Mountain)	954	100.5	100.5	99.6	49.8	100.0	100.0
Total Stored	4 377	3913.3	3736.8	3886.7	3481.0	3434.7	3865.4
Percentages stored		89.4	85.4	88.8	79.5	78.5	88.3


Rainfall Recorded

RAINFALL (mm)	11-Aug	12-Aug	13-Aug	14-Aug	15-Aug	16-Aug	17-Aug	Aug	
								Total*	LT Average
Blackheath Upper	0.2	0.0	4.2	0.0	7.0	6.0	1.5	38.2	77.7
Brooklands	14.0	1.0	10.0	0.0	14.0	7.0	0.0	87.0	135.1
Newlands	29.0	5.5	29.0	0.0	32.0	8.0	1.5	191.5	237.0
Steenbras	11.2	1.5	10.9	0.0	26.9	35.1	4.2	160.3	127.1
Table Mountain (Woodhead)	30.5	3.0	17.5	0.0	34.0	14.0		157.5	215.8
Theewaterskloof	1.0	1.6	1.4	0.0	6.7	10.5	0.0	47.3	76.0
Tygerberg	0.0	7.0	2.3	0.0	11.3	5.0	2.5	49.9	86.5
Voëlvlei	0.0	9.0	4.0	0.0	5.5	0.0	0.0	43.8	90.2
Wemmershoek	7.9	7.3	11.0	0.0	20.0	9.4	0.0	133.9	146.0
Wynberg	12.2	6.0	17.1	0.0	19.7	8.0	2.0	134.5	191.1

Notes: *Total/cummulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountaneous location

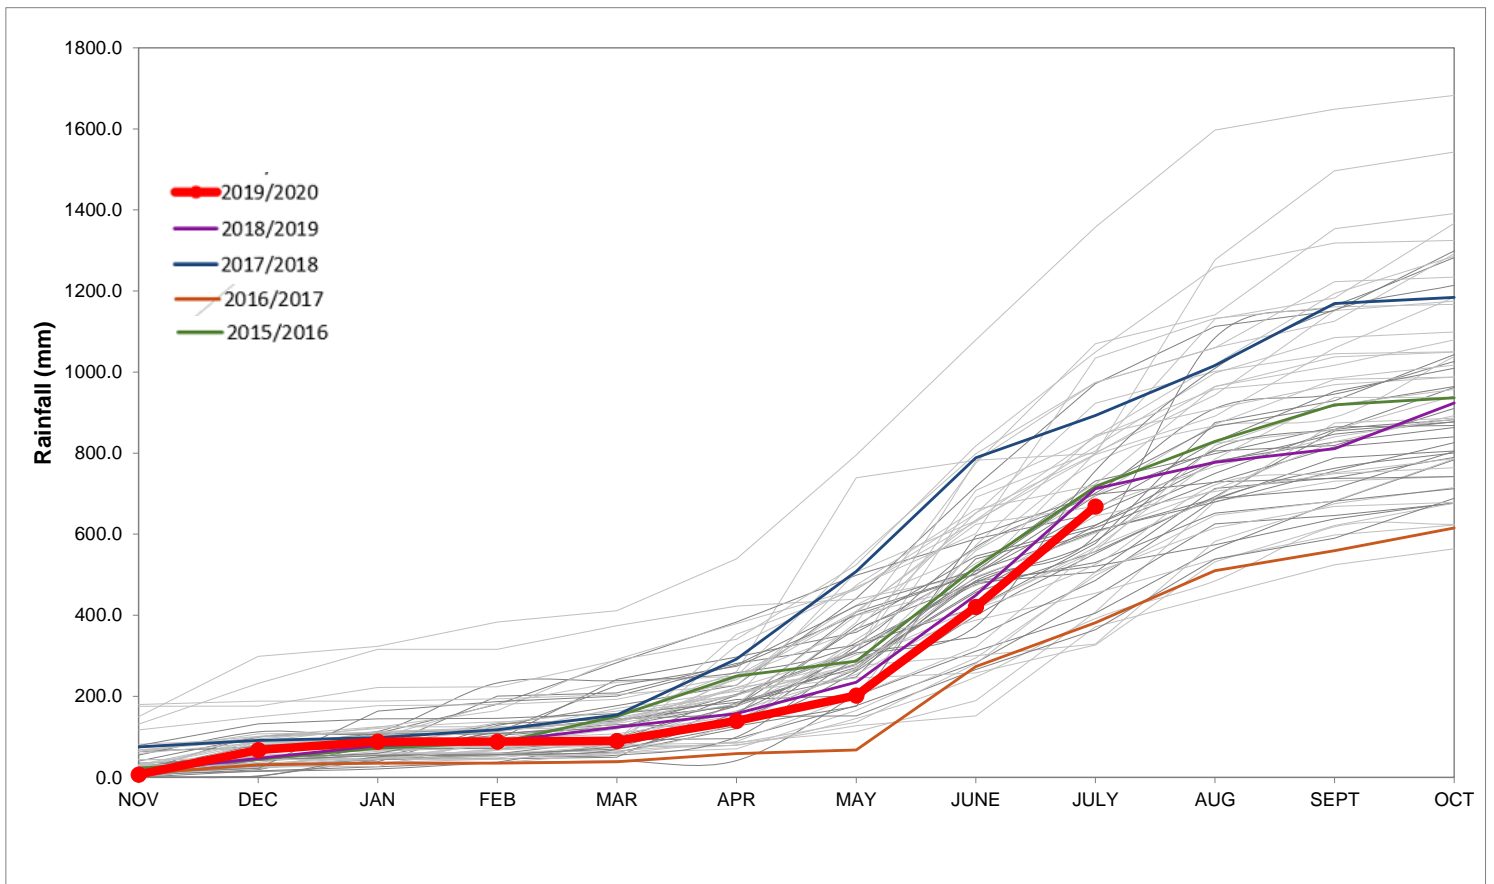

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Apr-19	99.10	98
May-19	99.08	98
Jun-19	99.09	98
Jul-19	99.04	98
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98
Nov-19	99.14	98
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)