


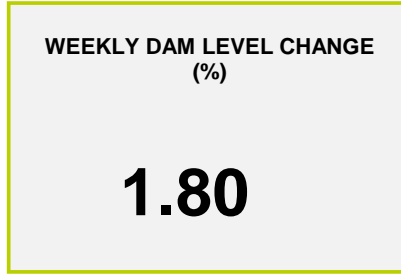


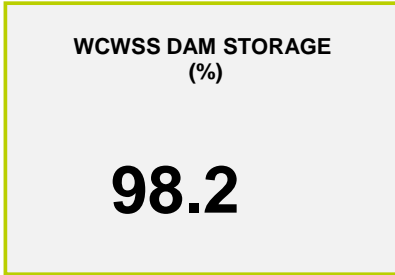


Headline Statistics

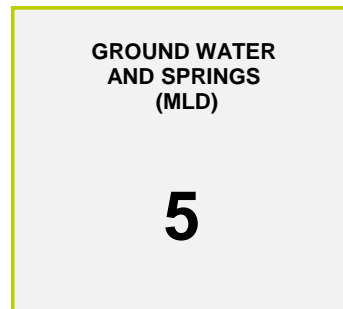

Water Production from Different Sources

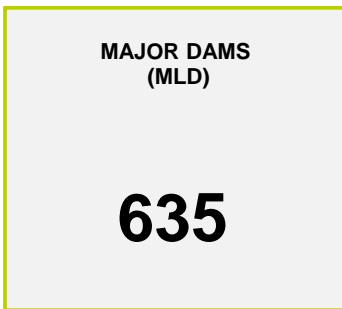

Overall Water Usage Trend (2010 - Present)

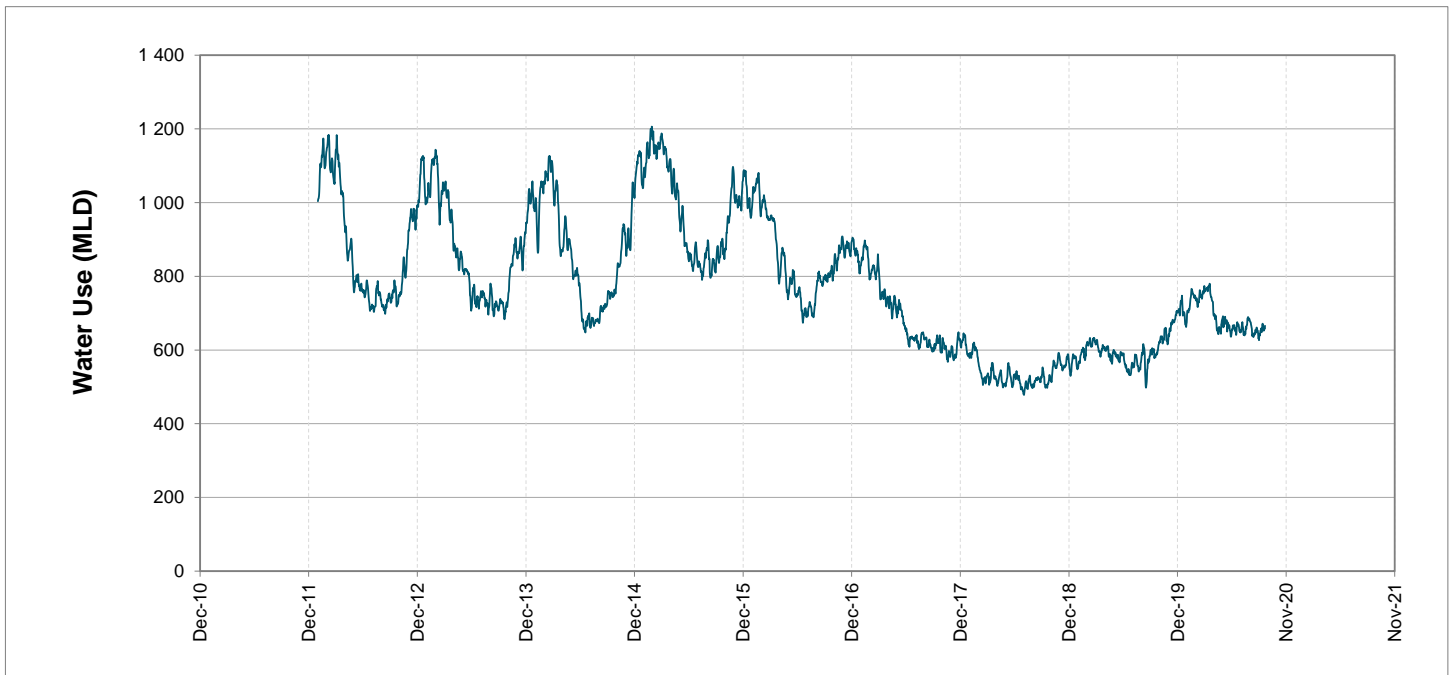

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **98.2%**


Weekly Change **1.8%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	21 September 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	100.3	100.5	99.4	100.2	63.2	71.7
STEENBRAS LOWER	33 517	101.0	99.9	98.7	91.3	47.0	68.5
STEENBRAS UPPER	31 767	99.4	99.3	86.0	94.8	99.7	97.4
THEEWATERSKLOOF	480 188	98.1	95.6	72.5	55.4	28.6	53.3
VOËLVLEI	164 095	96.7	94.4	88.7	88.9	26.7	68.7
WEMMERSHOEK	58 644	96.8	95.4	91.4	93.9	44.2	70.0
TOTAL STORED	898 221	882 411	865 560	736 985	657 869	336 469	556 661
% STORAGE		98.2%	96.4%	82.0%	73.2%	37.5%	62.0%




WCWSS Storage Record (2008 - Present)

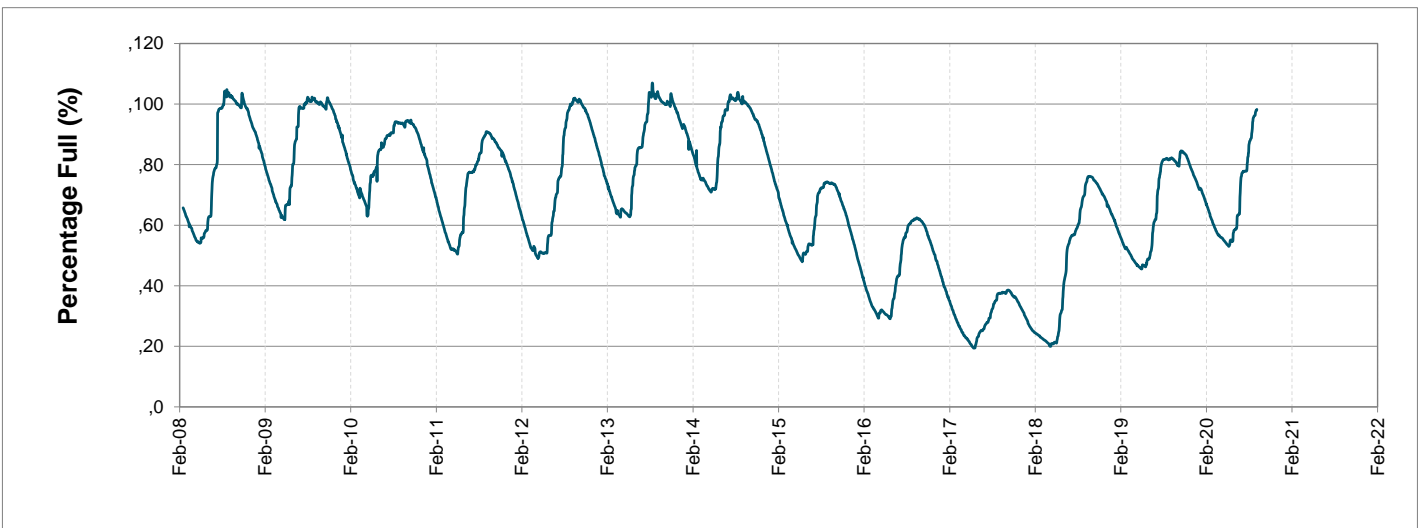

WCWSS Comparative Storage Graph (5 Years)

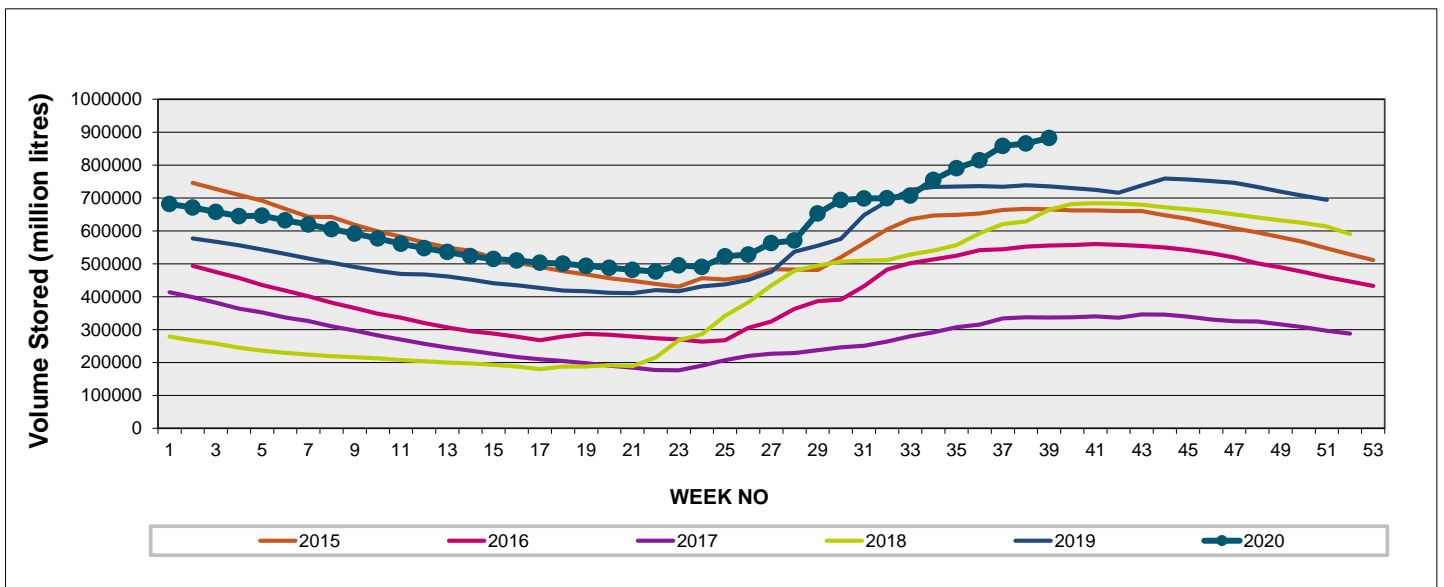

WCWSS Dam Storage and Water Use Tracking

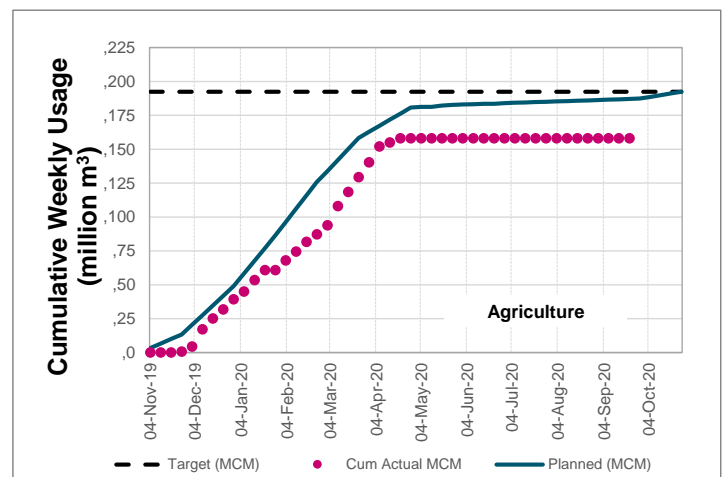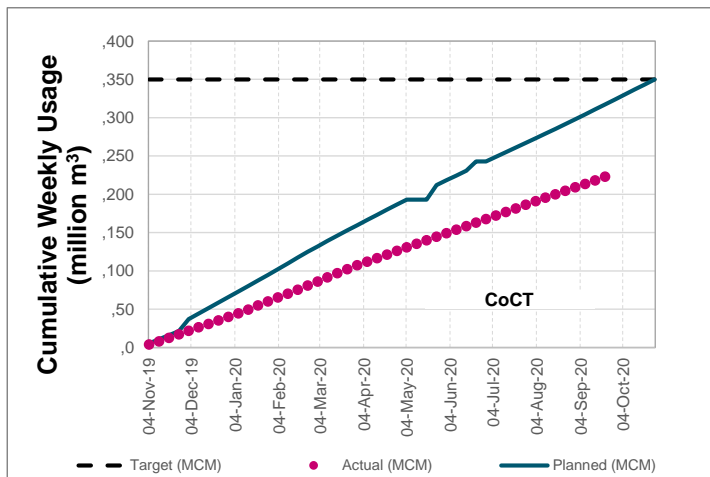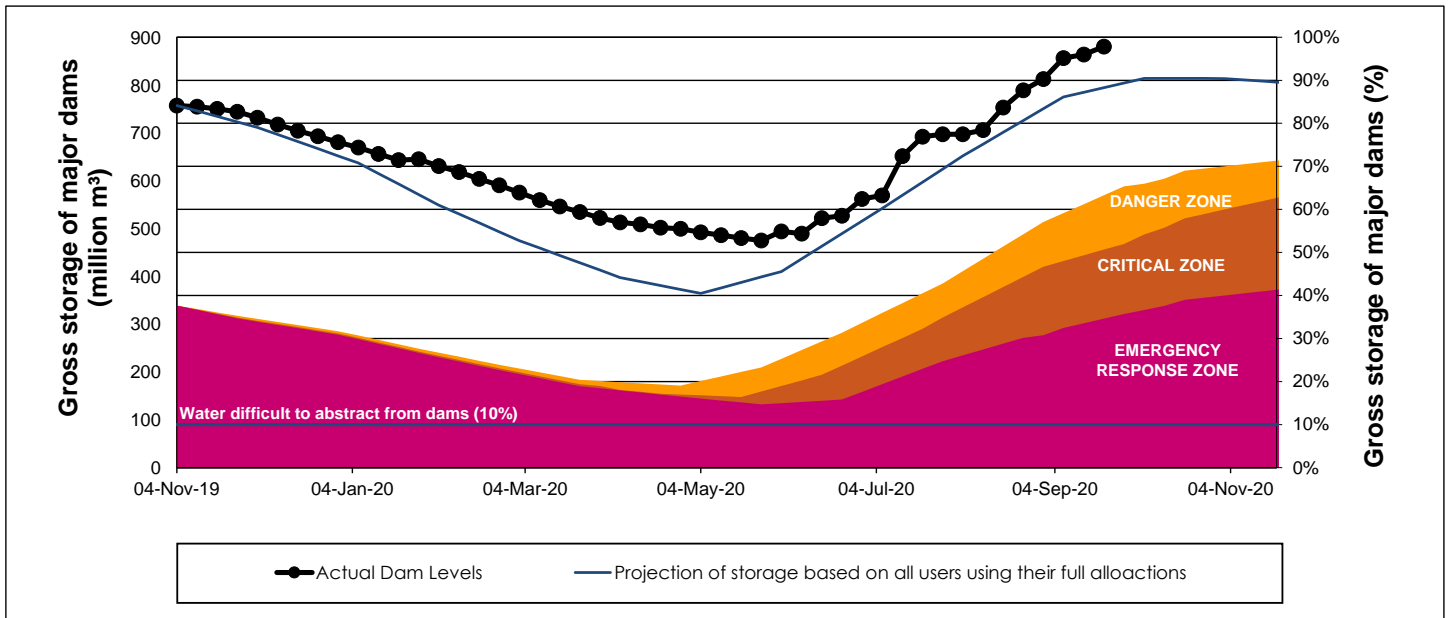

Water Stored in Minor Dams

Overall Percentage Full **97.2**

Weekly Change **1.19**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	21 September 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	100.0	100.0	53.3	100.0	81.8	44.3
DE VILLIERS (Table Mountain)	243	100.0	100.0	99.7	100.5	89.6	95.1
HELY-HUTCHINSON (Table Mount)	925	100.2	100.2	100.2	100.5	100.0	100.2
KLEINPLAATS (Simon's Town)	1 368	99.6	98.0	81.2	99.8	70.2	97.5
LAND-EN-ZEEZICHT (Helderberg)	451	93.2	91.7	83.0	100.0	87.3	65.9
LEWIS GAY (Simon's Town)	182	91.7	97.2	75.5	100.9	90.5	76.4
VICTORIA (Table Mountain)	128	100.8	100.4	100.4	101.5	100.4	96.6
WOODHEAD (Table Mountain)	954	97.5	94.0	83.6	75.3	89.5	99.9
Total Stored	4 377	4253.3	4201.1	3741.5	4096.8	3713.8	4002.8
Percentages stored		97.2	96.0	85.5	93.6	84.8	91.5


Rainfall Recorded

RAINFALL (mm)	15-Sep	16-Sep	17-Sep	18-Sep	19-Sep	20-Sep	21-Sep	Sep	
								Total*	LT Average
Blackheath Upper	0.0	1.0	0.0	0.0	0.0	0.0		36.5	43.5
Brooklands	0.0	5.0	0.0	1.0	0.0	1.0		53.0	85.7
Newlands	0.0	19.5	0.0	0.0	0.0	16.0		172.0	168.3
Steenbras	0.0	10.5	0.0	0.7	0.0	4.5		68.2	83.6
Table Mountain (Woodhead)	0.0	19.0	0.0	0.0	0.0			123.0	147.2
Theewaterskloof	0.0	0.0	0.0	0.0	0.0	0.2		38.6	41.1
Tygerberg	0.0	0.0	0.0	0.0	0.0	1.3		52.9	47.0
Voëlvlei	0.0	0.2	0.0	0.0	0.0	0.0		19.6	45.1
Wemmershoek	4.0	2.3	0.0	0.0	0.0	9.9		126.9	90.3
Wynberg	0.0	5.5	0.0	0.0	0.0	5.2		147.7	97.8

Notes: *Total/cummulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountaneous location

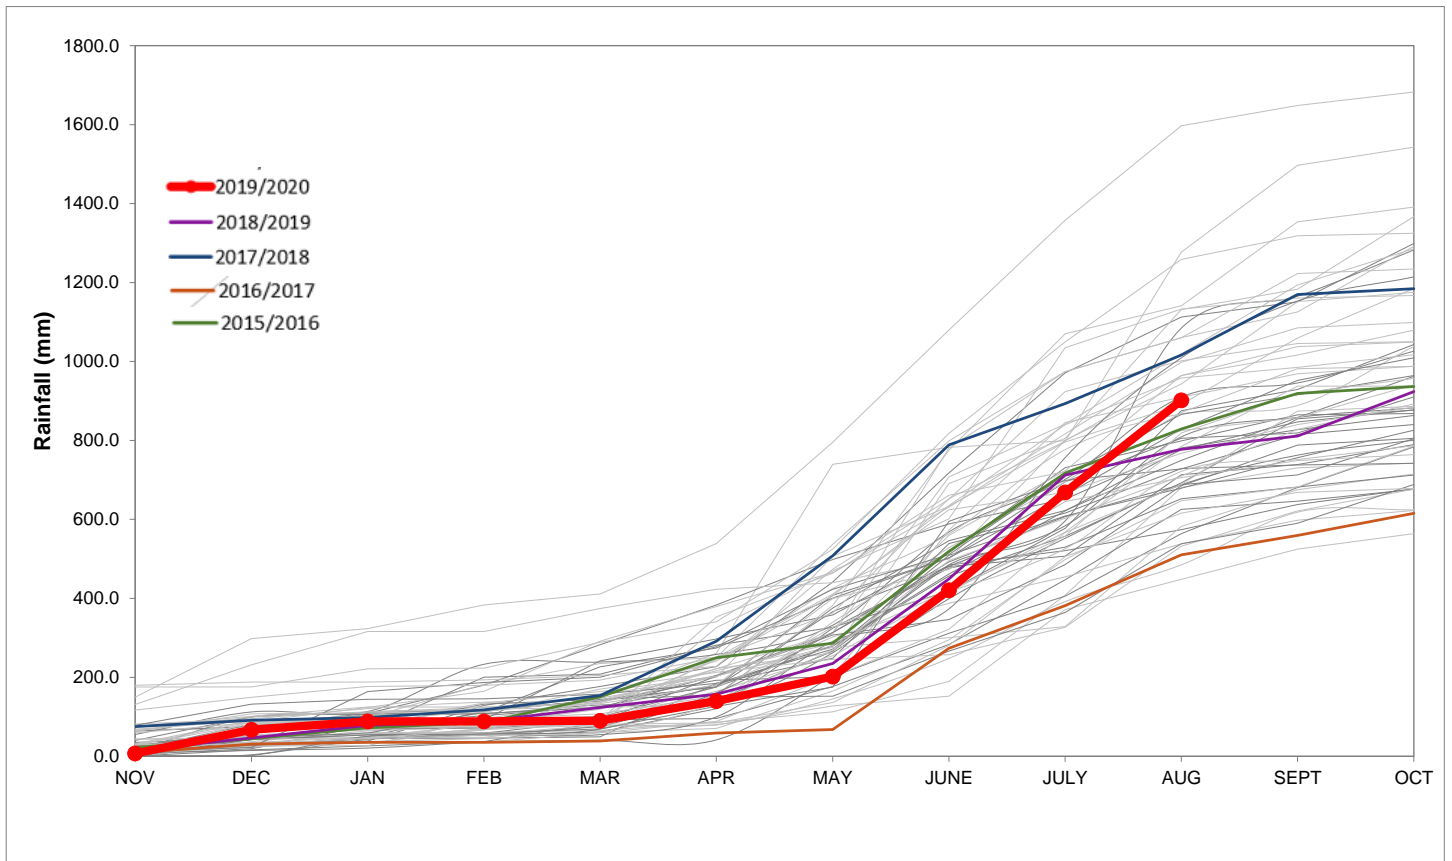

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
May-19	99.08	98
Jun-19	99.09	98
Jul-19	99.04	98
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98
Nov-19	99.14	98
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.