


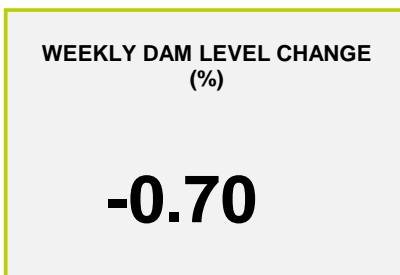
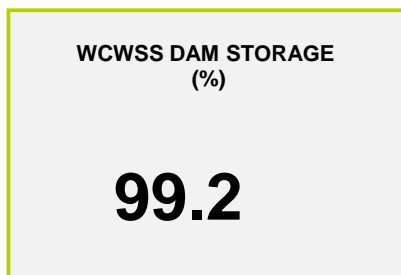


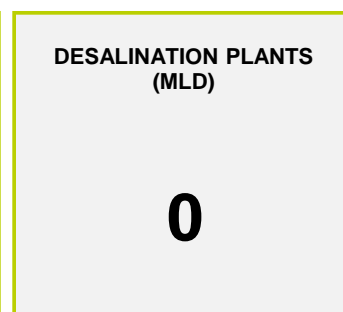


Headline Statistics

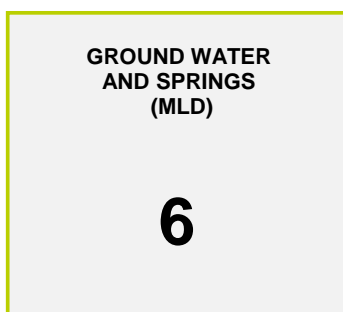

Water Production from Different Sources

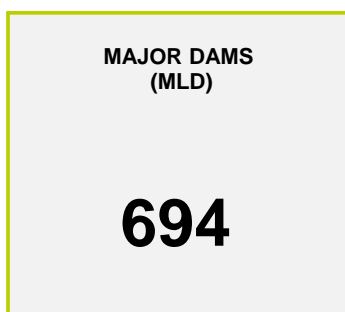

Overall Water Usage Trend (2010 - Present)

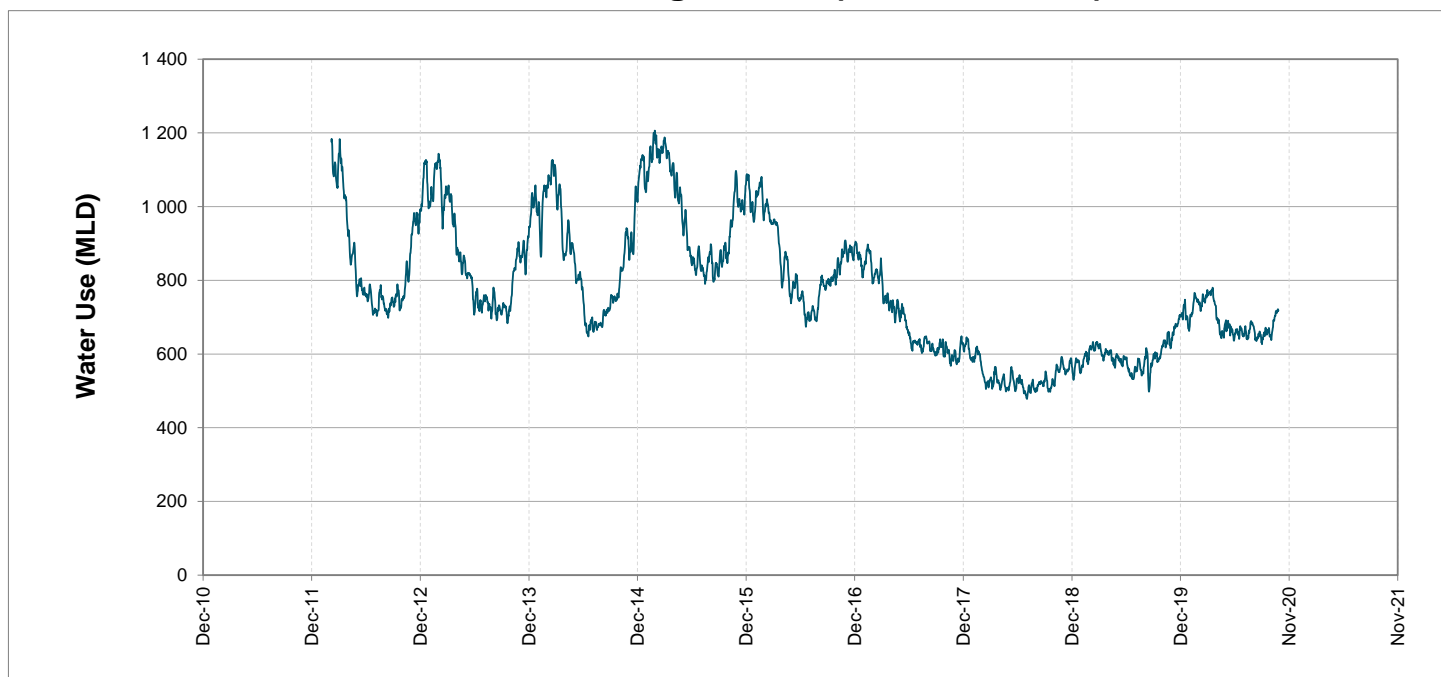

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **99.2%**


Weekly Change **-0.7%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	26 October 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	99.9	100.0	102.2	99.2	68.4	73.7
STEENBRAS LOWER	33 517	95.8	97.8	98.5	87.8	53.5	61.0
STEENBRAS UPPER	31 767	91.8	95.9	79.7	73.0	101.3	89.5
THEEWATERSKLOOF	480 188	100.8	101.2	72.3	58.3	27.6	51.7
VOËLVLEI	164 095	97.0	97.9	86.8	96.1	28.4	71.3
WEMMERSHOEK	58 644	96.8	98.1	92.9	92.5	48.1	63.4
TOTAL STORED	898 221	891 349	897 333	735 427	673 444	346 413	547 024
% STORAGE		99.2%	99.9%	81.9%	75.0%	38.6%	60.9%




WCWSS Storage Record (2008 - Present)

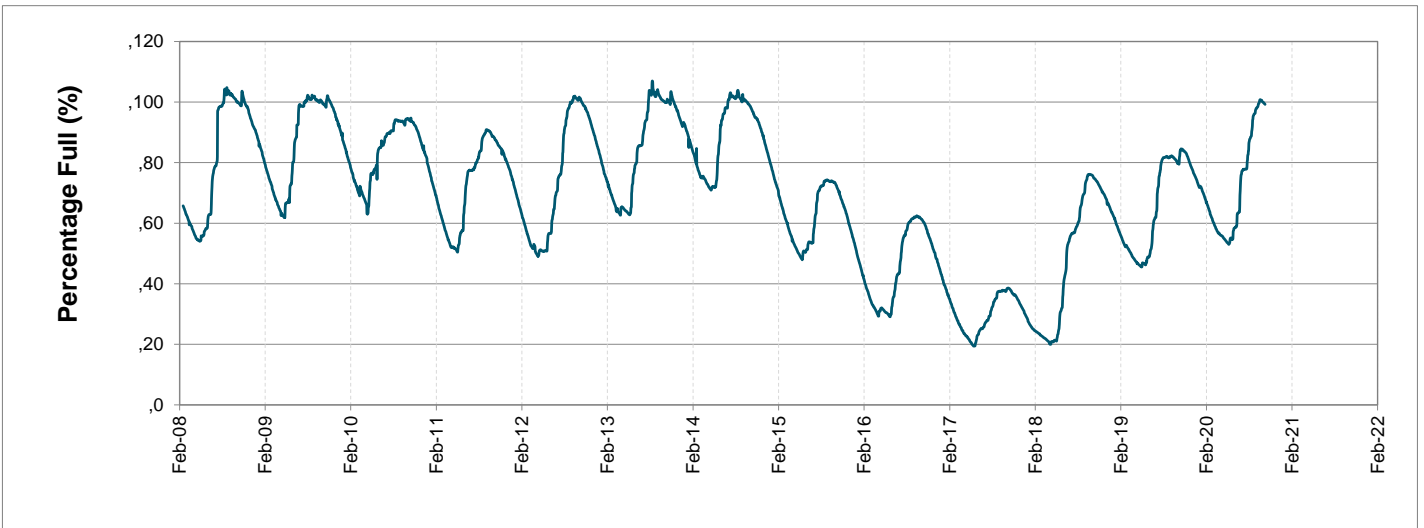

WCWSS Comparative Storage Graph (5 Years)

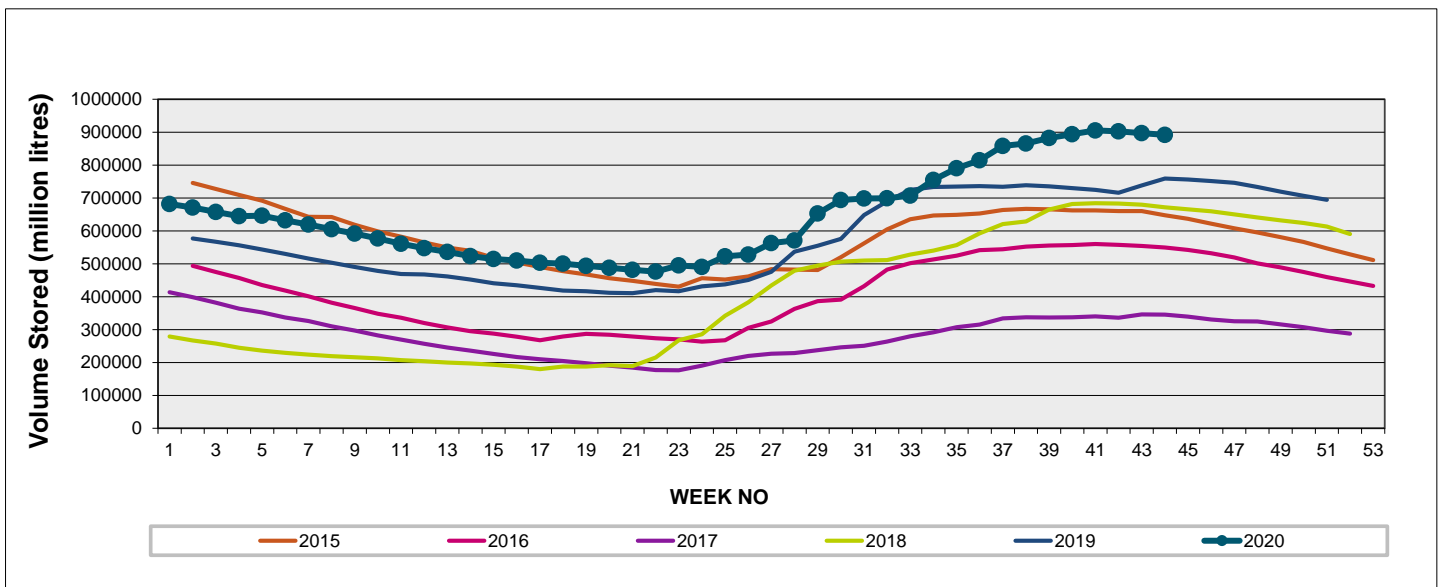

WCWSS Dam Storage and Water Use Tracking

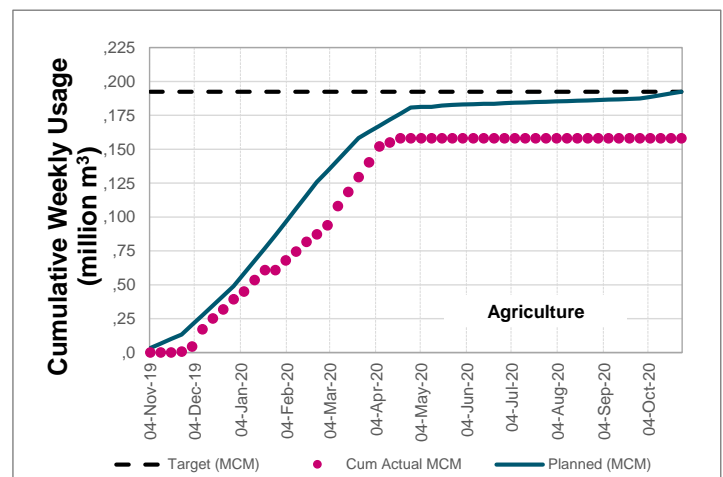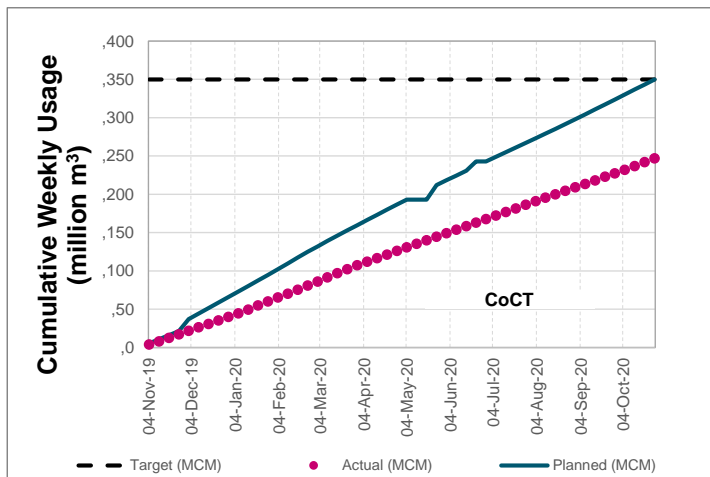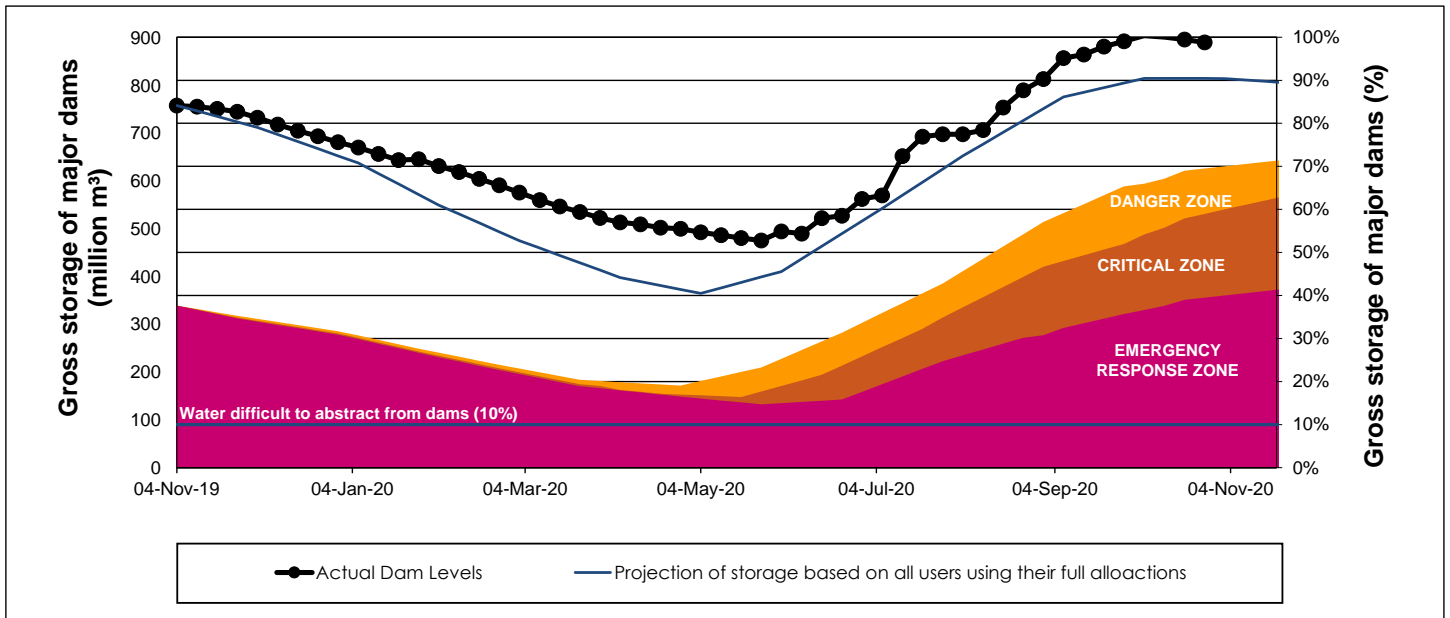

Water Stored in Minor Dams

Overall Percentage Full **90.4**

Weekly Change **-3.50**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	26 October 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	80.6	86.9	54.6	78.3	68.0	39.9
DE VILLIERS (Table Mountain)	243	99.8	99.8	101.7	91.7	97.7	87.9
HELY-HUTCHINSON (Table Mount)	925	95.3	99.2	104.4	97.8	100.5	100.0
KLEINPLAATS (Simon's Town)	1 368	94.7	99.8	80.2	97.5	66.5	87.2
LAND-EN-ZEEZICHT (Helderberg)	451	96.2	95.8	85.5	100.0	100.0	71.3
LEWIS GAY (Simon's Town)	182	100.9	95.4	58.2	90.0	90.9	83.0
VICTORIA (Table Mountain)	128	98.5	99.6	106.8	96.6	101.2	100.4
WOODHEAD (Table Mountain)	954	77.7	83.2	94.7	66.9	97.0	99.8
Total Stored	4 377	3955.2	4108.3	3871.1	3887.3	3804.3	3884.2
Percentages stored		90.4	93.9	88.4	88.8	86.9	88.7


Rainfall Recorded

RAINFALL (mm)	20-Oct	21-Oct	22-Oct	23-Oct	24-Oct	25-Oct	26-Oct	Oct	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4.3	26.8
Brooklands	0.0	0.0	0.0	0.0	1.0	0.0	0.0	30.0	47.7
Newlands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	18.0	72.2
Steenbras	0.0	0.0	0.0	0.0	0.0	0.0	0.0	40.2	55.4
Table Mountain (Woodhead)	0.0	0.0	0.0	2.0	0.0	0.0	0.0	39.5	83.7
Theewaterskloof	0.0	0.0	0.0	0.0	0.0	0.0	5.6	51.5	44.1
Tygerberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4.2	28.9
Voëlvlei	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.0	26.7
Wemmershoek	0.0	0.0	0.0	0.0	0.0	0.0	0.0	10.4	43.0
Wynberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	14.5	51.1

Notes: *Total/cumulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

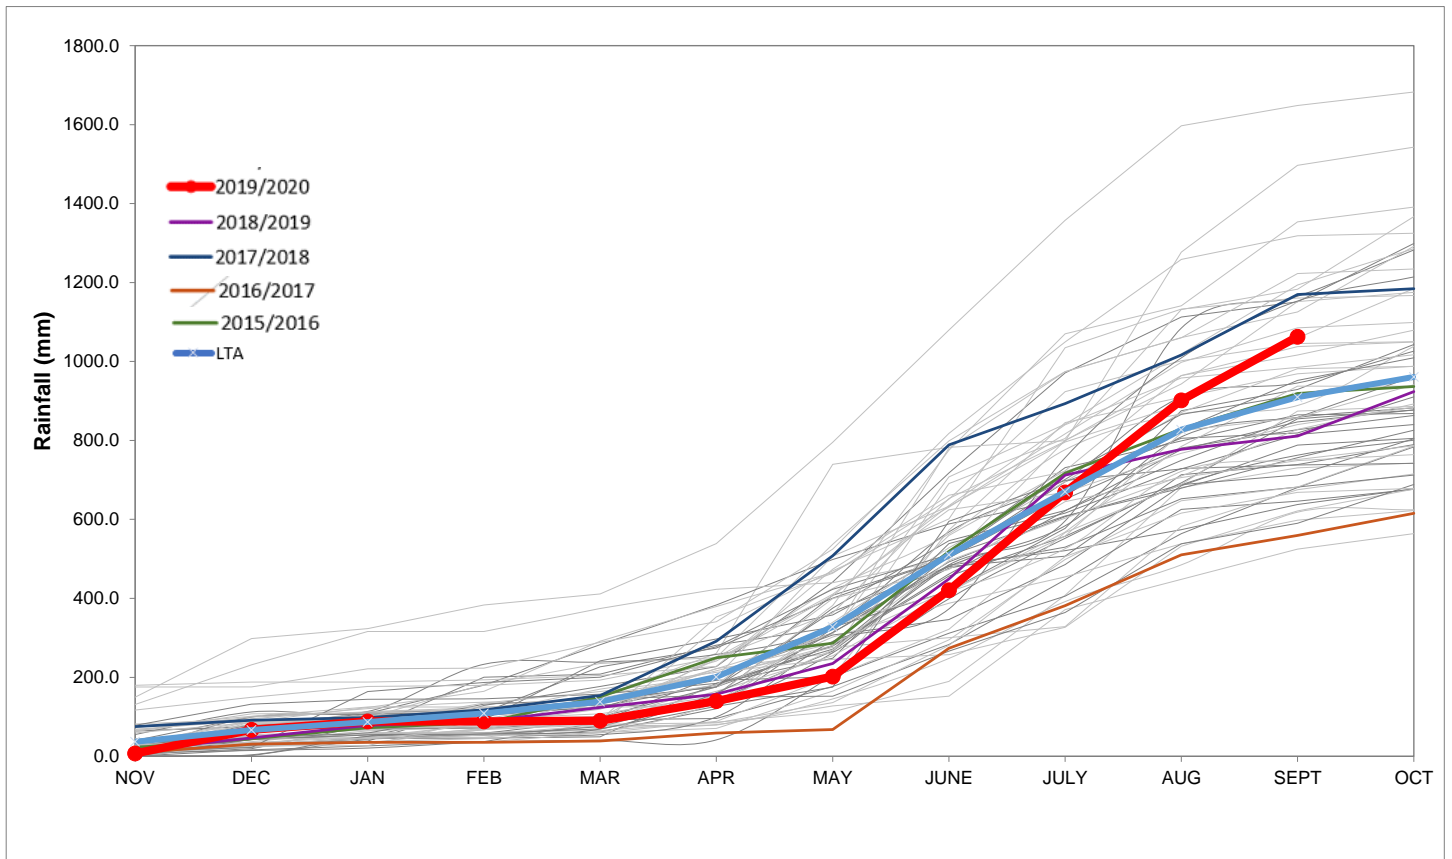

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Jul-19	99.04	98
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98
Nov-19	99.14	98
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)