




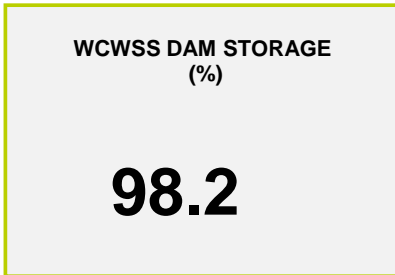


Headline Statistics

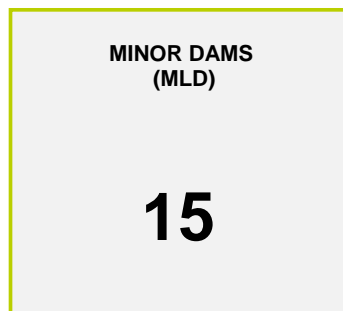

Water Production from Different Sources

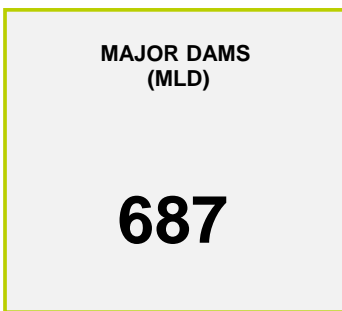

Overall Water Usage Trend (2010 - Present)

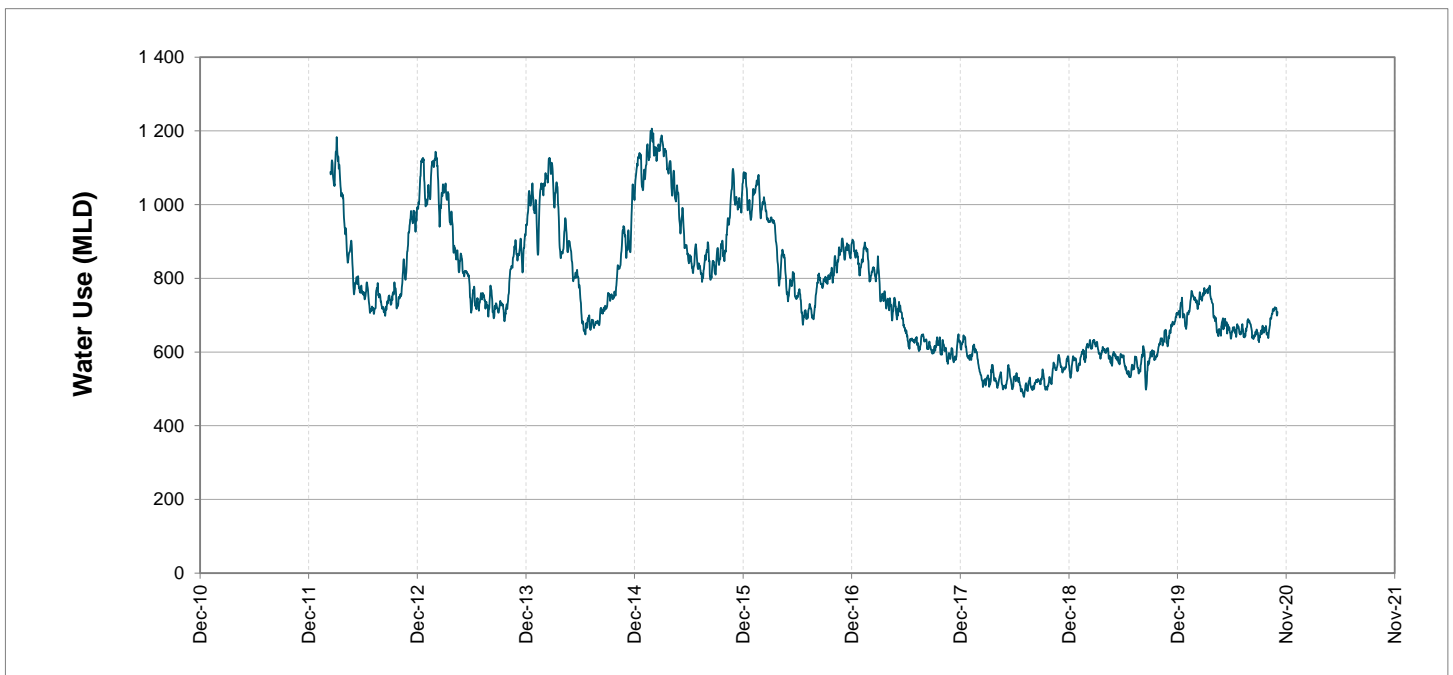

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **98.2%**


Weekly Change **-1.0%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	02 November 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	99.7	99.9	100.4	99.3	68.4	72.8
STEENBRAS LOWER	33 517	94.1	95.8	100.9	86.1	53.4	58.7
STEENBRAS UPPER	31 767	83.5	91.8	88.7	71.3	99.9	88.4
THEEWATERSKLOOF	480 188	100.0	100.8	75.6	57.7	27.0	51.1
VOËLVLEI	164 095	96.2	97.0	89.9	96.0	28.5	70.2
WEMMERSHOEK	58 644	95.7	96.8	95.6	91.7	48.6	61.4
TOTAL STORED	898 221	881 878	891 349	759 190	668 785	343 459	539 080
% STORAGE		98.2%	99.2%	84.5%	74.5%	38.2%	60.0%




WCWSS Storage Record (2008 - Present)

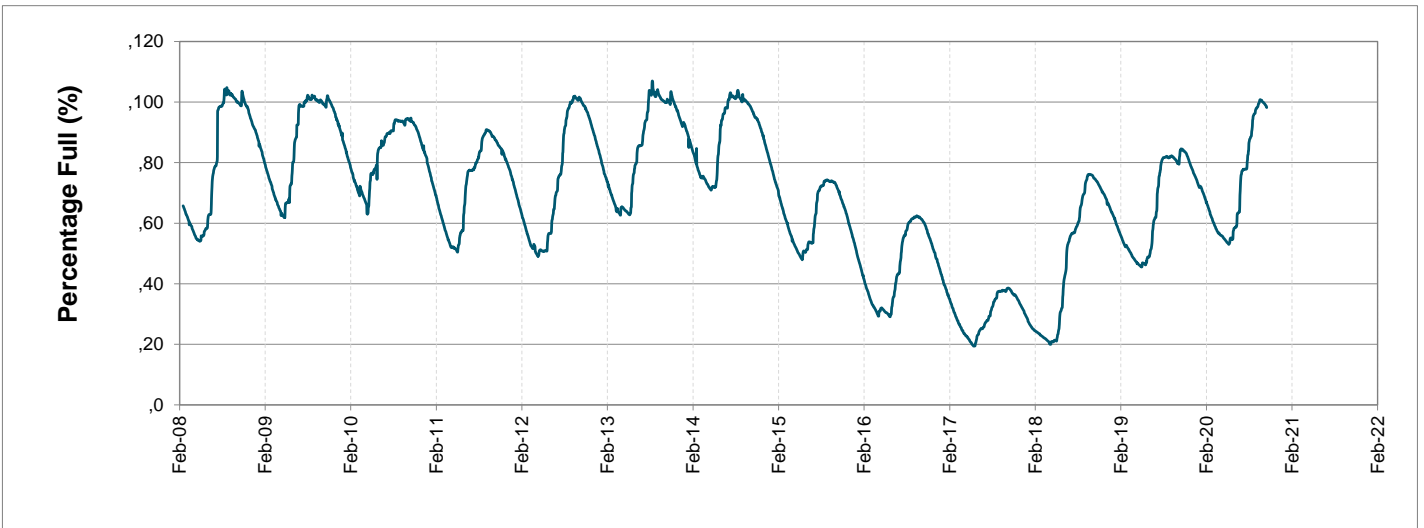

WCWSS Comparative Storage Graph (5 Years)

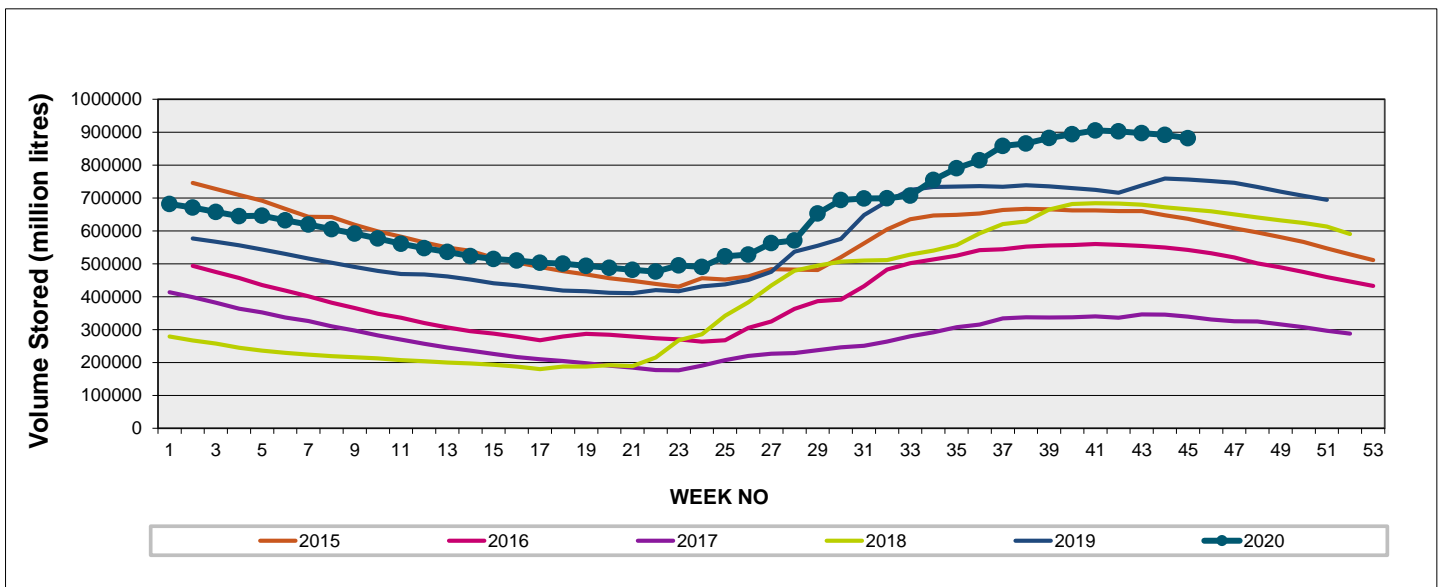

WCWSS Dam Storage and Water Use Tracking

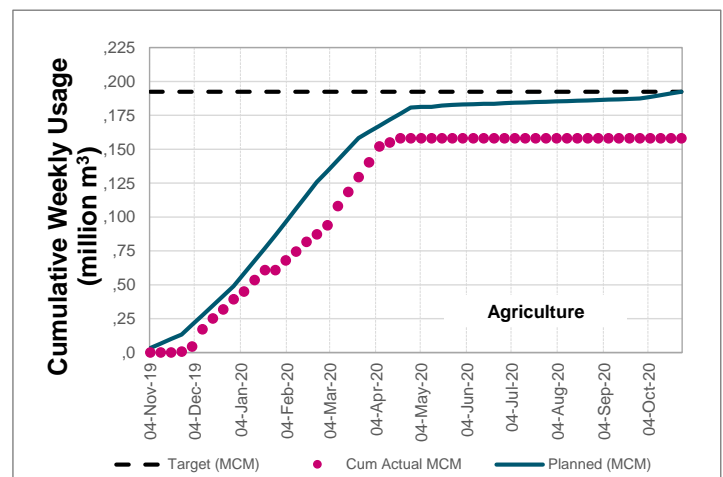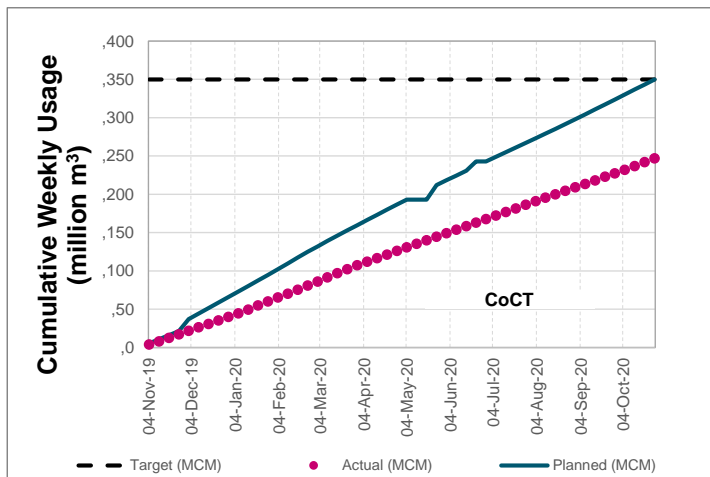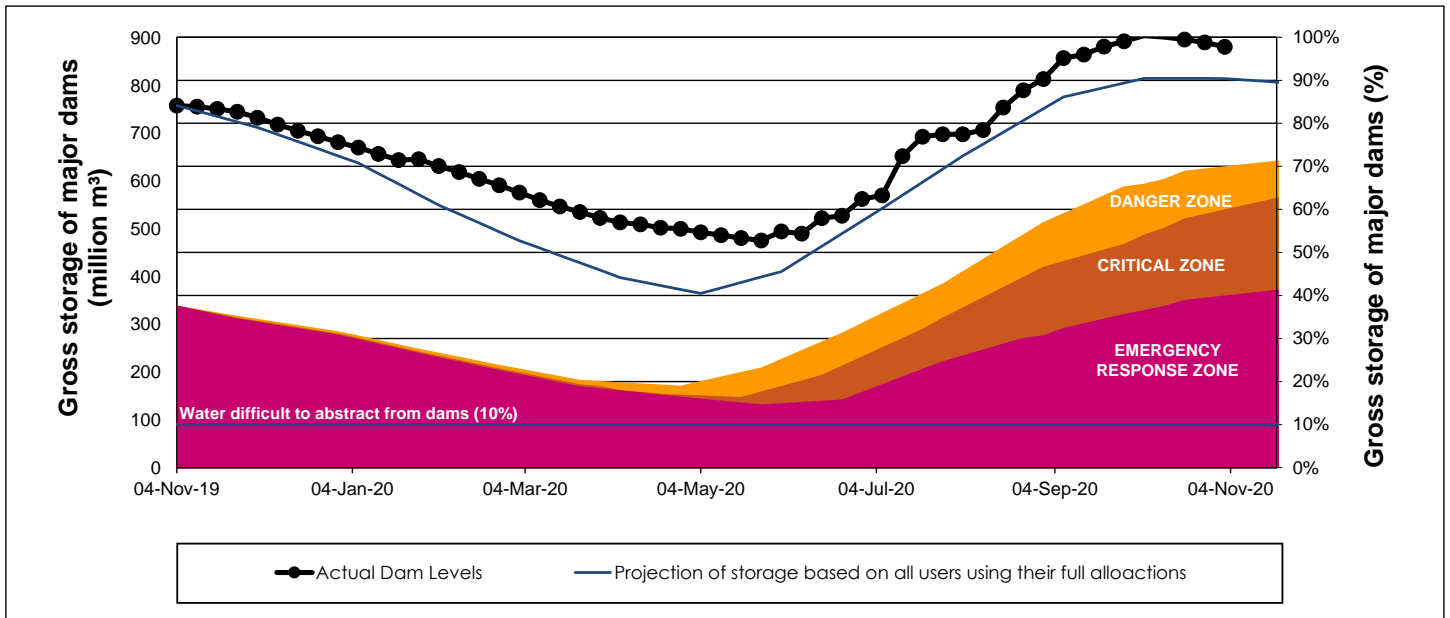

Water Stored in Minor Dams

Overall Percentage Full **87.8**

Weekly Change **-2.53**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	02 November 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	77.6	80.6	71.9	73.7	68.2	38.5
DE VILLIERS (Table Mountain)	243	100.0	99.8	100.5	87.9	95.1	87.5
HELY-HUTCHINSON (Table Mount)	925	88.7	95.3	100.2	97.8	99.8	99.7
KLEINPLAATS (Simon's Town)	1 368	93.6	94.7	85.2	95.3	66.8	85.2
LAND-EN-ZEEZICHT (Helderberg)	451	95.8	96.2	84.4	99.3	100.0	72.6
LEWIS GAY (Simon's Town)	182	98.7	100.9	66.5	83.8	85.7	74.7
VICTORIA (Table Mountain)	128	97.7	98.5	100.4	95.4	100.4	100.0
WOODHEAD (Table Mountain)	954	75.0	77.7	96.6	67.2	89.9	99.6
Total Stored	4 377	3844.7	3955.2	3936.6	3830.7	3718.7	3842.1
Percentages stored		87.8	90.4	89.9	87.5	85.0	87.8


Rainfall Recorded

RAINFALL (mm)	27-Oct	28-Oct	29-Oct	30-Oct	31-Oct	01-Nov	02-Nov	Nov	
								Total*	LT Average
Blackheath Upper	0.0	7.0	0.0	0.0	0.0	0.0	0.0	0.0	27.1
Brooklands	0.0	12.0	0.0	0.0	0.0	0.0	0.0	0.0	50.8
Newlands	0.0	19.0	0.0	0.0	0.0	0.0	0.0	0.0	60.3
Steenbras	0.0	20.0	0.0	0.0	0.0	0.0	0.0	0.0	49.3
Table Mountain (Woodhead)	0.0	17.0	0.0	0.0	0.0	0.0	0.0	0.0	69.0
Theewaterskloof	0.0	2.0	0.0	0.0	0.0	0.0	0.0	0.0	36.4
Tygerberg	0.0	5.0	0.5	0.0	0.0	0.0	0.0	0.0	24.5
Voëlvlei	0.0	2.7	0.0	0.0	0.0	0.0	0.0	0.0	29.0
Wemmershoek	0.0	3.4	1.5	0.0	0.0	0.0	0.0	0.0	39.8
Wynberg	0.0	12.0	0.0	0.0	0.0	0.0	0.0	0.0	44.9

Notes: *Total/cumulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

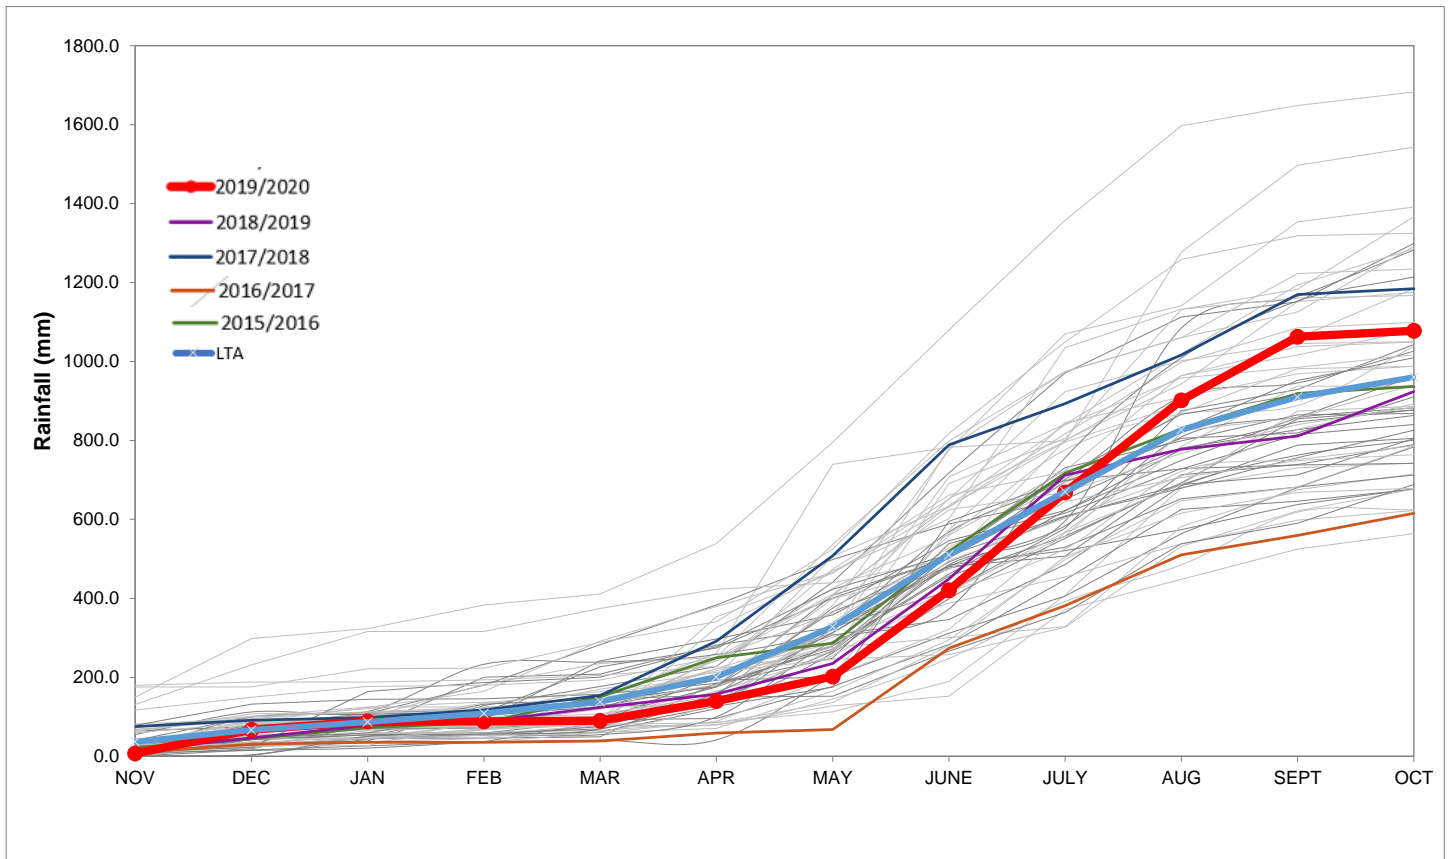

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Jul-19	99.04	98
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98
Nov-19	99.14	98
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.