


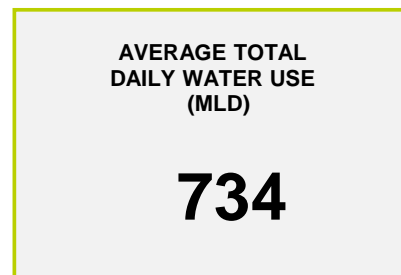
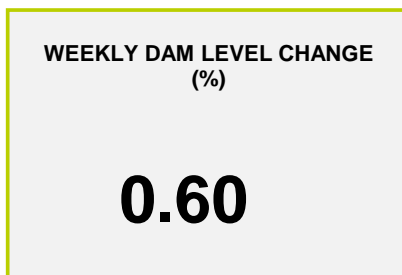
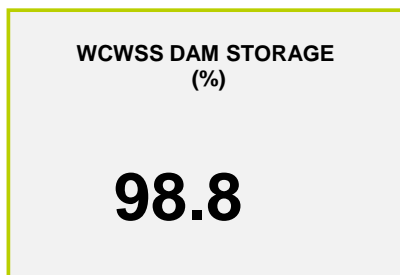


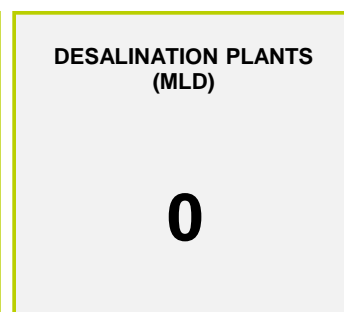


## Headline Statistics

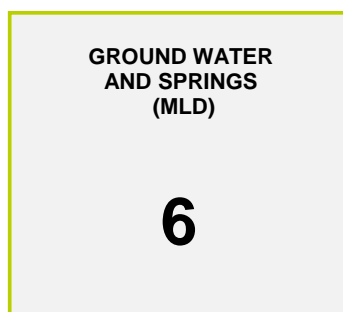

## Water Production from Different Sources

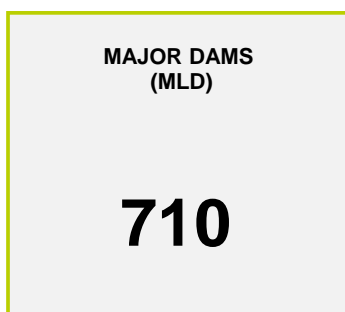

## Overall Water Usage Trend (2010 - Present)

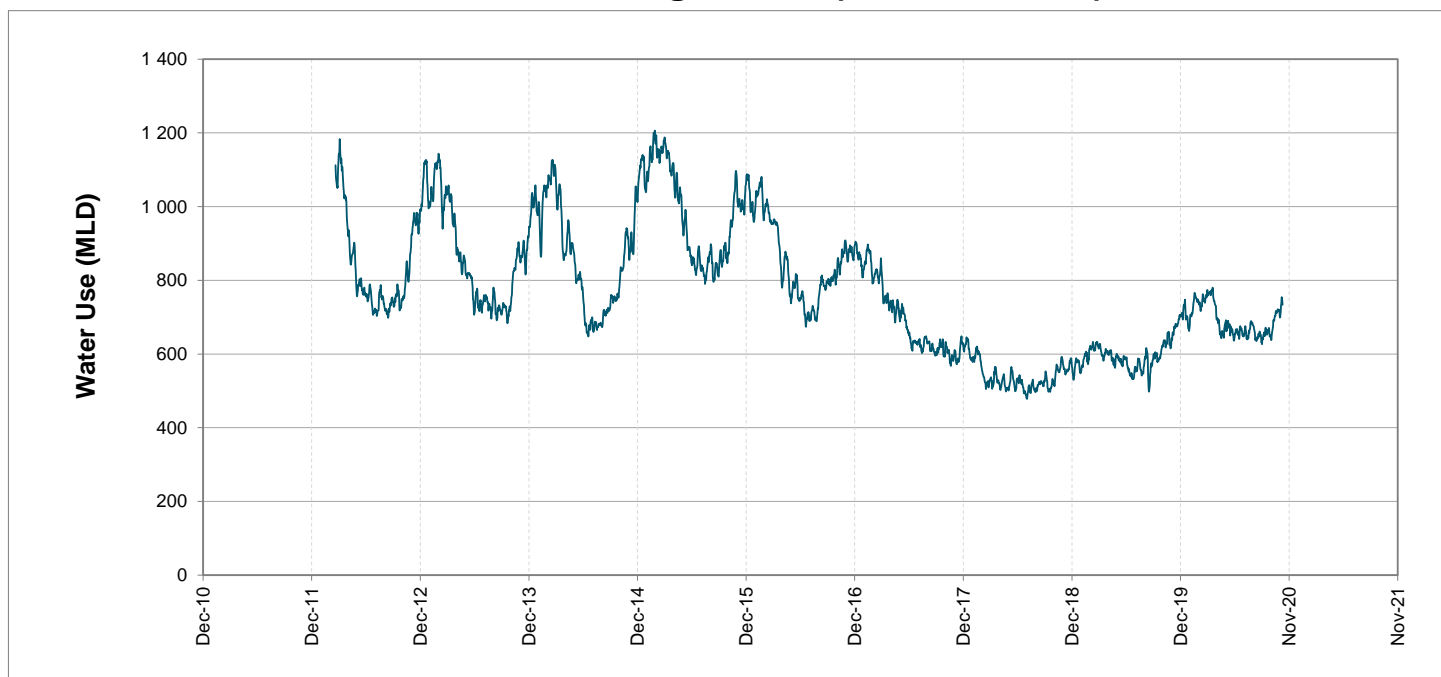

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


# Water Stored in Major Dams (WCWSS)

Overall Percentage Full **98.8%**


Weekly Change **0.6%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	09 November 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	101.2	99.7	100.0	99.3	67.9	72.2
STEENBRAS LOWER	33 517	96.9	94.1	98.8	85.4	53.0	56.8
STEENBRAS UPPER	31 767	93.5	83.5	92.8	69.0	99.7	86.7
THEEWATERSKLOOF	480 188	99.8	100.0	75.3	57.2	25.9	50.1
VOËLVLEI	164 095	95.2	96.2	90.0	94.5	28.0	68.9
WEMMERSHOEK	58 644	99.6	95.7	94.7	90.8	48.9	59.2
<b>TOTAL STORED</b>	<b>898 221</b>	<b>887 626</b>	<b>881 878</b>	<b>757 290</b>	<b>662 691</b>	<b>337 003</b>	<b>528 551</b>
<b>% STORAGE</b>		<b>98.8%</b>	<b>98.2%</b>	<b>84.3%</b>	<b>73.8%</b>	<b>37.5%</b>	<b>58.8%</b>




## WCWSS Storage Record (2008 - Present)

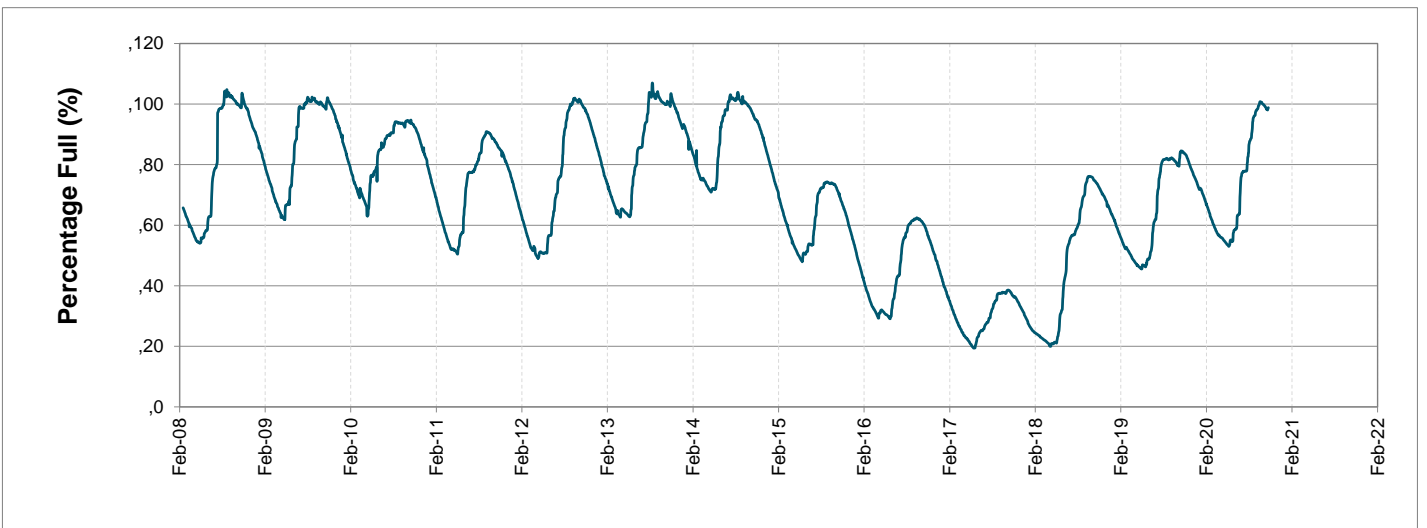

## WCWSS Comparative Storage Graph (5 Years)

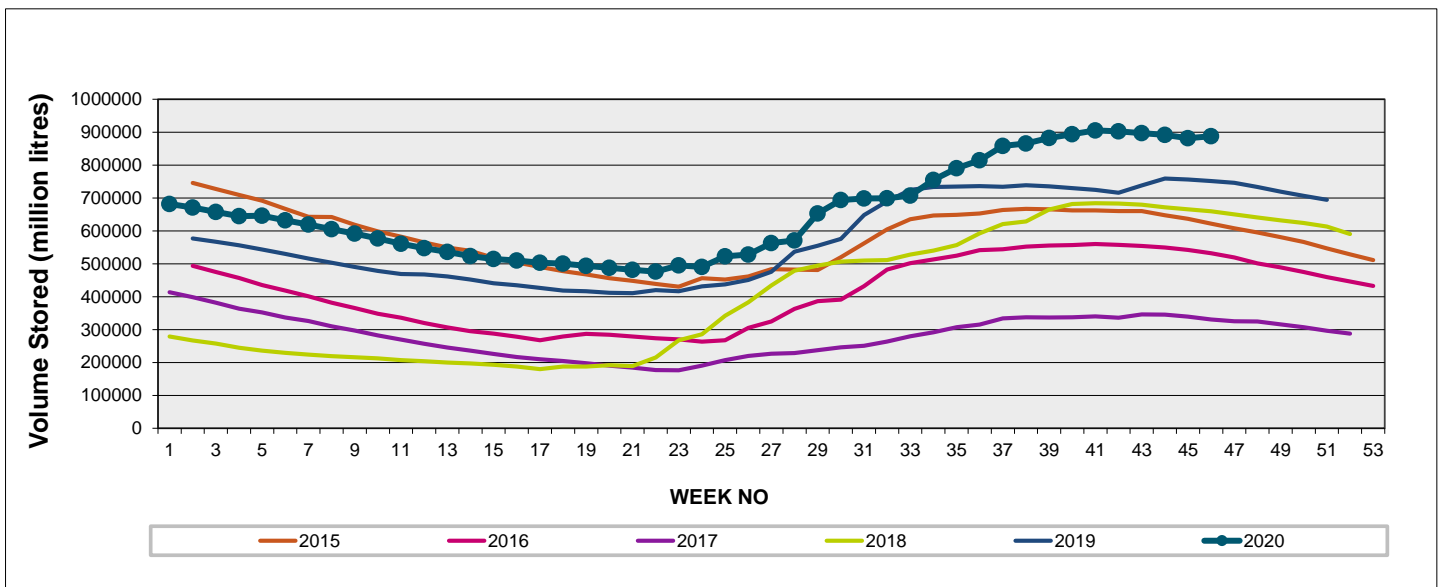

# WCWSS Dam Storage and Water Use Tracking

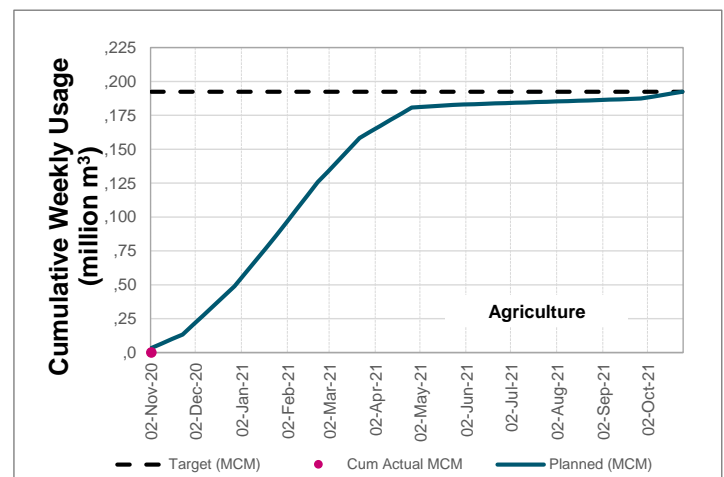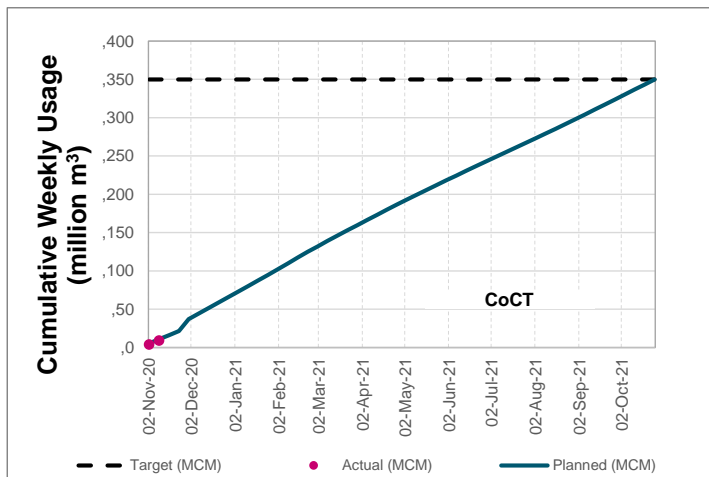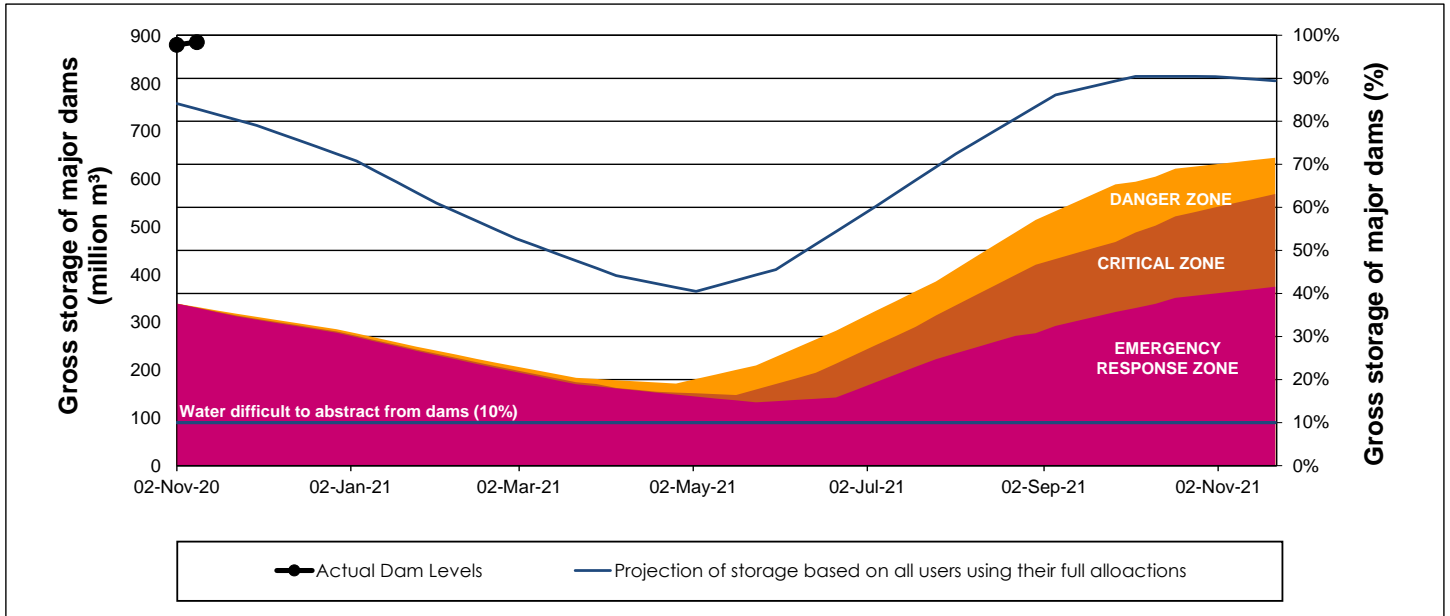

## Water Stored in Minor Dams

Overall Percentage Full **89.8**

Weekly Change **1.92**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	09 November 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	75.5	77.6	69.3	71.0	65.6	37.1
DE VILLIERS (Table Mountain)	243	100.3	100.0	99.8	83.9	92.5	86.9
HELY-HUTCHINSON (Table Mount)	925	91.9	88.7	100.0	97.5	99.8	98.8
KLEINPLAATS (Simon's Town)	1 368	99.1	93.6	86.2	95.6	65.5	82.2
LAND-EN-ZEEZICHT (Helderberg)	451	96.9	95.8	85.4	99.4	100.0	73.5
LEWIS GAY (Simon's Town)	182	94.3	98.7	67.9	84.8	79.6	68.8
VICTORIA (Table Mountain)	128	96.6	97.7	100.4	93.9	100.4	98.1
WOODHEAD (Table Mountain)	954	73.8	75.0	85.8	67.3	90.4	99.5
<b>Total Stored</b>	<b>4 377</b>	<b>3928.6</b>	<b>3844.7</b>	<b>3846.8</b>	<b>3818.5</b>	<b>3686.1</b>	<b>3781.9</b>
<b>Percentages stored</b>		<b>89.8</b>	<b>87.8</b>	<b>87.9</b>	<b>87.2</b>	<b>84.2</b>	<b>86.4</b>



## Drinking Water Quality

### SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Jul-19	99.04	98
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98
Nov-19	99.14	98
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98

#### Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)