


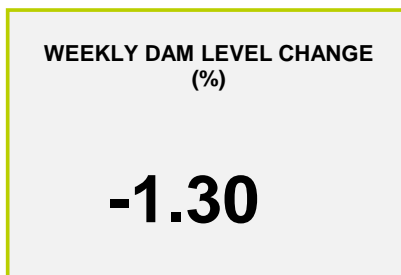
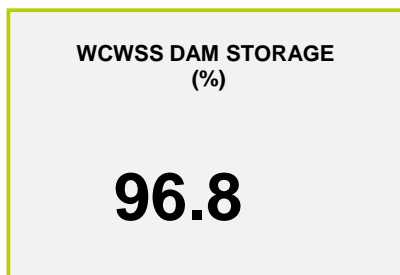


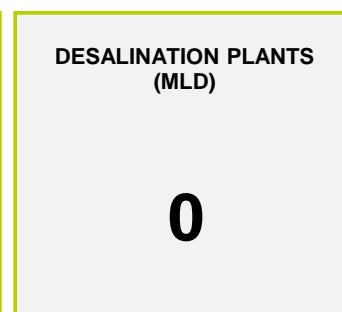


Headline Statistics

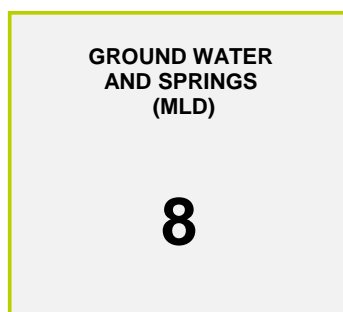

Water Production from Different Sources

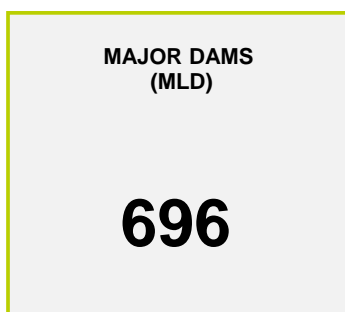

Overall Water Usage Trend (2010 - Present)

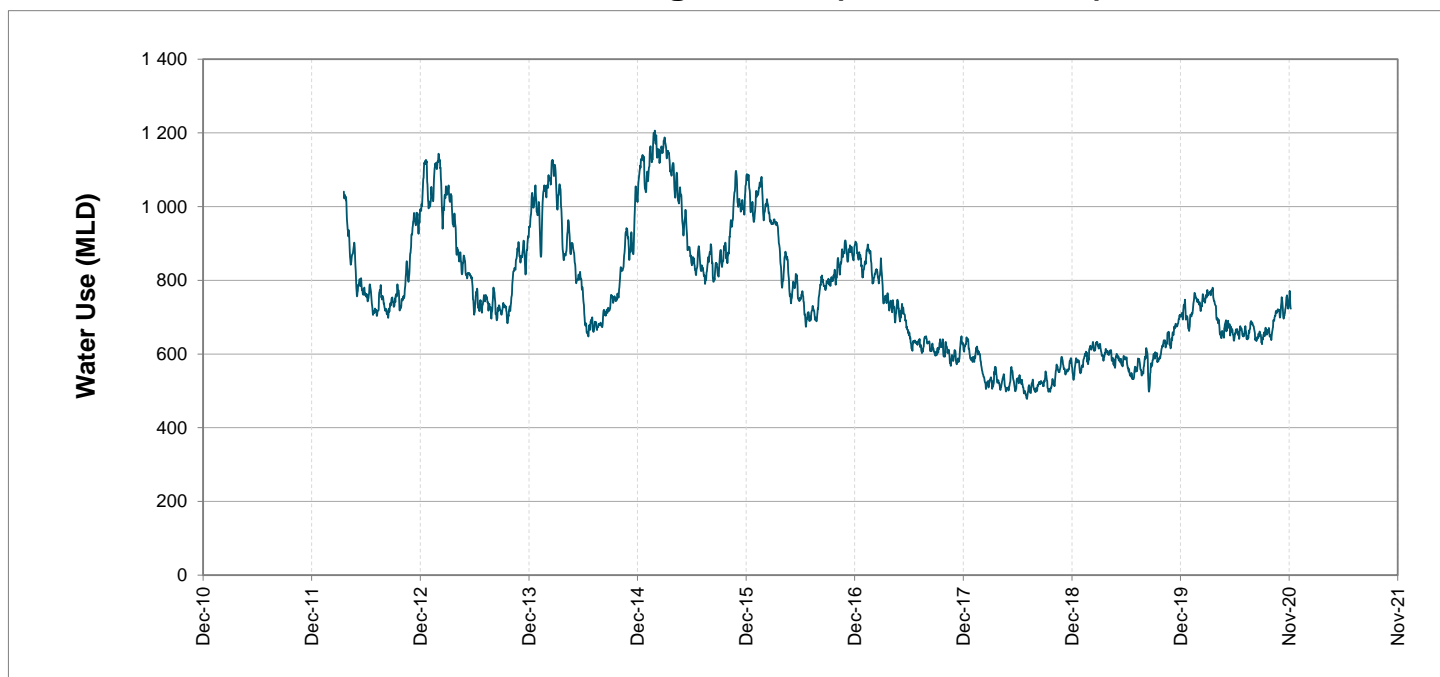

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **96.8%**


Weekly Change **-1.3%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	07 December 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	98.4	99.9	96.5	94.7	64.3	65.5
STEENBRAS LOWER	33 517	93.3	95.6	90.2	76.2	53.5	46.9
STEENBRAS UPPER	31 767	83.9	85.8	95.0	70.7	99.5	77.7
THEEWATERSKLOOF	480 188	98.2	99.6	71.7	54.1	22.0	45.1
VOËLVLEI	164 095	94.3	95.0	85.4	89.4	25.8	60.2
WEMMERSHOEK	58 644	97.7	98.9	87.2	84.0	51.5	50.0
TOTAL STORED	898 221	869 497	881 248	721 430	626 921	311 188	470 075
% STORAGE		96.8%	98.1%	80.3%	69.8%	34.6%	52.3%




WCWSS Storage Record (2008 - Present)

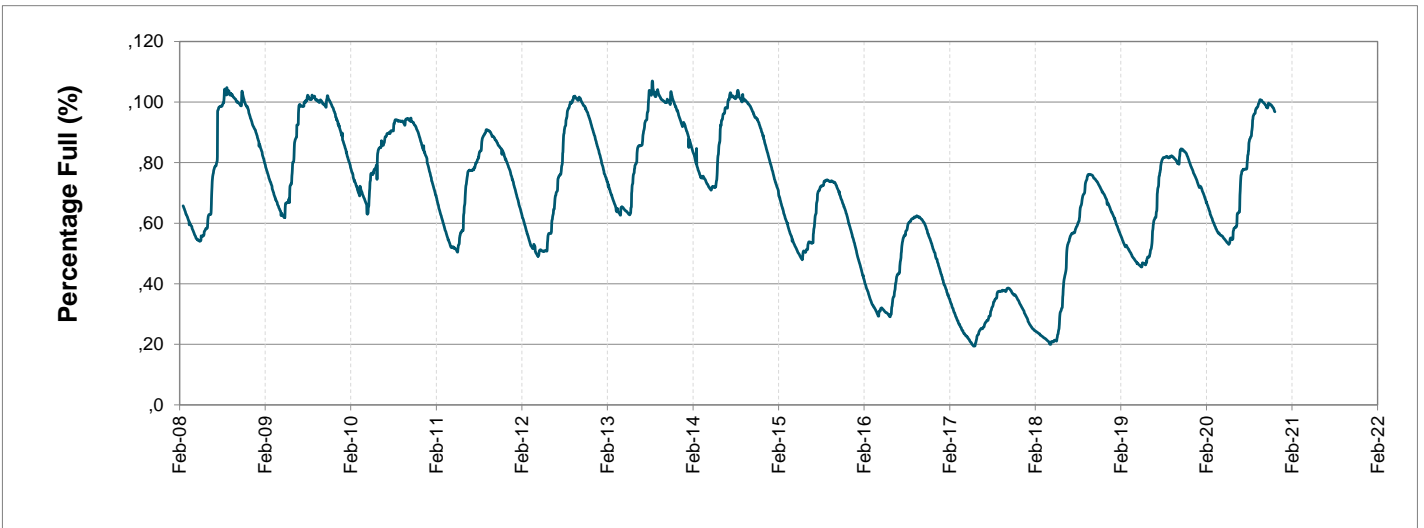

WCWSS Comparative Storage Graph (5 Years)

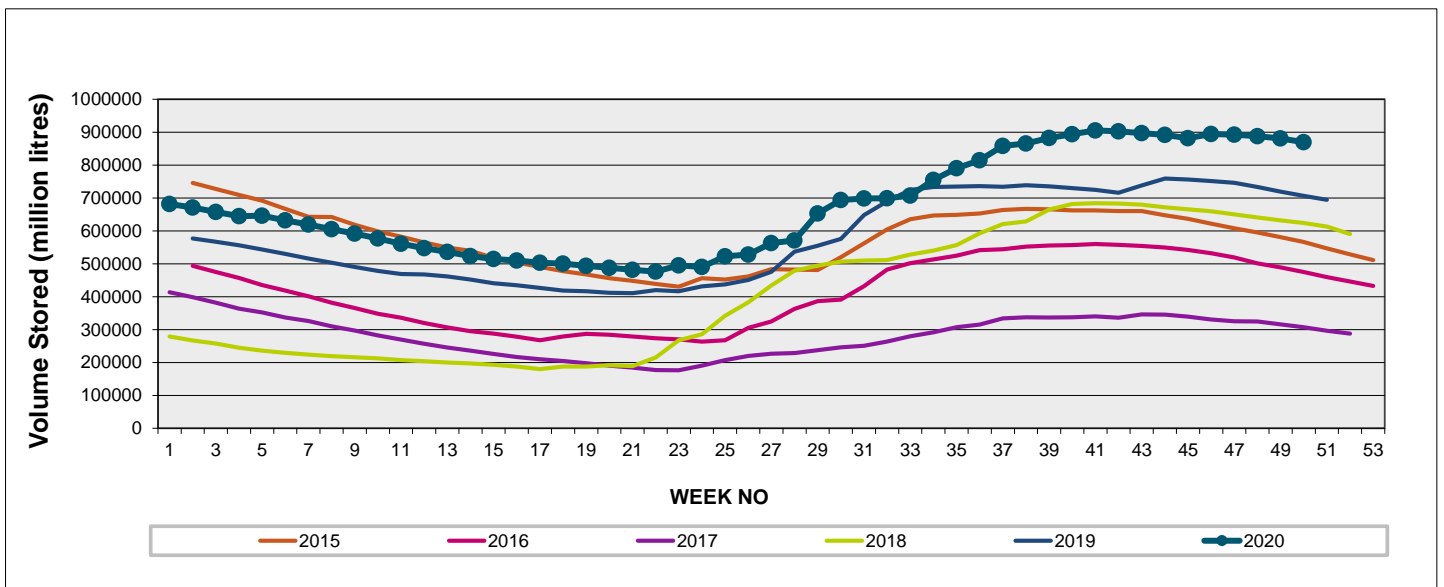

WCWSS Dam Storage and Water Use Tracking

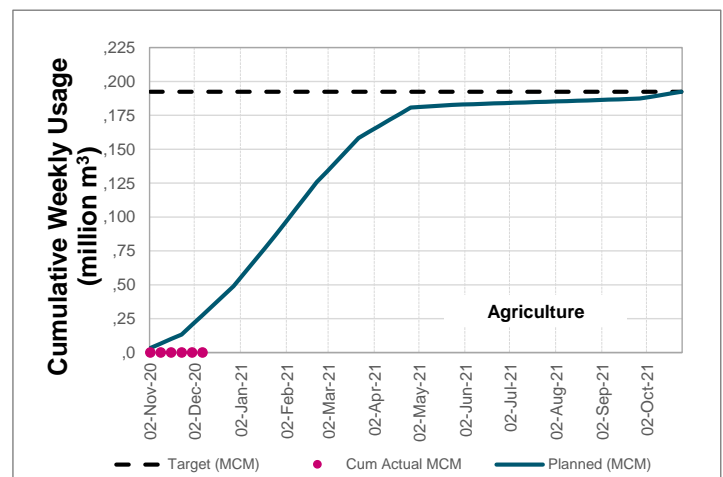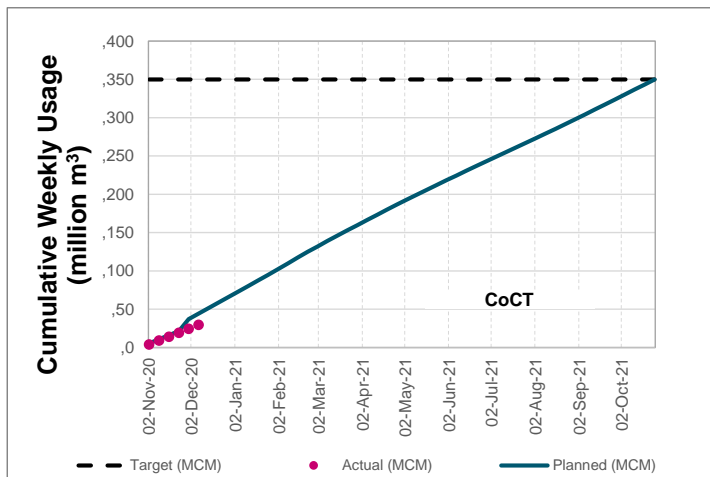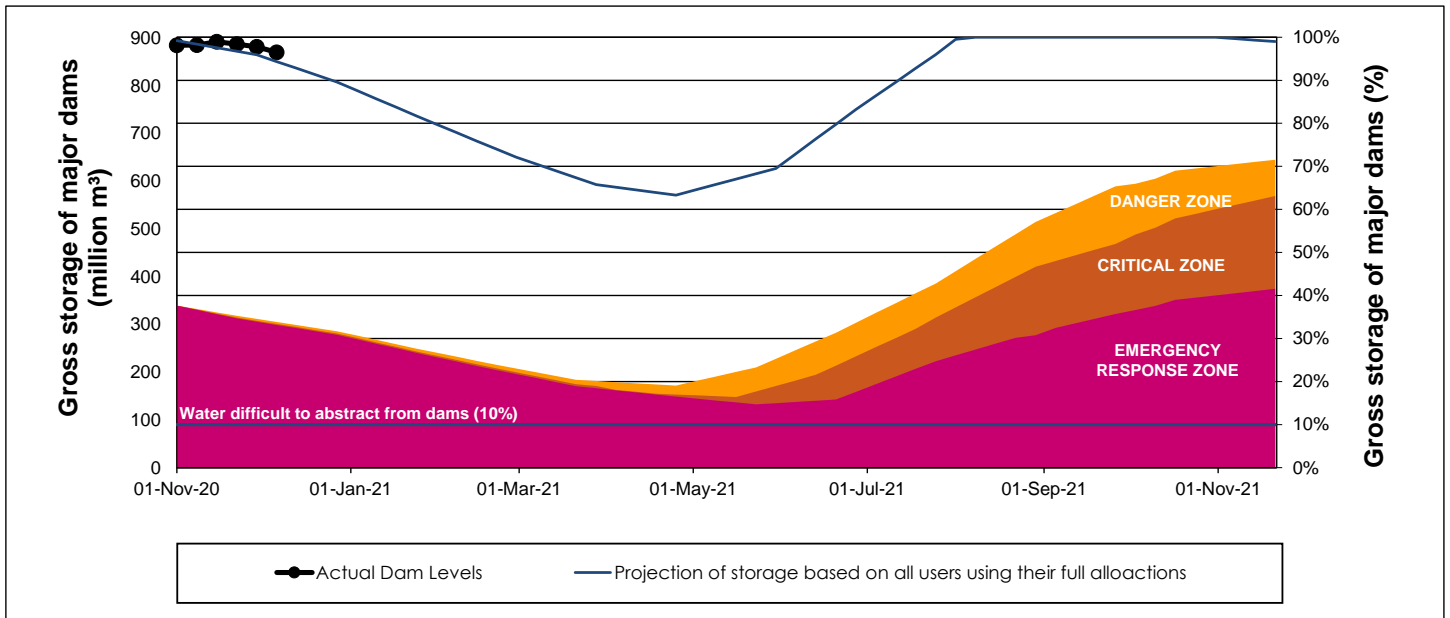

Water Stored in Minor Dams

Overall Percentage Full **81.1**

Weekly Change **-1.40**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	07 December 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	70.0	73.3	56.3	58.6	57.0	33.4
DE VILLIERS (Table Mountain)	243	87.8	91.1	98.6	72.1	80.2	80.4
HELY-HUTCHINSON (Table Mount)	925	70.8	77.5	97.6	97.6	100.0	96.3
KLEINPLAATS (Simon's Town)	1 368	95.8	91.5	78.8	85.2	59.7	69.9
LAND-EN-ZEEZICHT (Helderberg)	451	95.5	97.0	91.0	100.0	100.0	78.0
LEWIS GAY (Simon's Town)	182	86.5	90.0	40.2	71.5	84.3	53.2
VICTORIA (Table Mountain)	128	97.7	98.5	95.0	88.9	100.4	91.6
WOODHEAD (Table Mountain)	954	65.2	68.1	83.3	67.0	90.4	97.8
Total Stored	4 377	3551.9	3613.1	3657.6	3611.7	3578.5	3549.0
Percentages stored		81.1	82.5	83.6	82.5	81.8	81.1


Rainfall Recorded

RAINFALL (mm)	01-Dec	02-Dec	03-Dec	04-Dec	05-Dec	06-Dec	07-Dec	Dec	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	13.0
Brooklands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	26.9
Newlands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	47.9
Steenbras	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.2	36.4
Table Mountain (Woodhead)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	63.0
Theewaterskloof	0.0	0.0	1.2	0.0	0.0	1.2	0.0	2.4	20.3
Tygerberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	10.2
Voëlvlei	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	13.0
Wemmershoek	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	26.7
Wynberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	22.0

Notes: *Total/cumulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

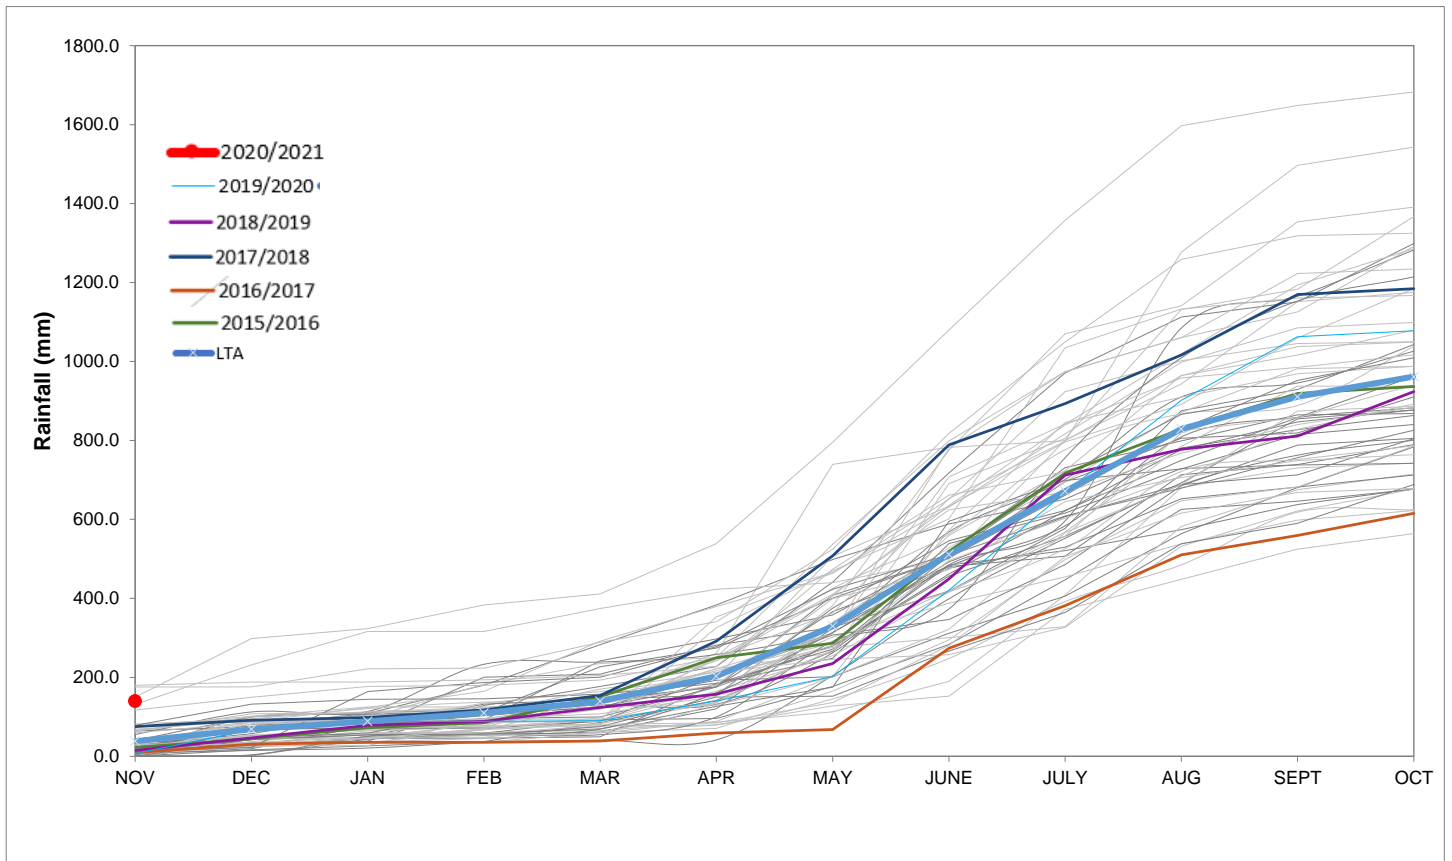

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98
Nov-19	99.14	98
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98
Oct-20	99.17	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)