


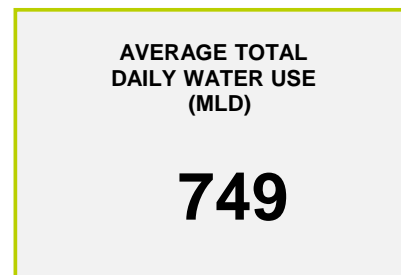
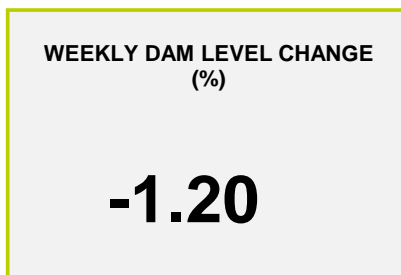
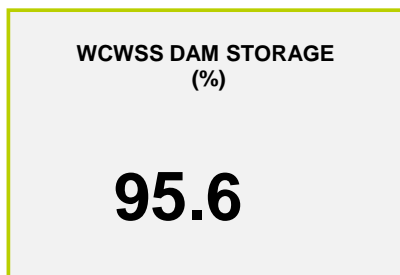


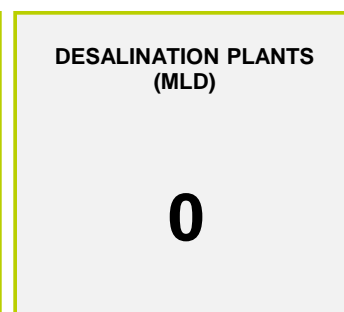


Headline Statistics

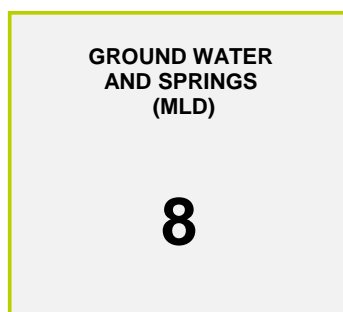

Water Production from Different Sources

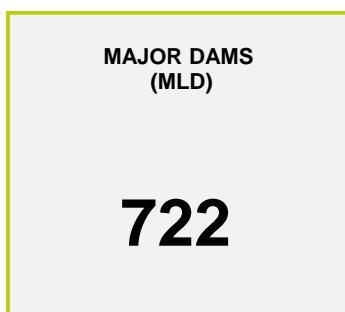

Overall Water Usage Trend (2010 - Present)

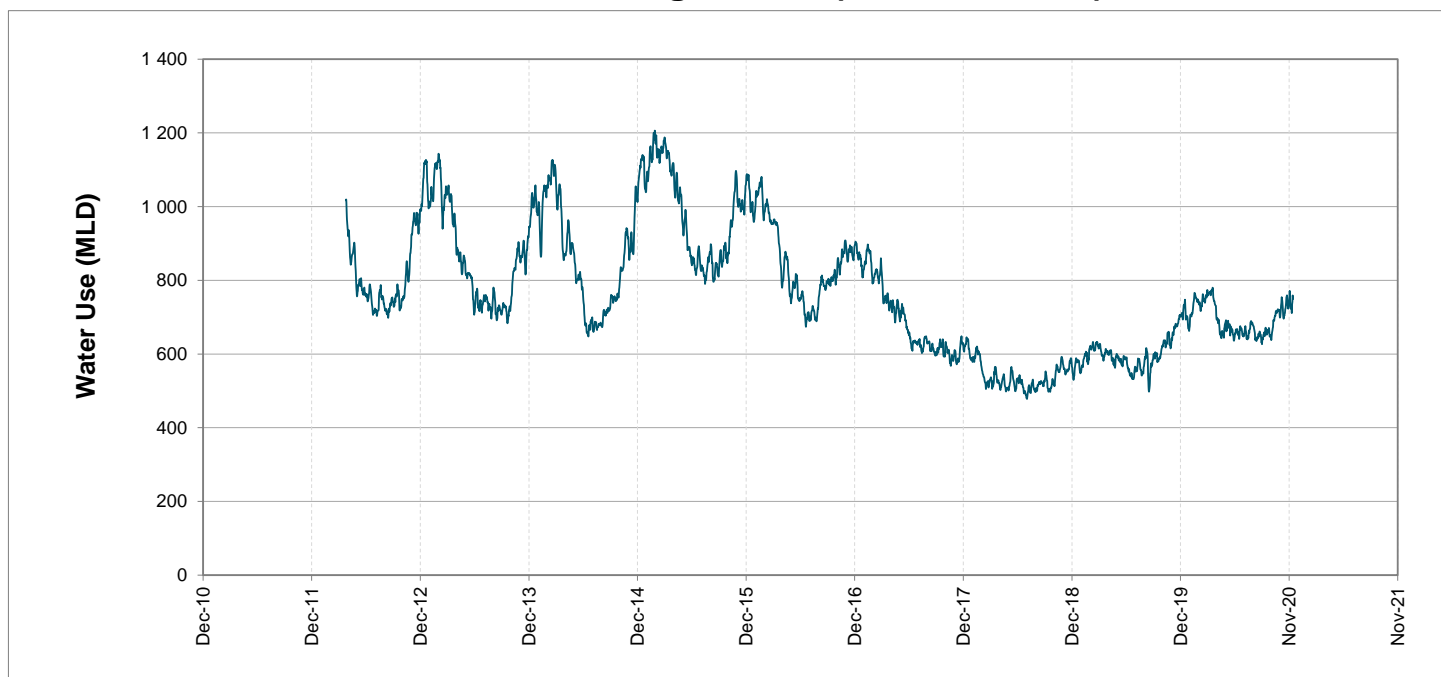

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **95.6%**


Weekly Change **-1.2%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	14 December 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	97.3	98.4	94.9	94.0	63.0	63.5
STEENBRAS LOWER	33 517	92.9	93.3	87.3	74.1	54.9	44.5
STEENBRAS UPPER	31 767	83.3	83.9	99.3	70.7	99.8	74.9
THEEWATERSKLOOF	480 188	97.4	98.2	70.2	53.2	20.7	43.8
VOËLVLEI	164 095	91.9	94.3	83.8	88.1	24.3	58.1
WEMMERSHOEK	58 644	96.2	97.7	85.1	82.3	51.7	47.9
TOTAL STORED	898 221	859 027	869 497	708 374	617 705	301 726	455 201
% STORAGE		95.6%	96.8%	78.9%	68.8%	33.6%	50.7%




WCWSS Storage Record (2008 - Present)

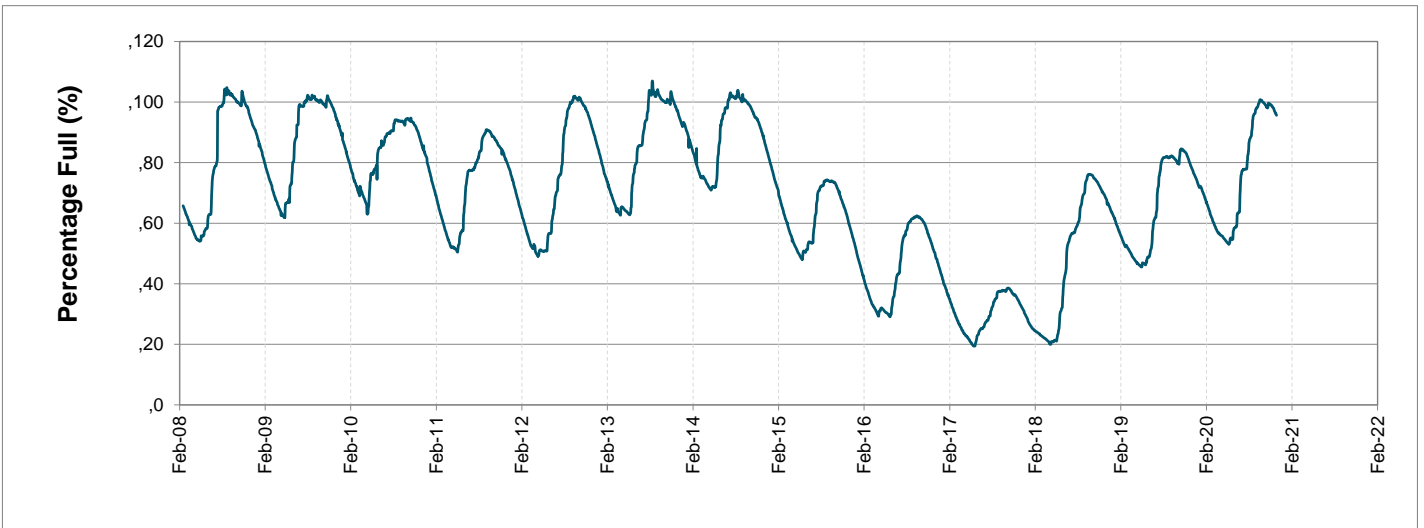

WCWSS Comparative Storage Graph (5 Years)

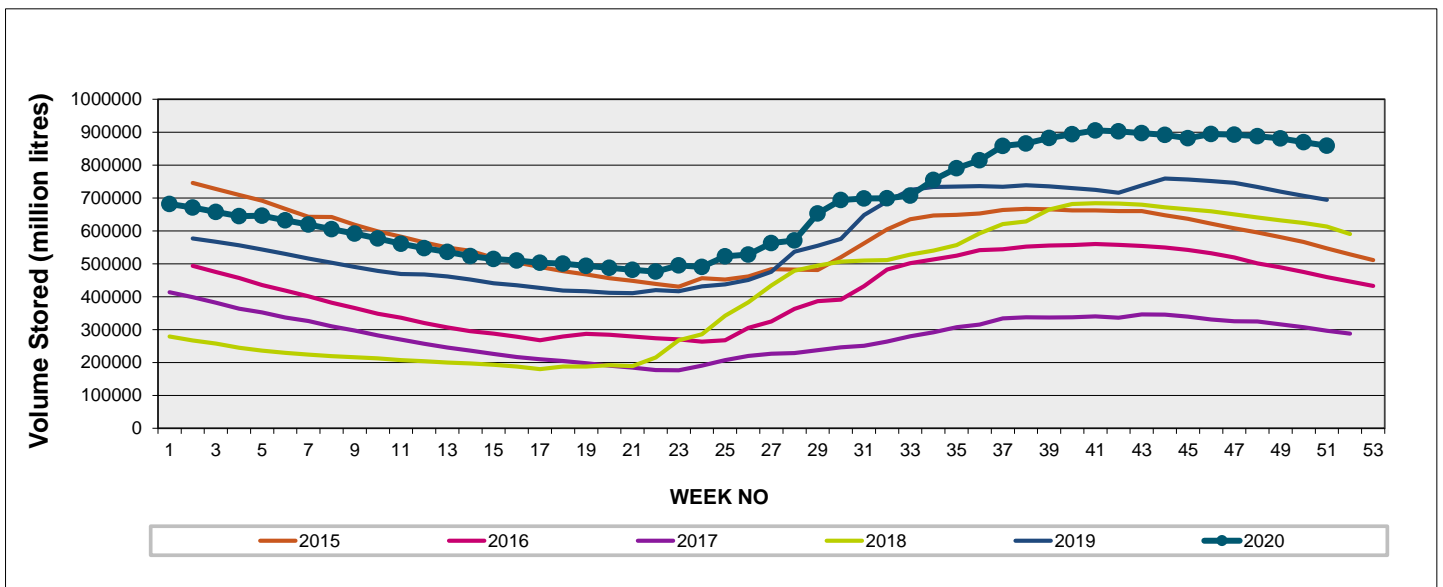

WCWSS Dam Storage and Water Use Tracking

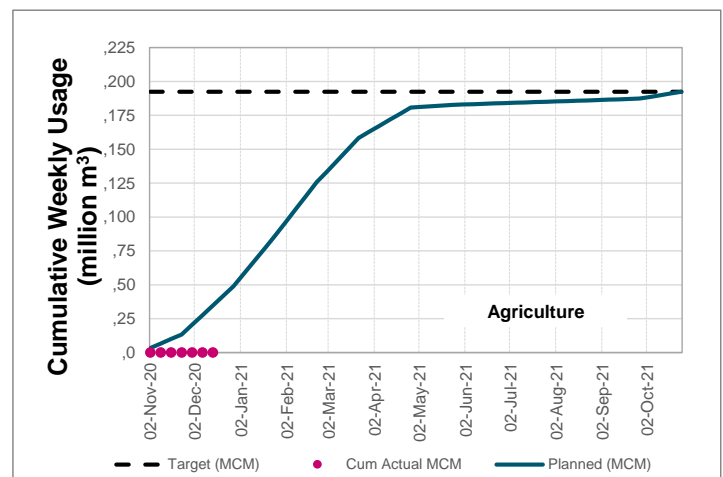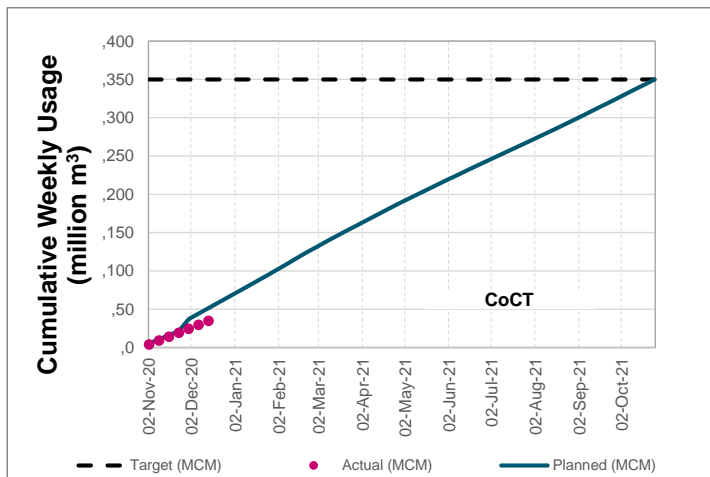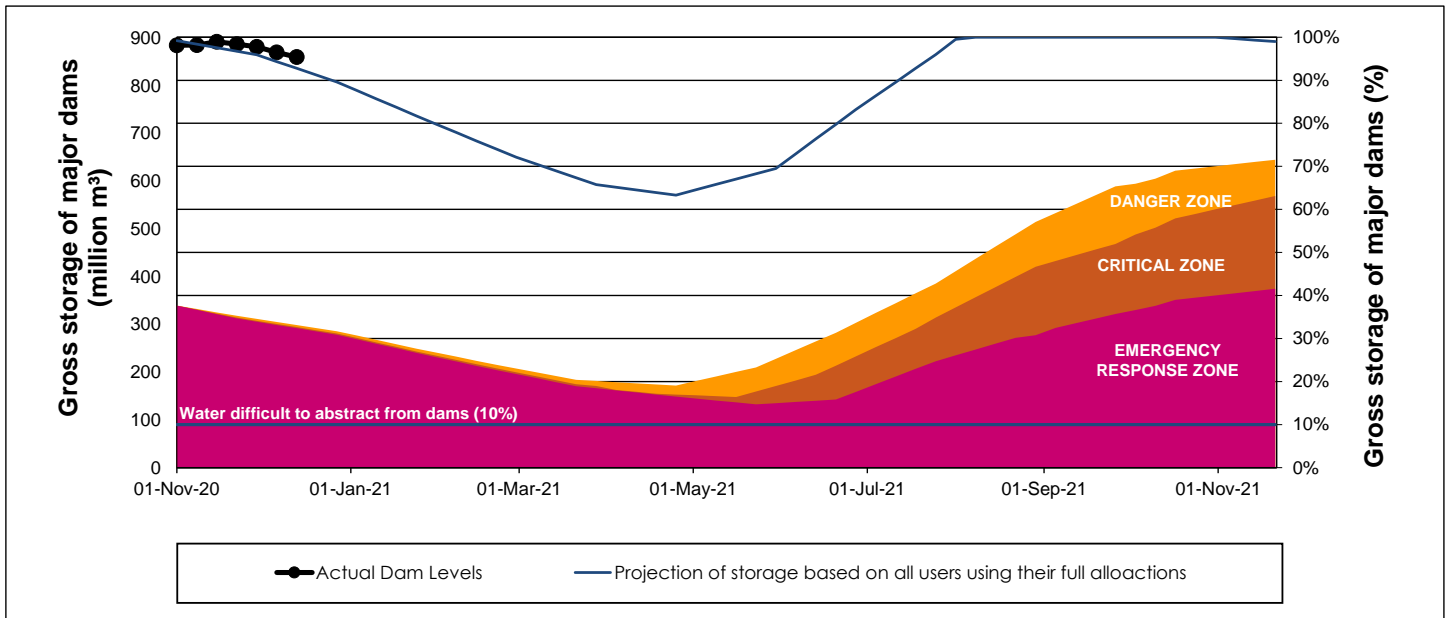

Water Stored in Minor Dams

Overall Percentage Full **78.0**

Weekly Change **-3.14**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	14 December 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	67.0	70.0	53.2	57.5	54.1	35.4
DE VILLIERS (Table Mountain)	243	82.4	87.8	98.6	67.6	80.1	77.7
HELY-HUTCHINSON (Table Mount)	925	64.9	70.8	97.8	100.0	98.6	100.0
KLEINPLAATS (Simon's Town)	1 368	93.6	95.8	77.3	84.2	58.6	66.5
LAND-EN-ZEEZICHT (Helderberg)	451	95.5	95.5	90.0	100.0	100.0	78.1
LEWIS GAY (Simon's Town)	182	80.4	86.5	30.7	76.4	86.5	63.6
VICTORIA (Table Mountain)	128	96.6	97.7	94.3	91.2	98.9	95.8
WOODHEAD (Table Mountain)	954	62.4	65.2	79.2	74.9	91.6	99.9
Total Stored	4 377	3414.4	3551.9	3575.2	3693.7	3561.0	3578.9
Percentages stored		78.0	81.1	81.7	84.4	81.4	81.8


Rainfall Recorded

RAINFALL (mm)	08-Dec	09-Dec	10-Dec	11-Dec	12-Dec	13-Dec	14-Dec	Dec	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	4.0	0.0	0.0		4.0	13.0
Brooklands	0.0	0.0	0.0	1.0	0.0	0.0		3.0	26.9
Newlands	0.0	0.0	0.0	2.0	0.2	0.0		12.8	47.9
Steenbras	15.5	0.0	0.0	15.4	0.0	0.0		31.1	36.4
Table Mountain (Woodhead)	3.5	0.0	0.0	14.5	0.0			22.5	63.0
Theewaterskloof	2.0	0.0	0.0	0.0	0.0	0.0		5.2	20.3
Tygerberg	0.0	0.0	0.0	0.0	0.0	0.0		0.0	10.2
Voëlvlei	2.5	0.0	0.0	0.0	0.0	0.0		2.5	13.0
Wemmershoek	5.3	2.5	0.0	4.5	0.0	0.0		12.3	26.7
Wynberg	1.5	0.0	0.0	2.5	0.0	0.0		9.0	22.0

Notes: *Total/cumulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

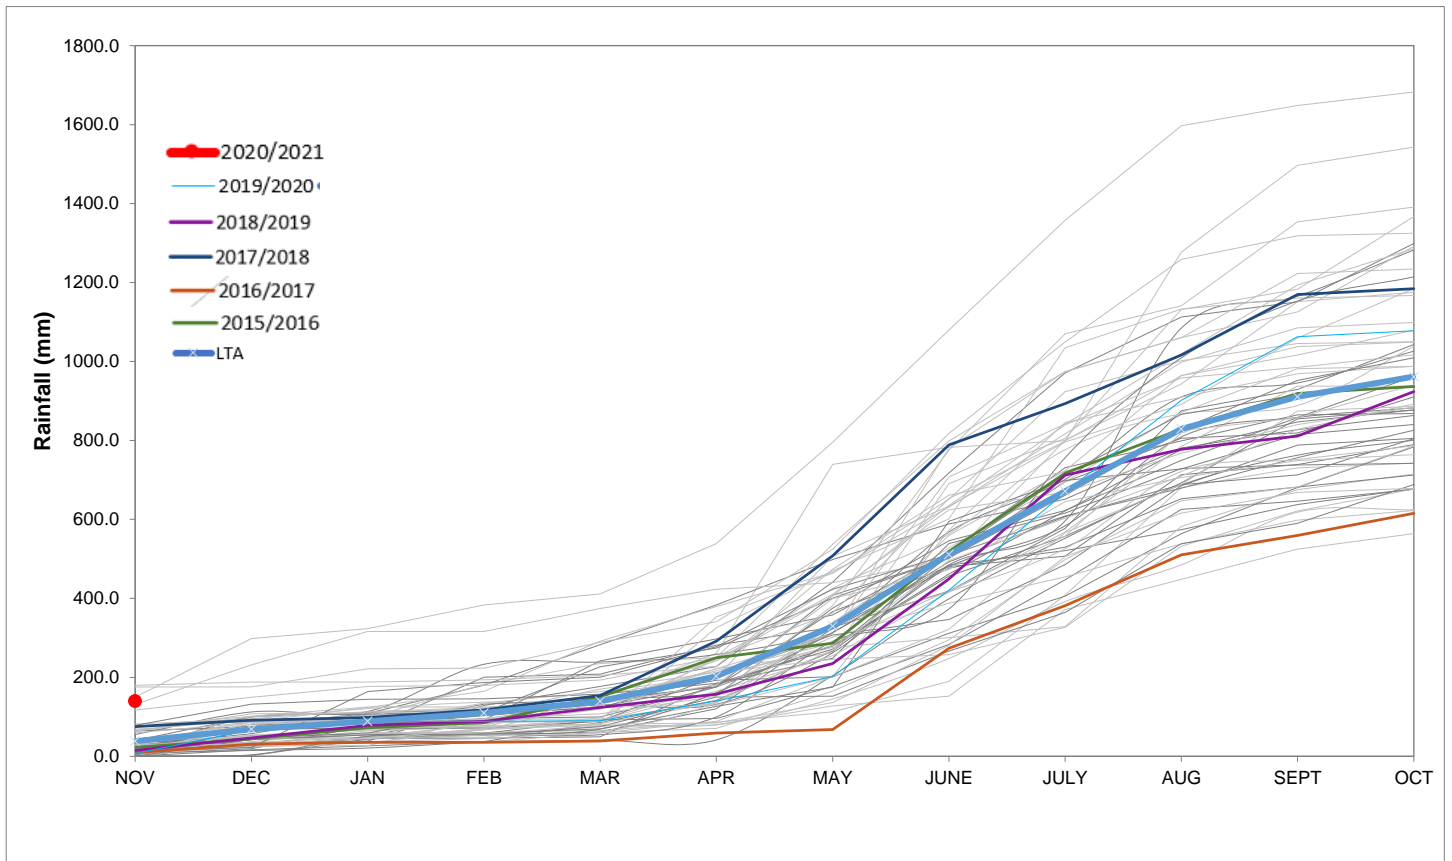

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98
Nov-19	99.14	98
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98
Oct-20	99.17	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)