


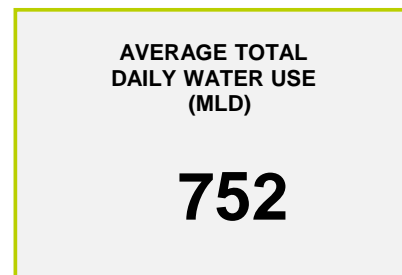
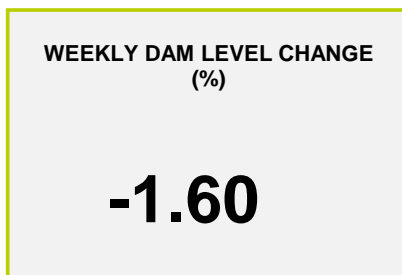
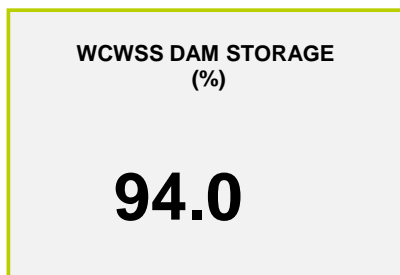


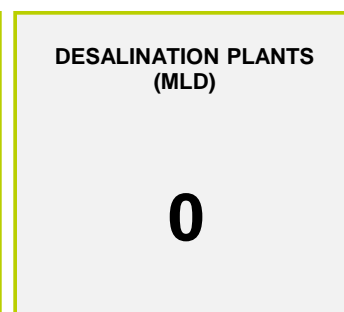


Headline Statistics

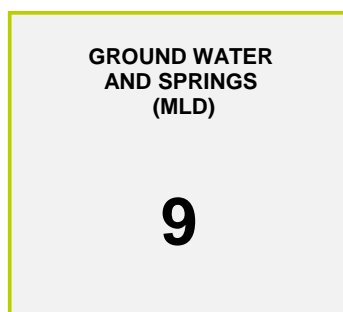

Water Production from Different Sources

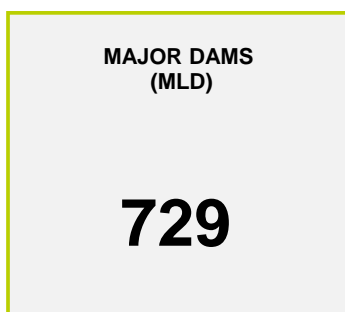

Overall Water Usage Trend (2010 - Present)

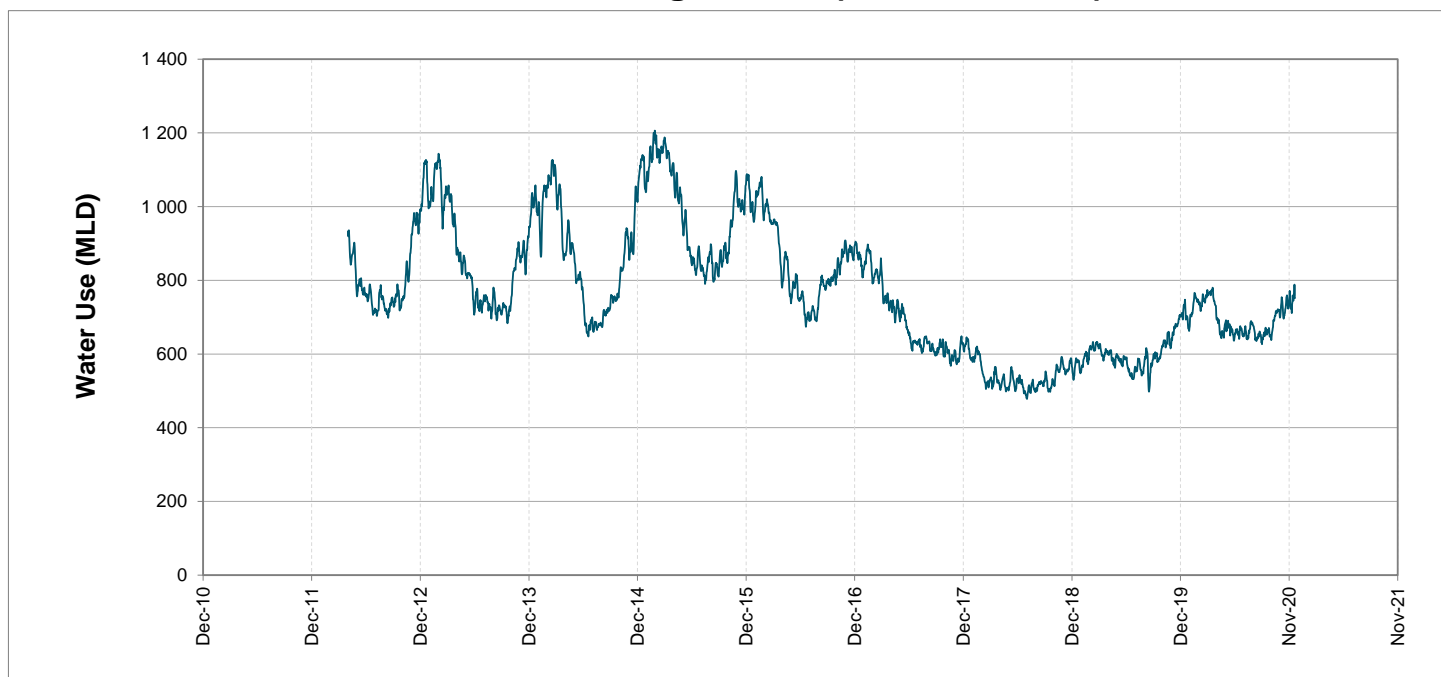

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **94.0%**


Weekly Change **-1.6%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	21 December 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	95.5	97.3	93.7	92.1	61.4	61.4
STEENBRAS LOWER	33 517	90.8	92.9	87.0	71.2	53.1	42.3
STEENBRAS UPPER	31 767	79.0	83.3	100.3	70.9	98.9	74.5
THEEWATERSKLOOF	480 188	95.9	97.4	68.8	52.3	19.8	42.2
VOËLVLEI	164 095	90.6	91.9	82.4	86.6	23.2	55.9
WEMMERSHOEK	58 644	94.7	96.2	83.4	80.6	51.9	45.3
TOTAL STORED	898 221	844 390	859 027	697 257	606 810	292 579	438 499
% STORAGE		94.0%	95.6%	77.6%	67.6%	32.6%	48.8%




WCWSS Storage Record (2008 - Present)

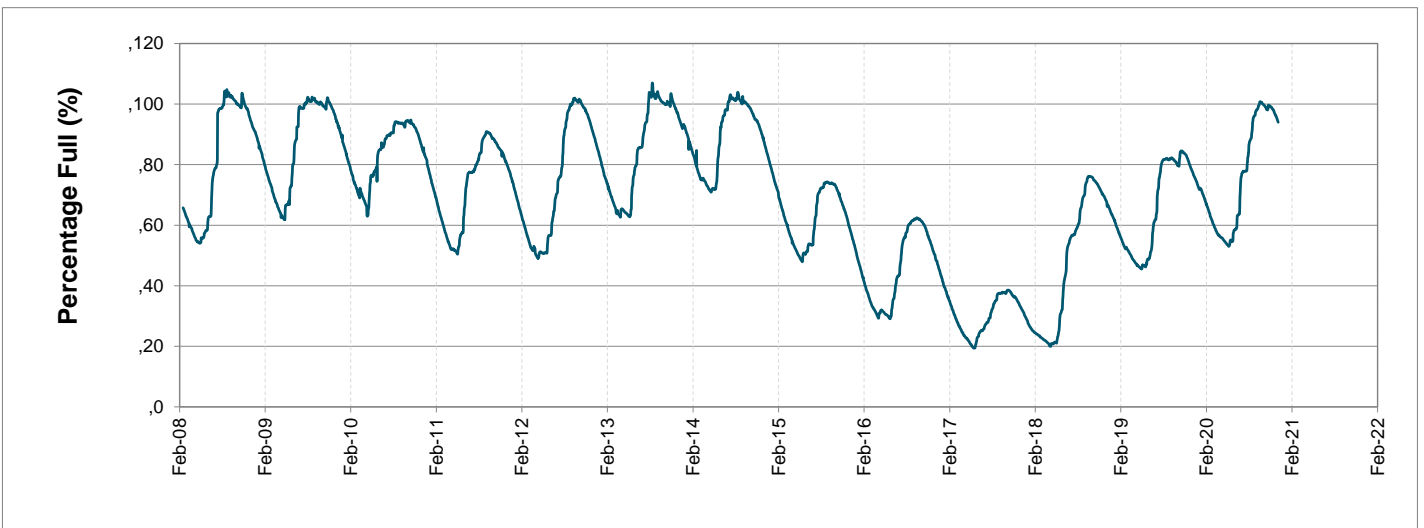

WCWSS Comparative Storage Graph (5 Years)

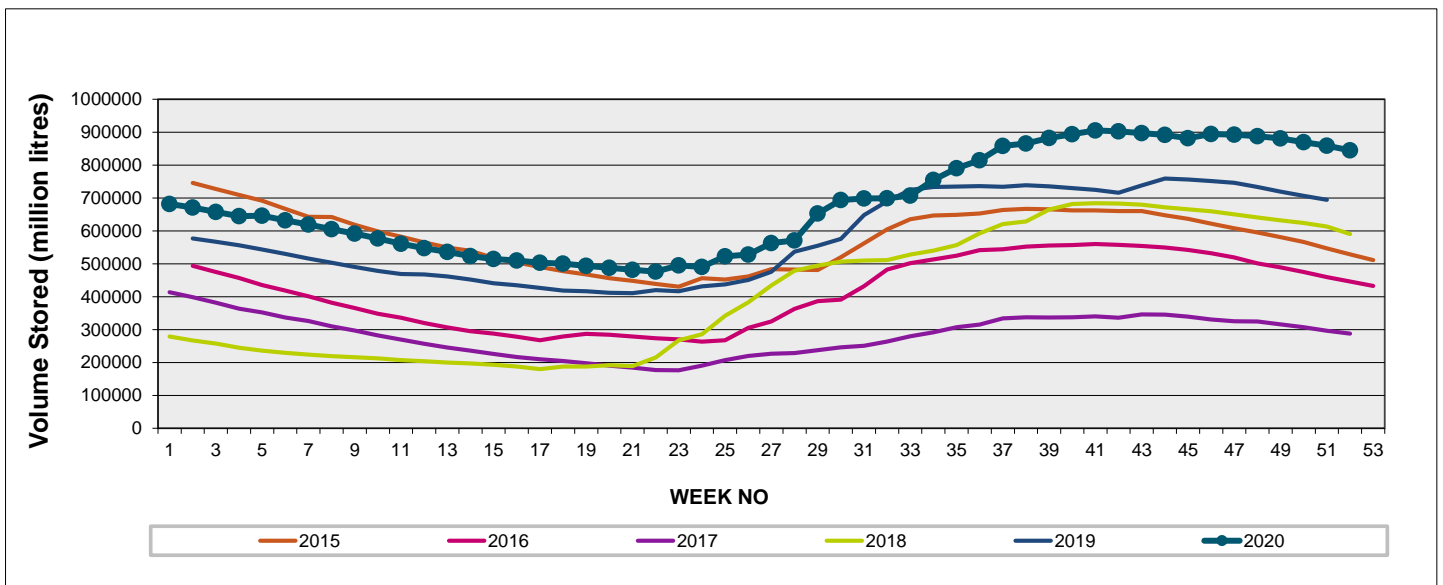

WCWSS Dam Storage and Water Use Tracking

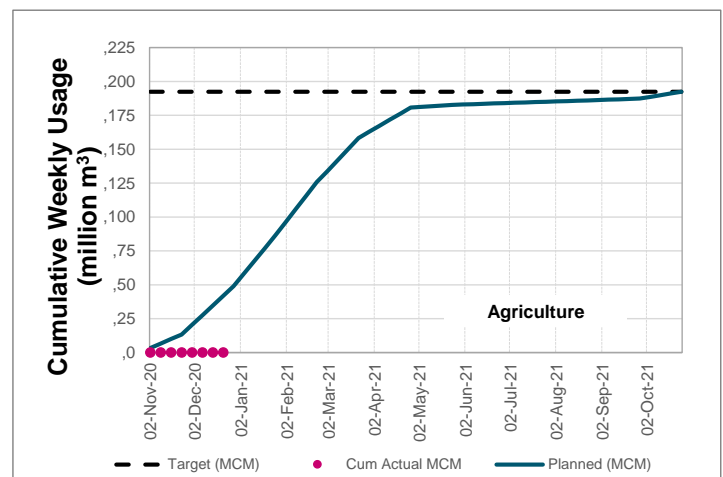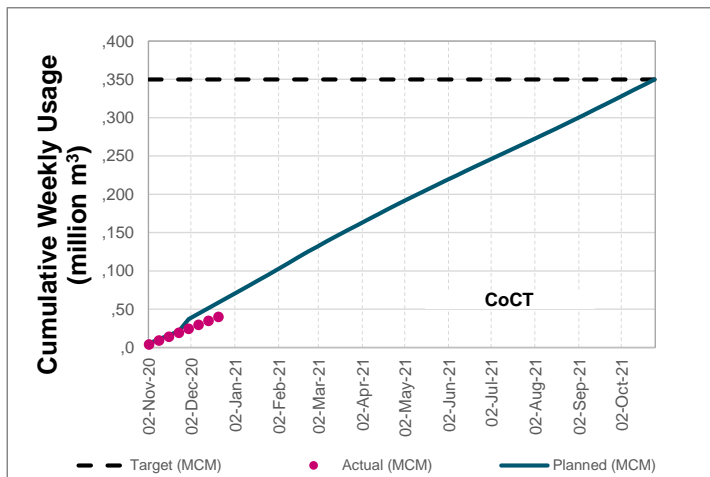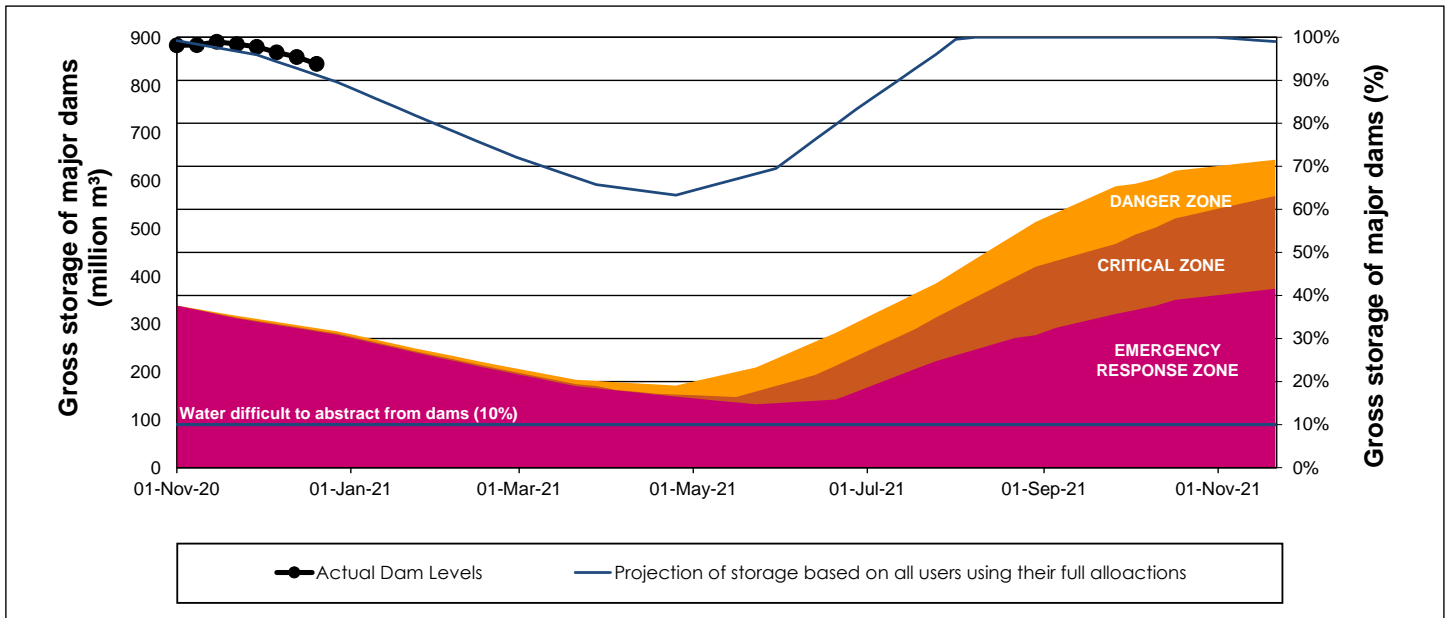

Water Stored in Minor Dams

Overall Percentage Full **75.1**

Weekly Change **-2.89**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	21 December 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	63.6	67.0	51.8	54.6	51.6	34.5
DE VILLIERS (Table Mountain)	243	76.8	82.4	99.7	62.2	80.3	74.9
HELY-HUTCHINSON (Table Mount)	925	57.5	64.9	97.1	99.3	98.1	99.2
KLEINPLAATS (Simon's Town)	1 368	93.0	93.6	75.9	81.6	57.2	64.3
LAND-EN-ZEEZICHT (Helderberg)	451	95.0	95.5	91.4	100.0	100.0	81.8
LEWIS GAY (Simon's Town)	182	69.7	80.4	26.2	64.0	89.1	61.1
VICTORIA (Table Mountain)	128	95.4	96.6	92.0	88.9	96.6	94.3
WOODHEAD (Table Mountain)	954	61.4	62.4	70.5	75.6	91.5	99.2
Total Stored	4 377	3288.0	3414.4	3463.5	3620.2	3535.8	3539.4
Percentages stored		75.1	78.0	79.1	82.7	80.8	80.9


Rainfall Recorded

RAINFALL (mm)	15-Dec	16-Dec	17-Dec	18-Dec	19-Dec	20-Dec	21-Dec	Dec	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4.0	13.0
Brooklands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4.0	26.9
Newlands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	12.8	47.9
Steenbras	0.0	0.0	0.0	0.0	0.0	0.0	0.0	31.1	36.4
Table Mountain (Woodhead)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	22.5	63.0
Theewaterskloof	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5.2	20.3
Tygerberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	10.2
Voëlvlei	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.5	13.0
Wemmershoek	0.0	0.0	0.0	0.0	0.0	0.0	0.0	12.3	26.7
Wynberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	9.0	22.0

Notes: *Total/cumulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

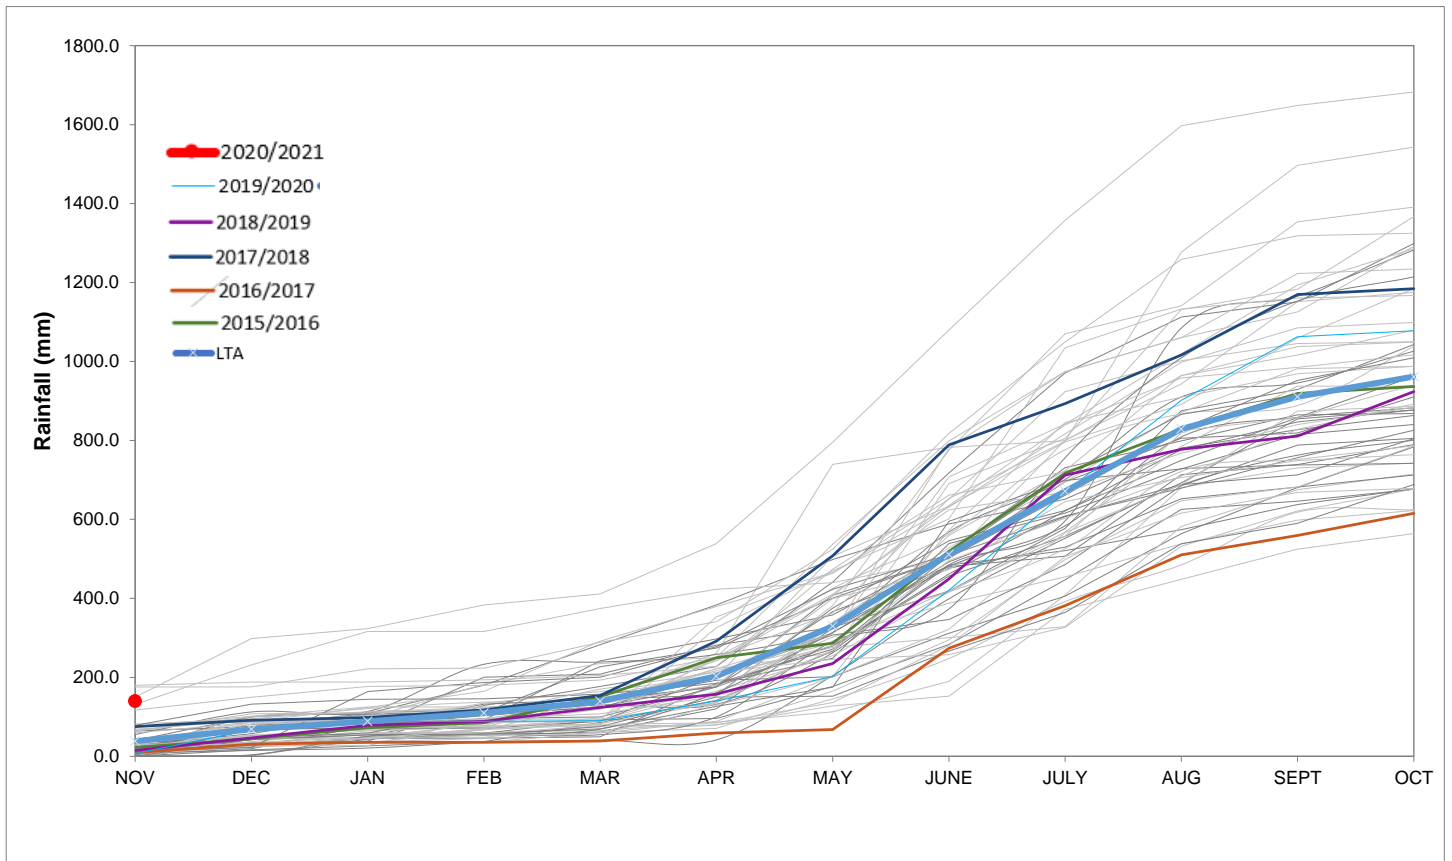

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98
Nov-19	99.14	98
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98
Oct-20	99.17	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)