


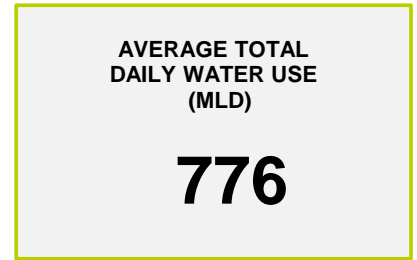
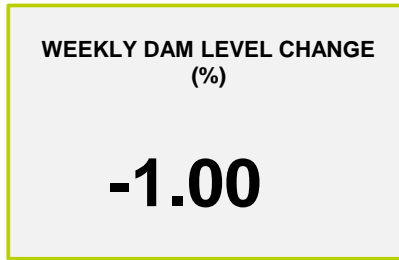


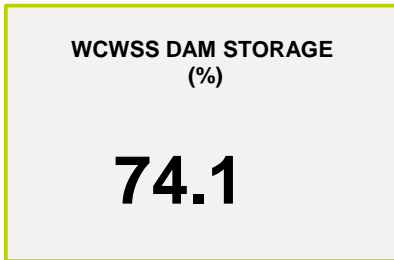


Headline Statistics

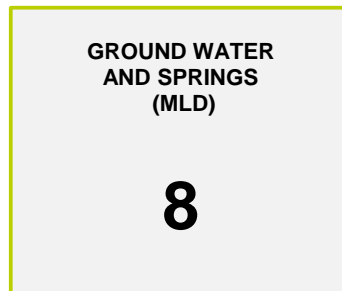

Water Production from Different Sources

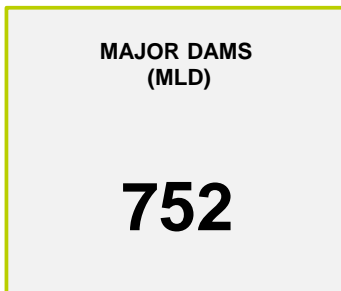

Overall Water Usage Trend (2010 - Present)

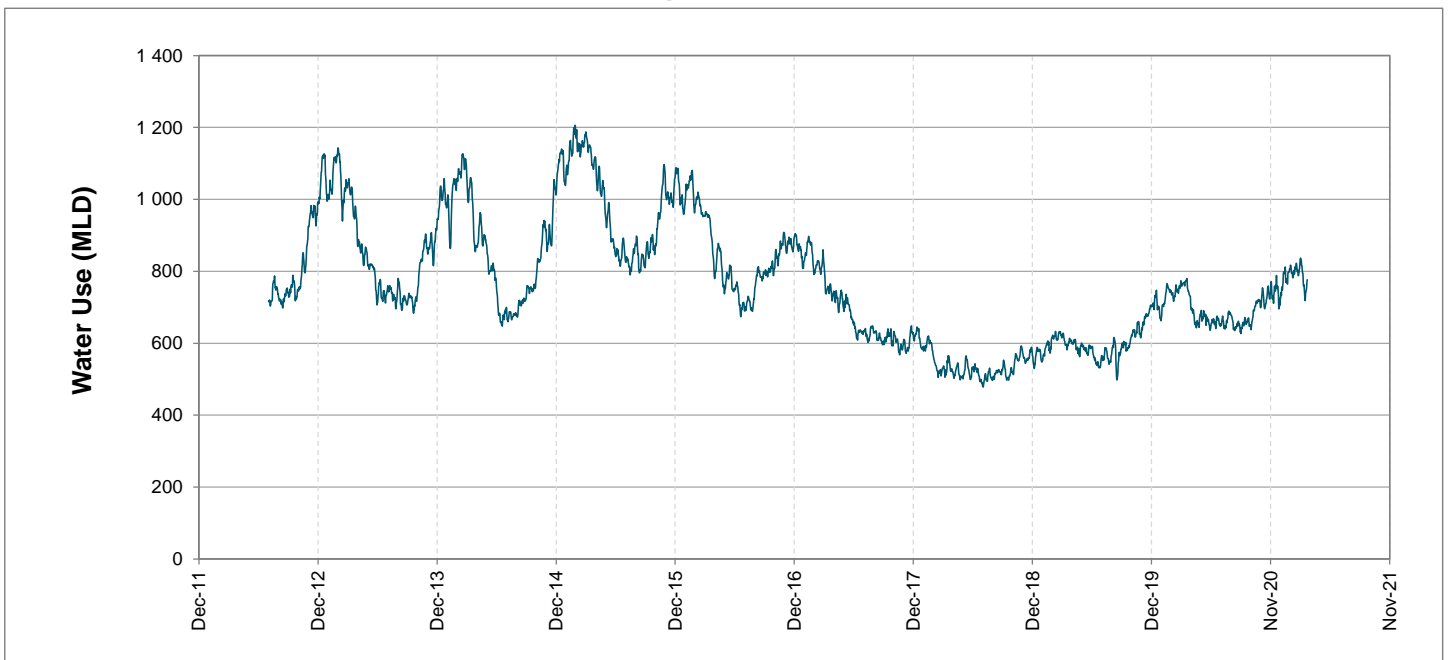

WCSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **74.1%**


Weekly Change **-1.0%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	23 March 2021	Previous week	2020	2019	2018	2017
BERG RIVER	130 010	76.5	77.4	70.5	72.7	46.8	36.6
STEENBRAS LOWER	33 517	64.9	66.9	62.0	49.2	39.2	32.0
STEENBRAS UPPER	31 767	52.3	48.6	97.4	69.8	84.9	55.7
THEEWATERSKLOOF	480 188	78.1	79.4	55.1	40.2	10.6	23.2
VOËLVLEI	164 095	67.4	68.0	57.4	62.5	14.7	26.1
WEMMERSHOEK	58 644	72.2	74.3	57.1	56.9	43.8	36.0
TOTAL STORED	898 221	665 676	674 893	535 655	462 224	201 743	251 466
% STORAGE		74.1%	75.1%	59.6%	51.5%	22.5%	28.0%




WCWSS Storage Record (2008 - Present)

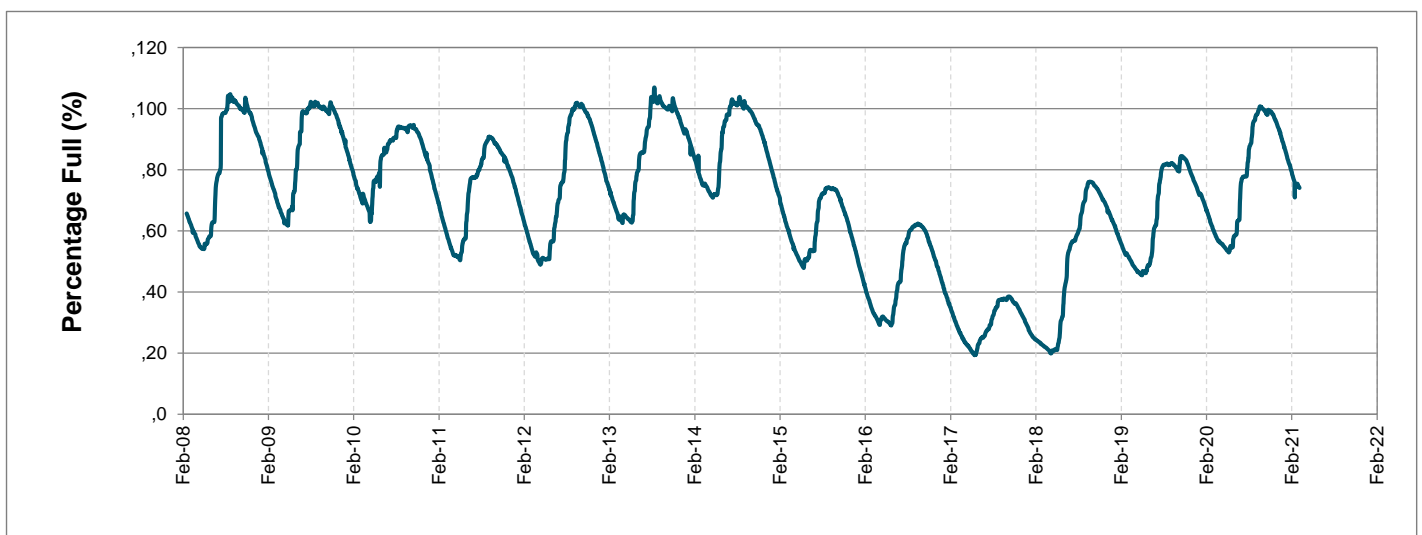

WCWSS Comparative Storage Graph

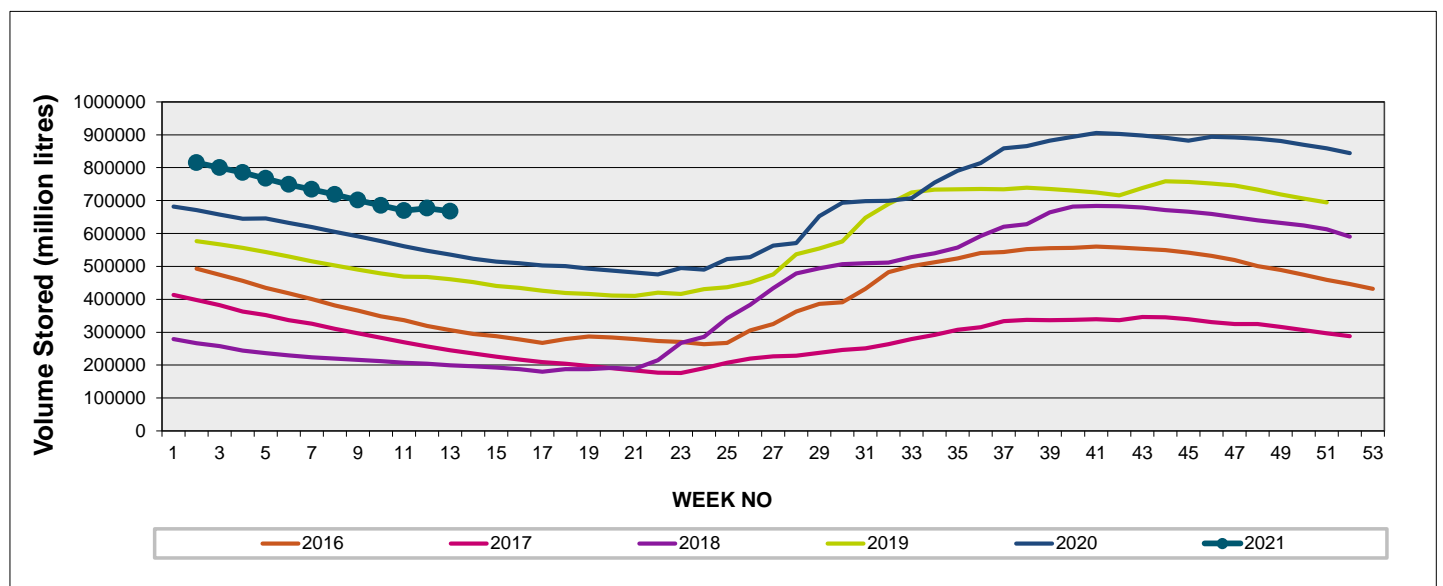

WCWSS Dam Storage and Water Use Tracking

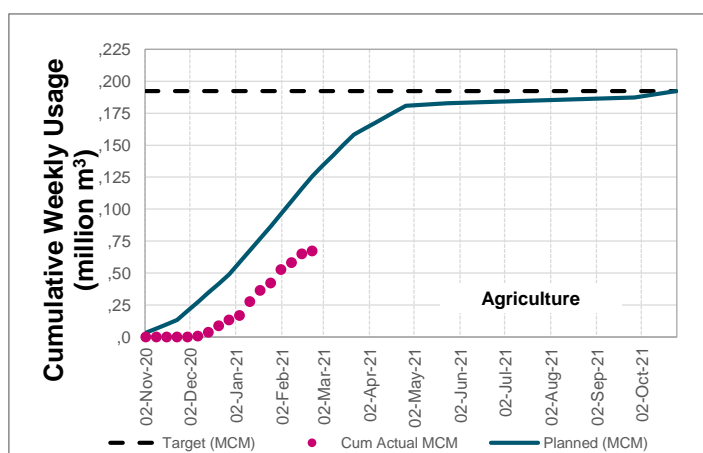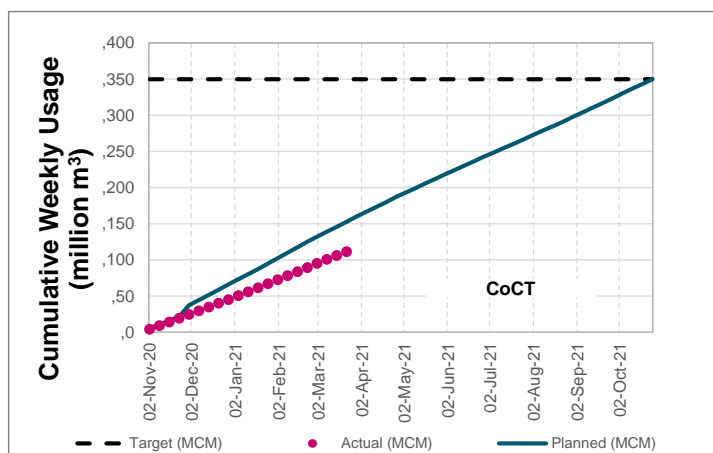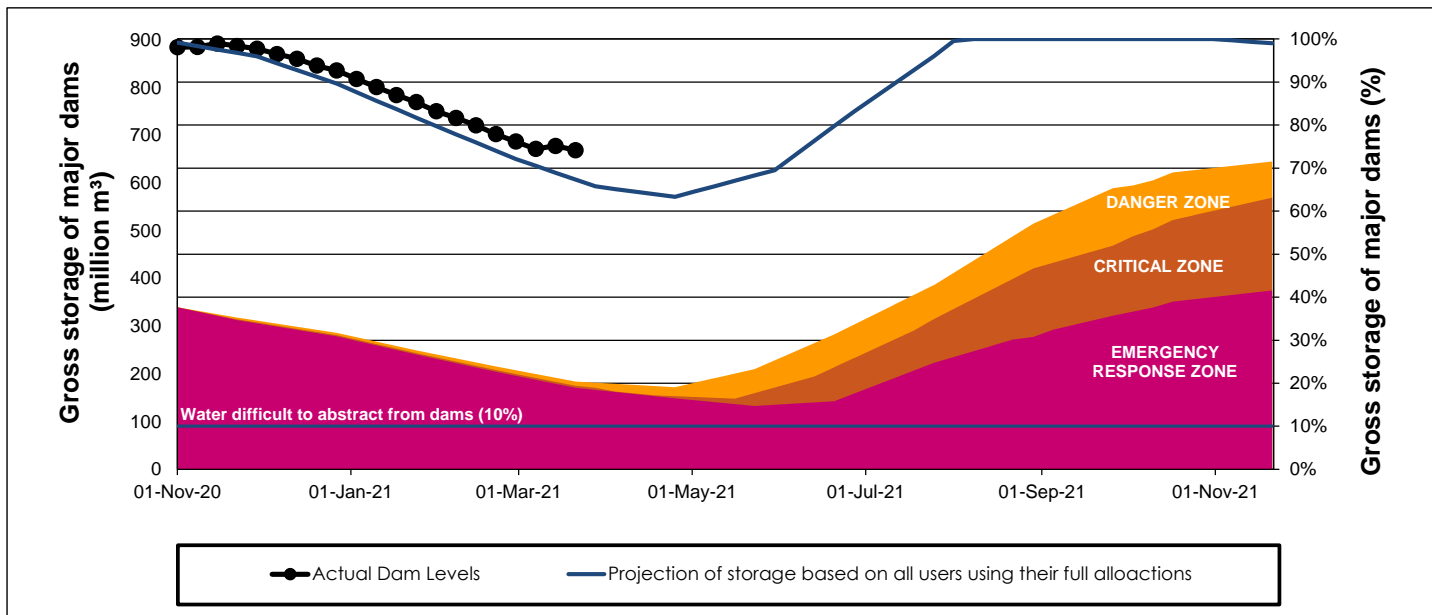

Water Stored in Minor Dams

Overall Percentage Full **50.4**

Weekly Change **-1.61**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	23 March 2021	Previous week	2020	2019	2018	2017
ALEXANDRA (Table Mountain)	126	46.7	47.8	33.2	0.0	37.3	30.9
DE VILLIERS (Table Mountain)	243	49.4	55.6	94.3	60.7	54.5	49.0
HELY-HUTCHINSON (Table Mountain)	925	22.7	22.0	0.0	35.8	94.7	94.2
KLEINPLAATS (Simon's Town)	1 368	54.5	55.7	43.1	49.9	41.8	46.1
LAND-EN-ZEEZICHT (Helderberg)	451	74.0	74.5	60.9	92.7	89.4	80.4
LEWIS GAY (Simon's Town)	182	75.5	85.1	0.0	0.0	57.7	36.9
VICTORIA (Table Mountain)	128	0.0	0.0	75.3	1.7	75.0	75.6
WOODHEAD (Table Mountain)	954	65.8	68.6	87.6	56.3	56.3	96.0
Total Stored	4 377	2206.9	2277.4	2055.6	2105.5	2755.8	3088.1
Percentages stored		50.4	52.0	47.0	48.1	63.0	70.6


Rainfall Recorded

RAINFALL (mm)	17-Mar	18-Mar	19-Mar	20-Mar	21-Mar	22-Mar	23-Mar	Mar	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	0.0	0.0	0.0	0.0	21.0	18.5
Brooklands	0.0	3.0	0.0	0.0	0.0	0.0	0.0	54.0	36.3
Newlands	0.0	4.0	0.0	0.0	0.0	0.0	0.0	128.5	46.0
Steenbras	0.0	0.0	0.0	0.0	0.0	0.0	0.0	44.3	39.0
Table Mountain (Woodhead)	0.0	6.0	6.0	0.0	0.0	0.0	0.0	95.5	58.7
Theewaterskloof	0.0	1.4	0.0	0.0	0.0	0.0	0.0	12.3	26.9
Tygerberg	0.0	1.1	0.0	0.0	0.0	0.0	0.0	23.8	15.0
Voëlvlei	0.0	0.0	0.0	0.0	0.0	0.0	0.0	34.0	12.9
Wemmershoek	0.0	0.0	0.0	0.0	0.0	0.0	0.0	63.2	29.3
Wynberg	0.0	4.0	0.0	0.0	0.0	0.0	0.0	72.0	26.2

Notes: *Total/cumulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

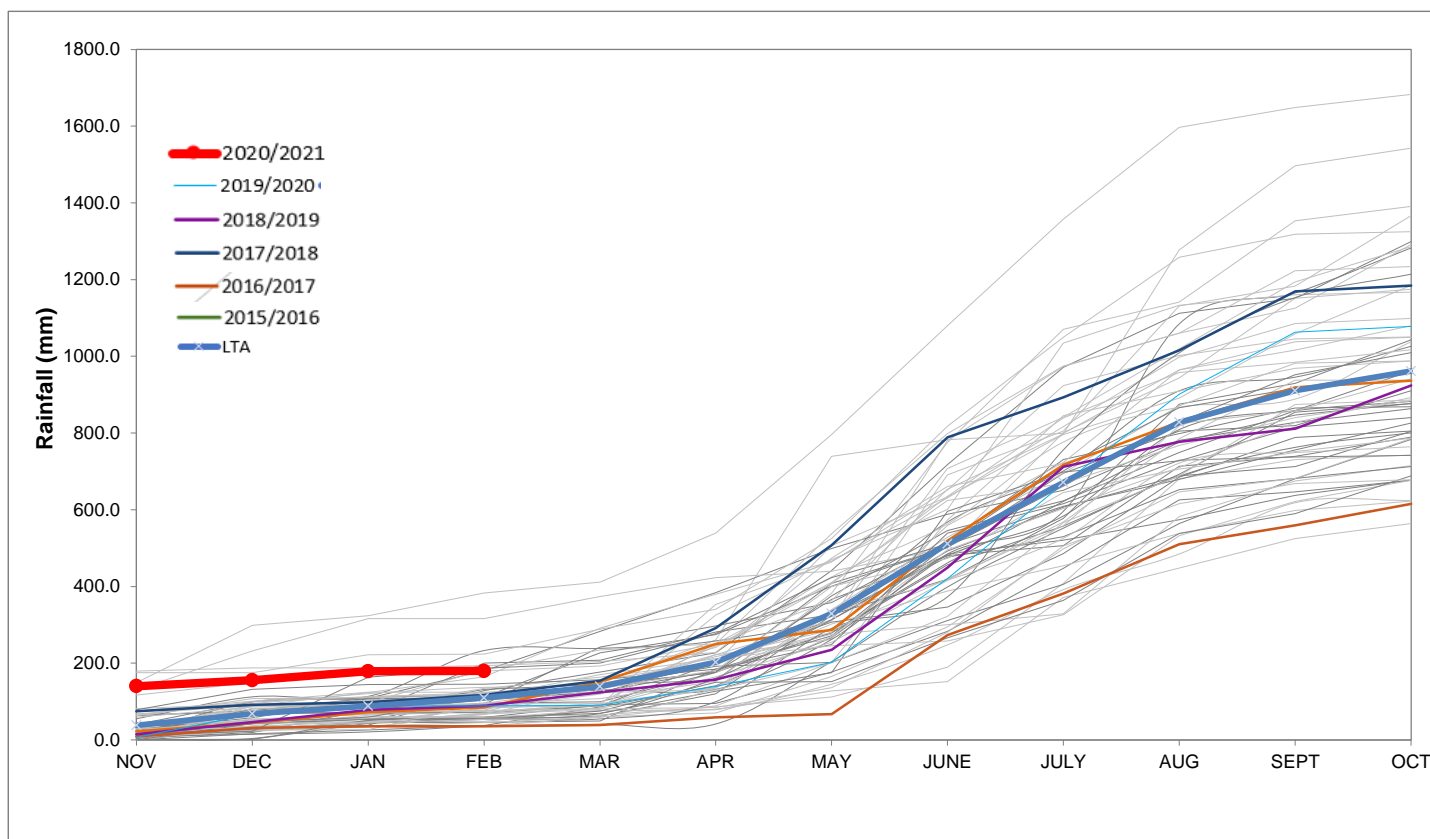

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98
Oct-20	99.17	98
Nov-20	99.17	98
Dec-20	99.14	98
Jan-21	99.16	98
Feb-21	99.12	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.