






Headline Statistics

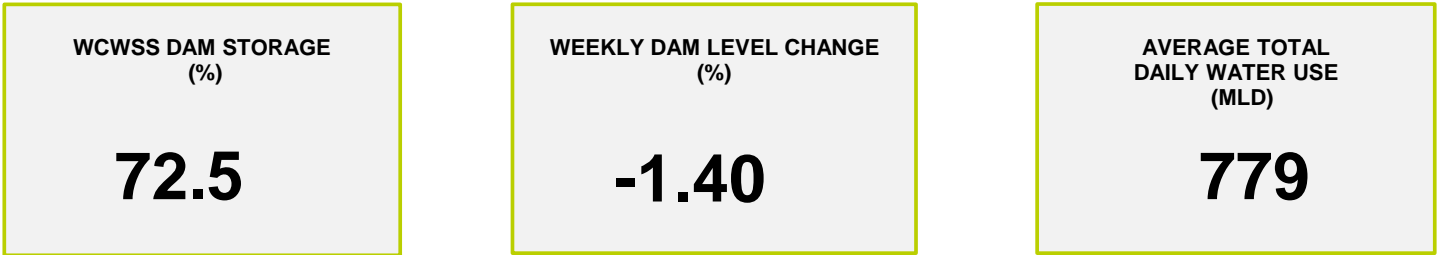

Water Production from Different Sources

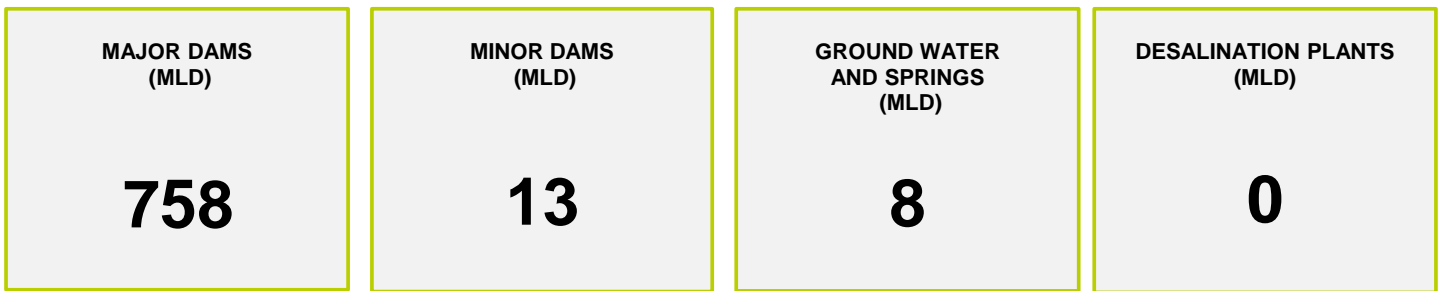

Overall Water Usage Trend (2010 - Present)

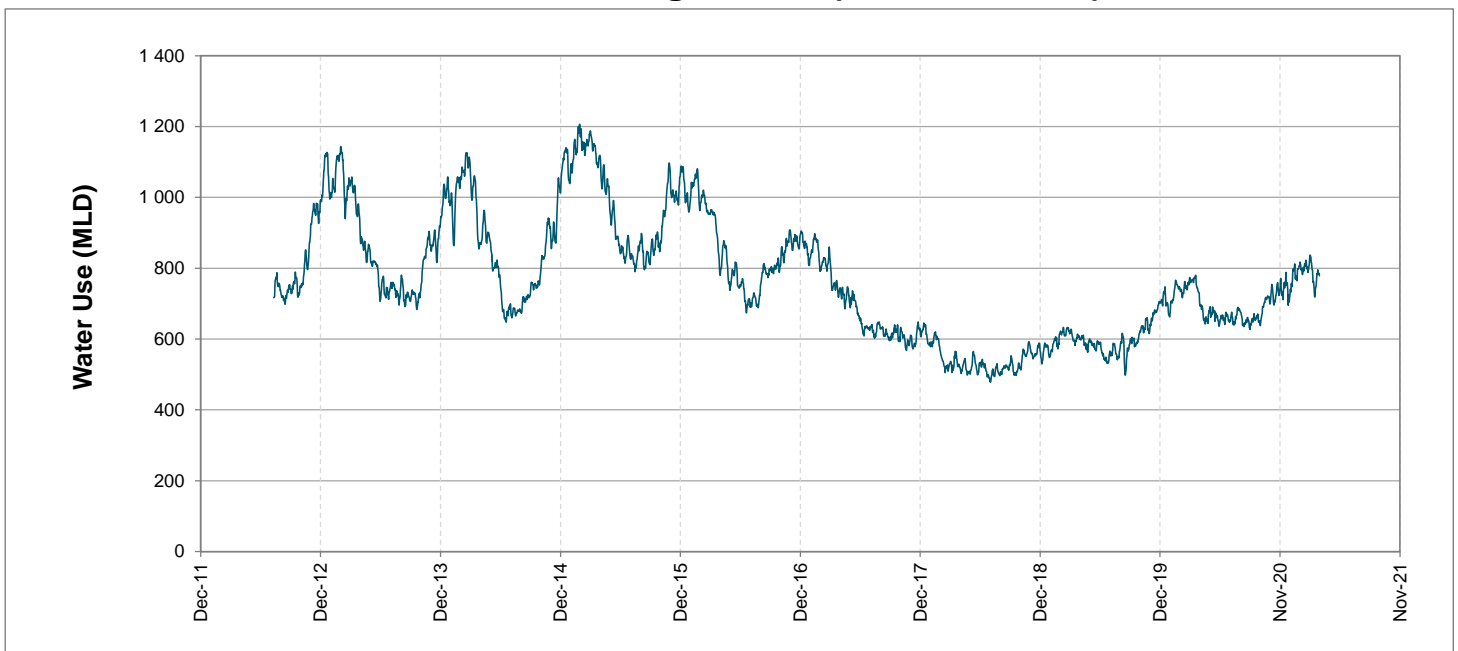

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **72.5%**


Weekly Change **-1.4%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	31 March 2021	Previous week	2020	2019	2018	2017
BERG RIVER	130 010	75.2	76.3	68.7	71.5	45.3	35.8
STEENBRAS LOWER	33 517	62.6	64.4	60.3	47.2	37.3	31.1
STEENBRAS UPPER	31 767	51.4	51.8	97.1	69.6	82.3	53.2
THEEWATERSKLOOF	480 188	76.6	77.9	53.9	39.3	10.6	21.8
VOËLVLEI	164 095	65.5	67.3	55.4	61.4	14.4	24.0
WEMMERSHOEK	58 644	69.9	72.0	54.8	54.8	44.0	35.9
TOTAL STORED	898 221	651 458	663 870	522 213	452 651	197 782	238 882
% STORAGE		72.5%	73.9%	58.1%	50.4%	22.0%	26.6%




WCWSS Storage Record (2008 - Present)

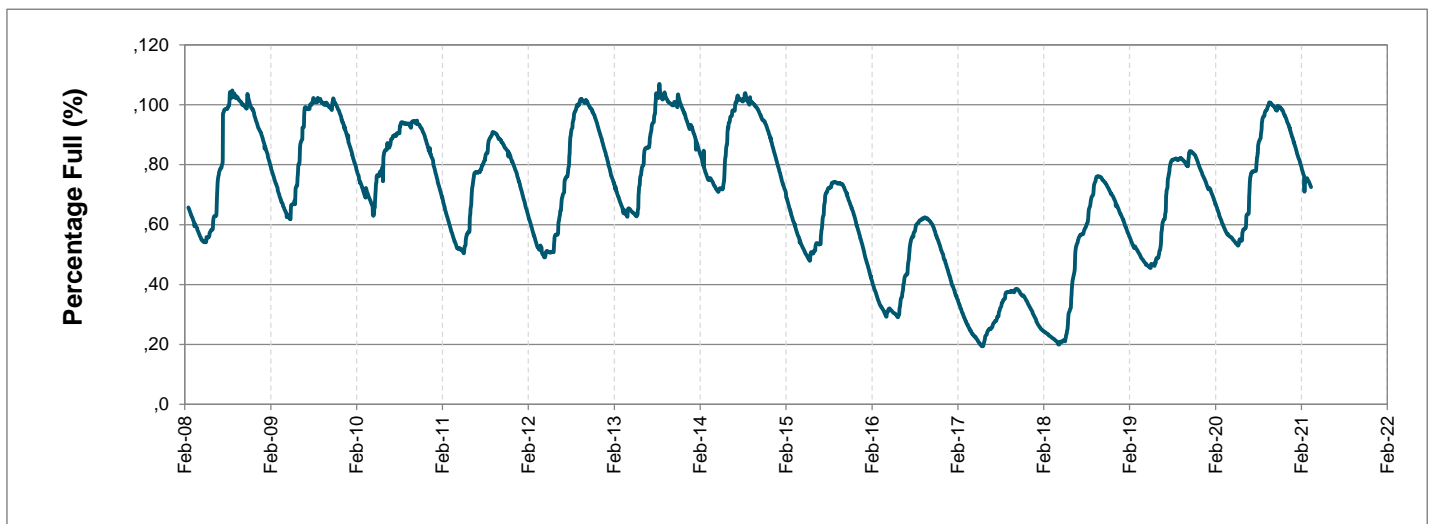

WCWSS Comparative Storage Graph

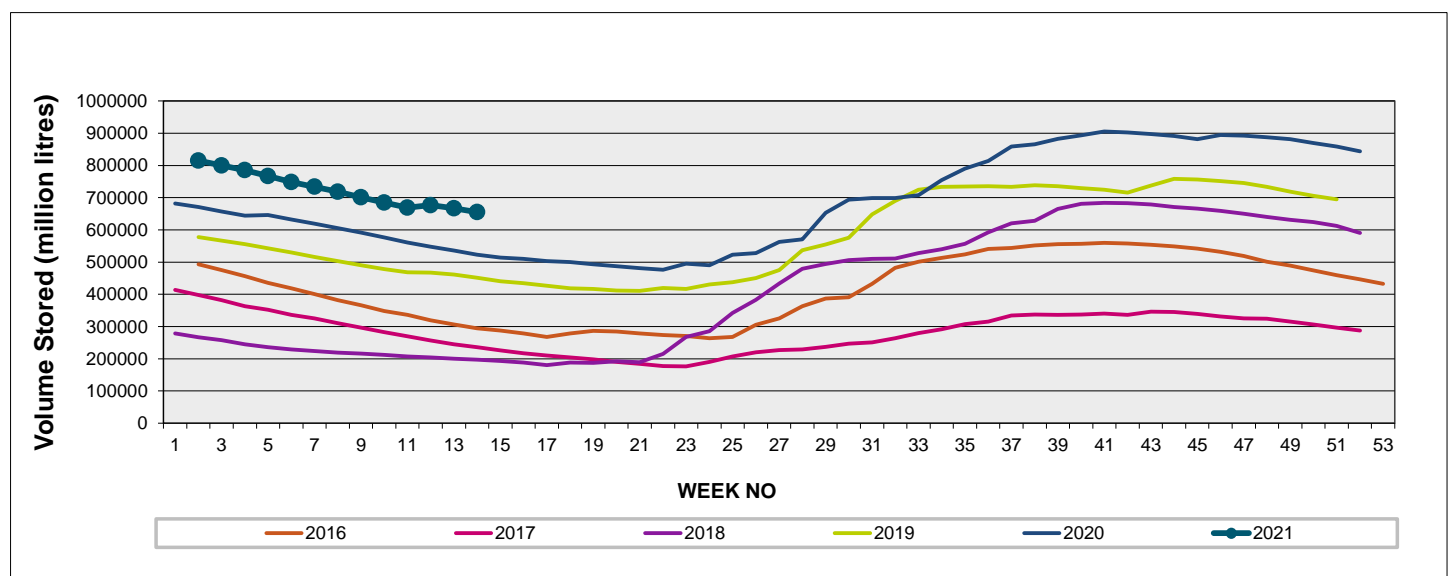

WCWSS Dam Storage and Water Use Tracking

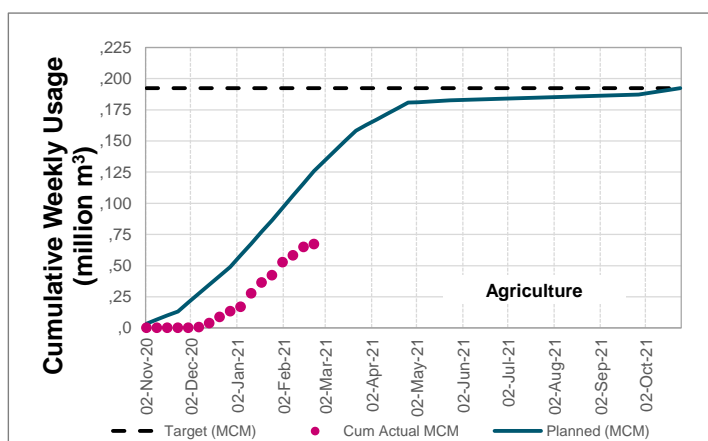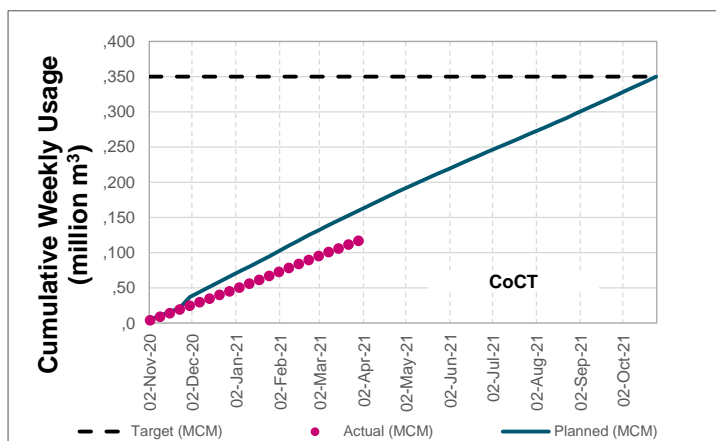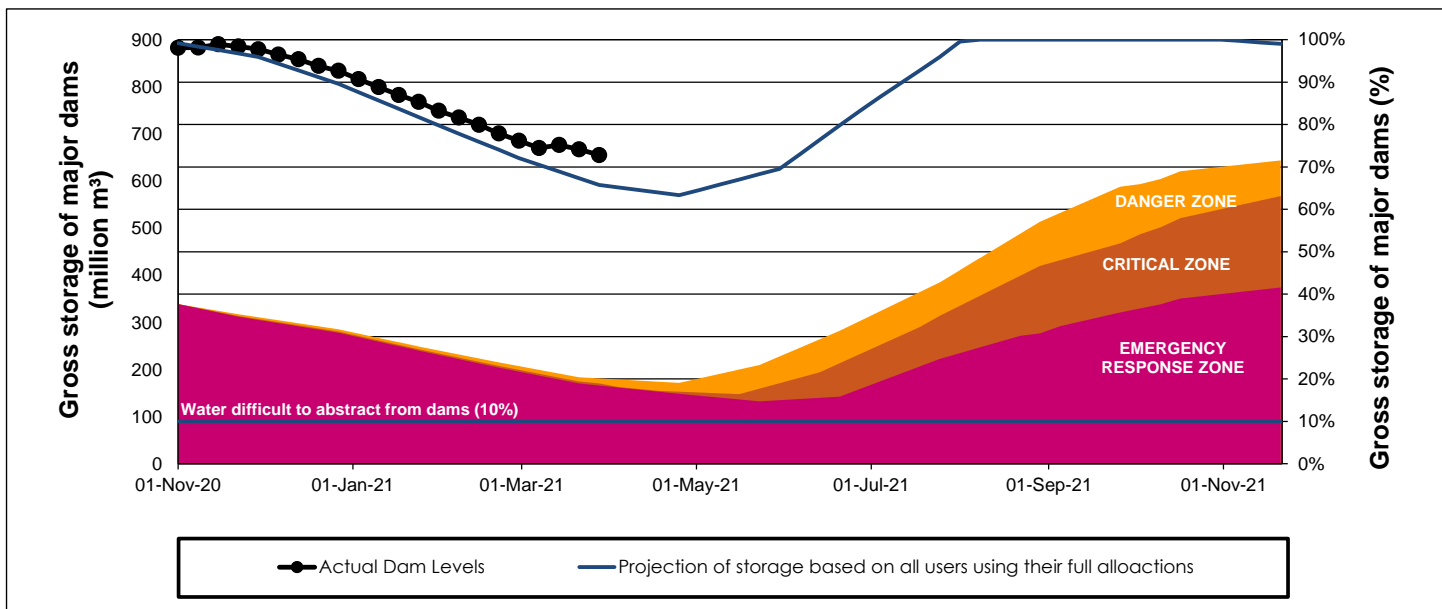

Water Stored in Minor Dams

Overall Percentage Full **46.2**

Weekly Change **-3.80**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	31 March 2021	Previous week	2020	2019	2018	2017
ALEXANDRA (Table Mountain)	126	23.7	46.3	32.8	0.0	43.8	30.6
DE VILLIERS (Table Mountain)	243	52.0	48.7	91.3	60.5	55.5	47.6
HELY-HUTCHINSON (Table Mount)	925	12.4	21.5	0.0	25.7	88.7	94.2
KLEINPLAATS (Simon's Town)	1 368	53.5	54.5	42.4	48.6	41.2	44.9
LAND-EN-ZEEZICHT (Helderberg)	451	72.3	73.9	59.1	93.7	90.9	81.0
LEWIS GAY (Simon's Town)	182	64.5	74.2	0.0	0.0	54.4	30.5
VICTORIA (Table Mountain)	128	0.0	0.0	74.6	0.0	65.9	74.3
WOODHEAD (Table Mountain)	954	63.1	65.5	86.8	51.7	56.1	95.7
Total Stored	4 377	2020.5	2187.0	2021.4	1953.1	2690.9	3055.7
Percentages stored		46.2	50.0	46.2	44.6	61.5	69.8


Rainfall Recorded

RAINFALL (mm)	25-Mar	26-Mar	27-Mar	28-Mar	29-Mar	30-Mar	31-Mar	Mar	
								Total*	LT Average
Blackheath Upper	0.0	4.0	0.0	0.0	0.0	0.0		25.0	18.5
Brooklands	0.0	5.0	0.0	0.0	0.0	3.0		62.0	36.3
Newlands	0.0	3.0	0.0	0.0	0.0	0.0		131.5	46.0
Steenbras	0.0	15.0	0.0	0.0	0.0	0.0		59.3	39.0
Table Mountain (Woodhead)	0.0	7.5	0.0	0.0	0.0	0.0		103.0	58.7
Theewaterskloof	0.0	0.0	0.0	0.0	0.0	0.0		12.3	26.9
Tygerberg	0.0	4.0	0.0	0.0	0.0	0.0		27.8	15.0
Voëlvlei	0.0	4.8	0.0	0.0	0.0	0.0		38.8	12.9
Wemmershoek	0.0	7.5	0.0	0.0	0.0	0.0		70.7	29.3
Wynberg	0.0	0.0	0.0	0.0	0.0	0.0		72.0	26.2

Notes: *Total/cummulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

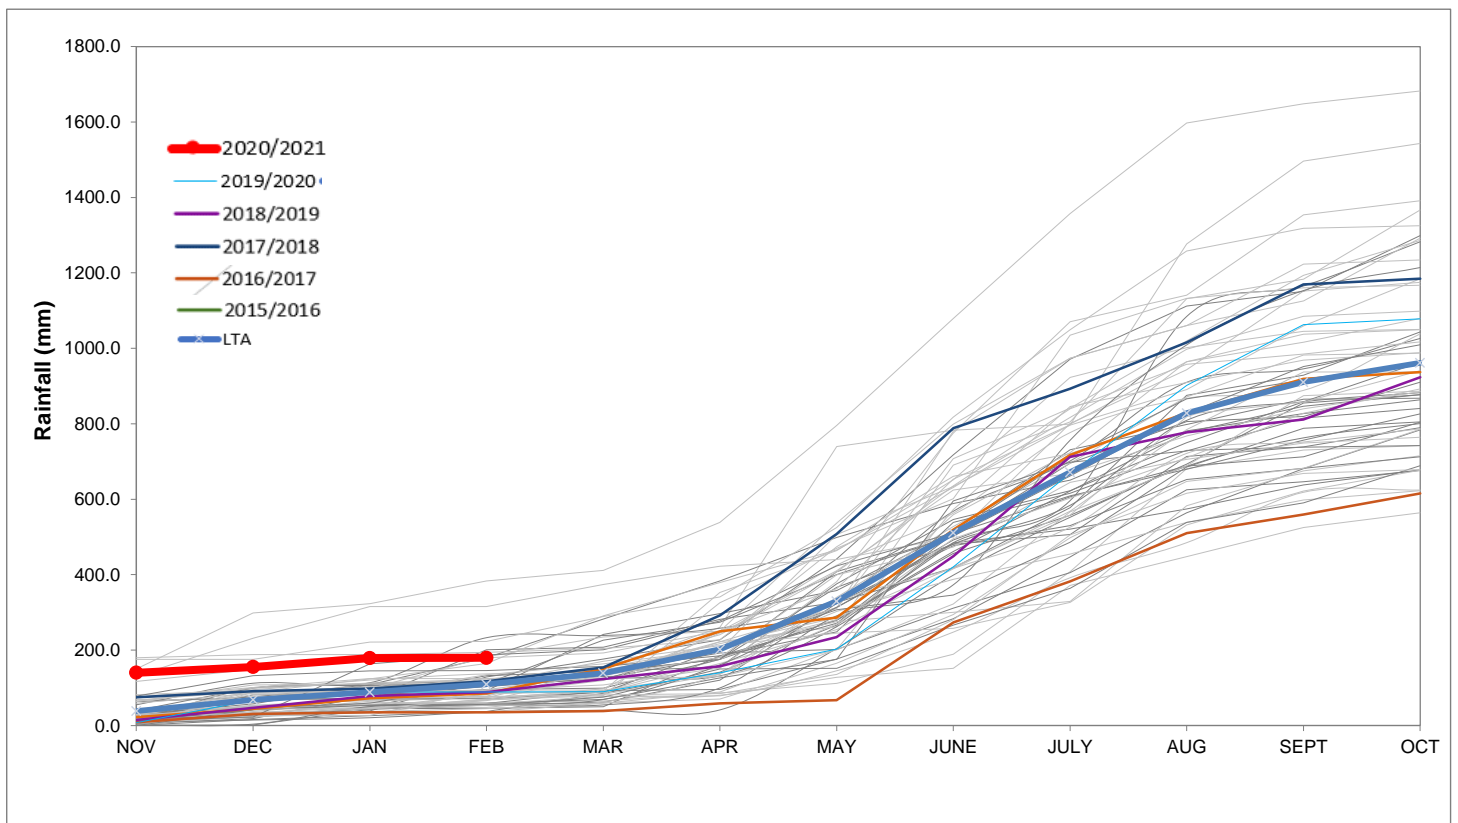

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98
Oct-20	99.17	98
Nov-20	99.17	98
Dec-20	99.14	98
Jan-21	99.16	98
Feb-21	99.12	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)