


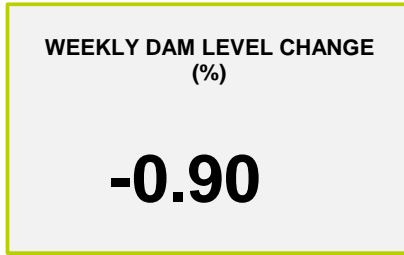


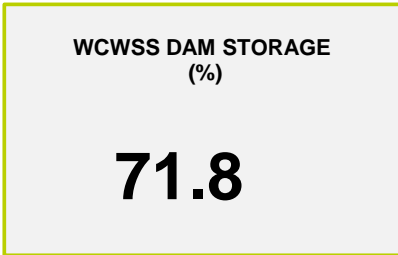


Headline Statistics

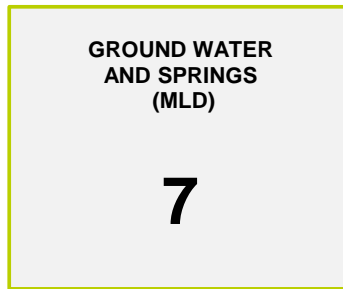

Water Production from Different Sources

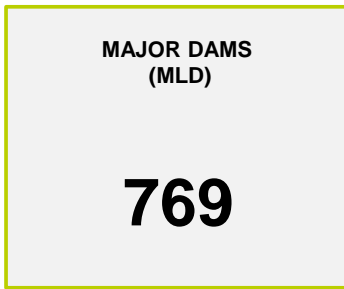

Overall Water Usage Trend (2010 - Present)

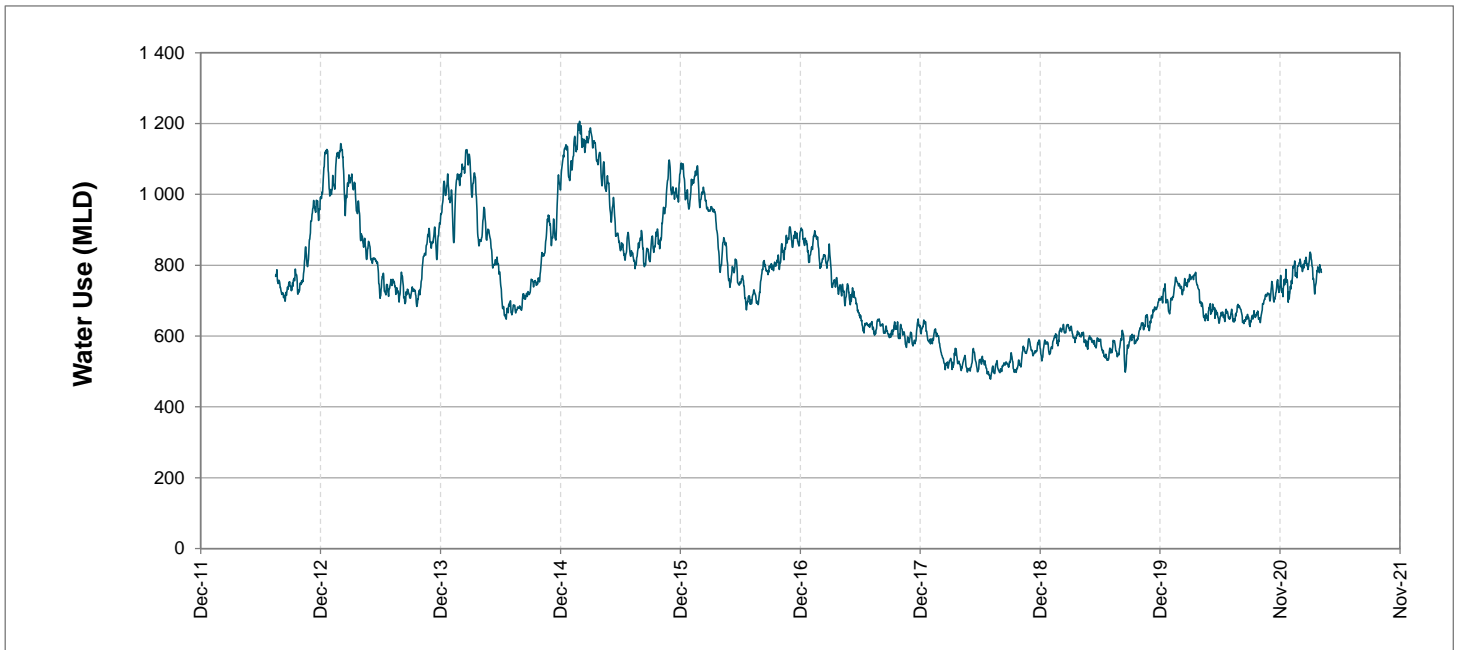

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **71.8%**


Weekly Change **-0.9%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	06 April 2021	Previous week	2020	2019	2018	2017
BERG RIVER	130 010	74.4	75.3	67.5	70.5	44.2	34.9
STEENBRAS LOWER	33 517	61.6	63.0	58.7	45.9	37.3	33.1
STEENBRAS UPPER	31 767	53.0	52.1	96.9	69.4	78.1	53.5
THEEWATERSKLOOF	480 188	76.0	76.8	53.2	38.7	10.5	20.6
VOËLVLEI	164 095	64.3	65.5	54.3	60.4	14.3	22.9
WEMMERSHOEK	58 644	68.3	70.3	53.5	53.2	44.0	35.9
TOTAL STORED	898 221	644 613	653 041	514 191	445 129	194 531	230 934
% STORAGE		71.8%	72.7%	57.2%	49.6%	21.7%	25.7%




WCWSS Storage Record (2008 - Present)

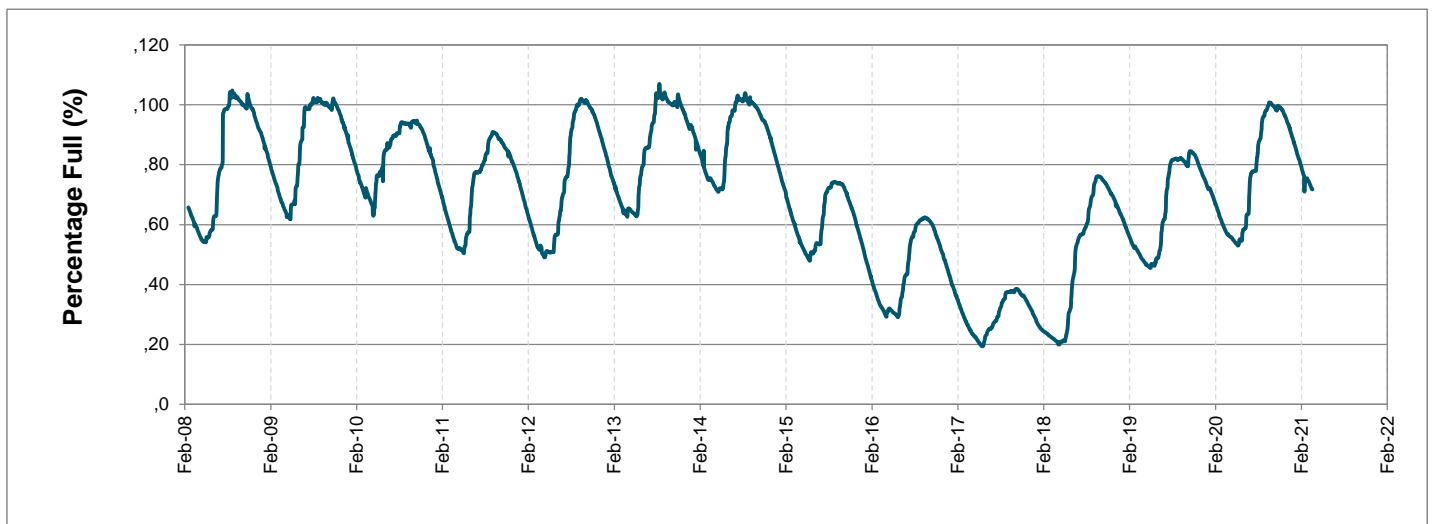

WCWSS Comparative Storage Graph

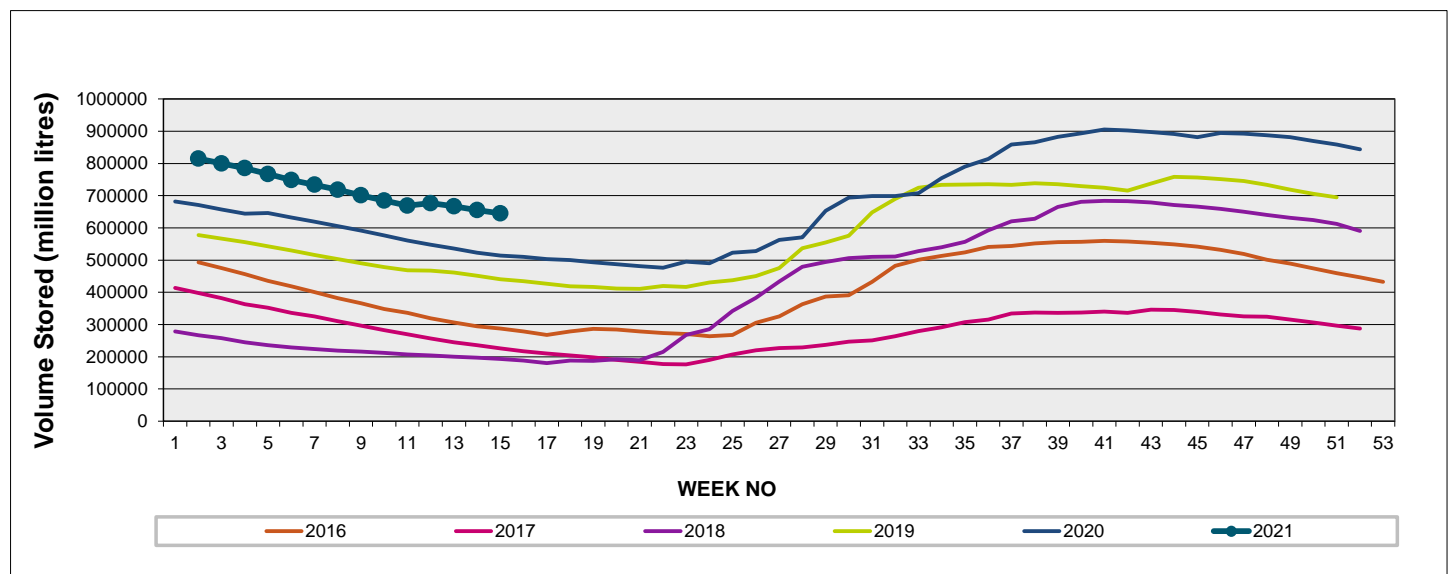

WCWSS Dam Storage and Water Use Tracking

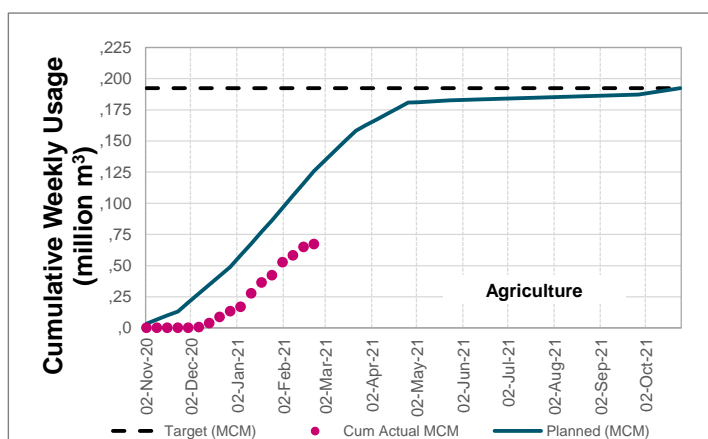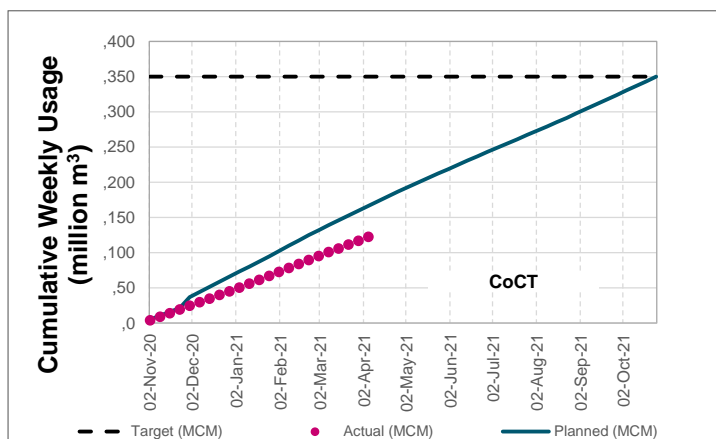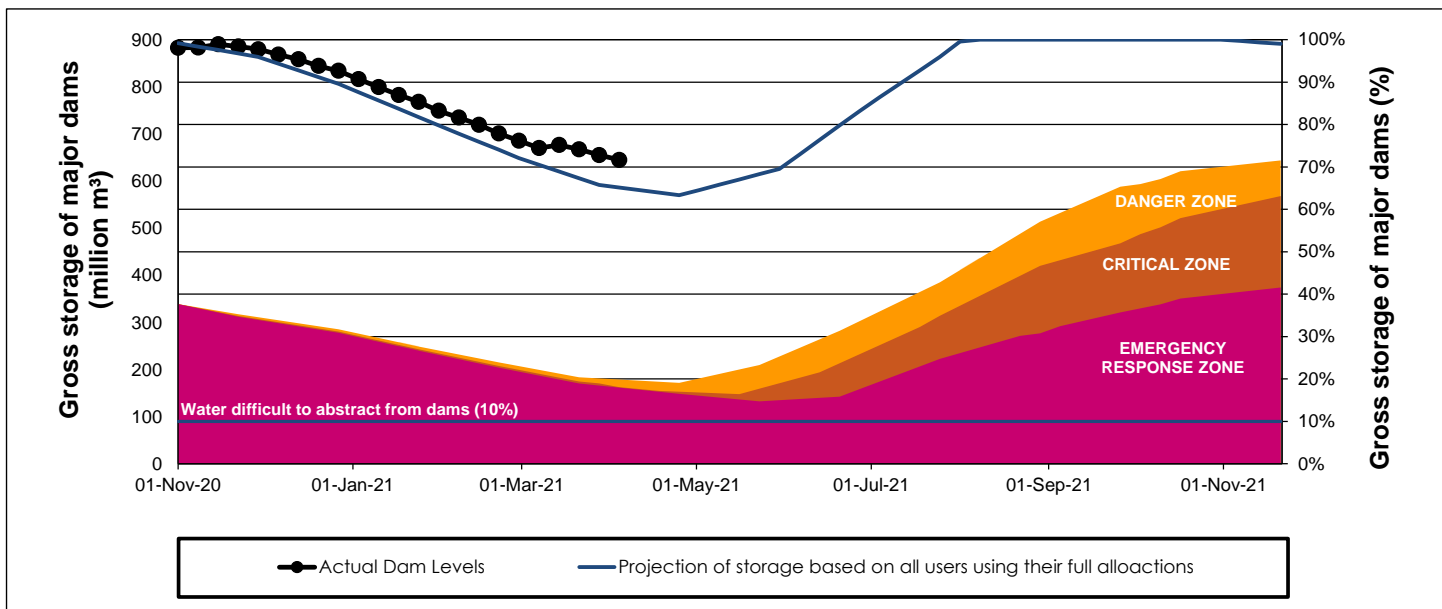

Water Stored in Minor Dams

Overall Percentage Full **47.1**

Weekly Change **0.64**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	06 April 2021	Previous week	2020	2019	2018	2017
ALEXANDRA (Table Mountain)	126	7.2	28.0	32.3	0.0	49.1	30.6
DE VILLIERS (Table Mountain)	243	54.9	51.6	93.0	67.5	56.1	47.3
HELY-HUTCHINSON (Table Mount)	925	16.7	13.5	0.0	12.2	83.6	94.6
KLEINPLAATS (Simon's Town)	1 368	52.8	53.5	41.2	47.7	42.8	43.0
LAND-EN-ZEEZICHT (Helderberg)	451	70.5	72.5	58.1	95.0	92.4	81.3
LEWIS GAY (Simon's Town)	182	57.7	65.5	0.0	0.0	58.2	22.0
VICTORIA (Table Mountain)	128	0.0	0.0	72.7	0.0	57.5	74.3
WOODHEAD (Table Mountain)	954	67.7	62.5	86.5	60.5	57.6	94.6
Total Stored	4 377	2060.3	2032.4	1998.6	1924.0	2689.6	3009.3
Percentages stored		47.1	46.4	45.7	44.0	61.4	68.8


Rainfall Recorded

RAINFALL (mm)	31-Mar	01-Apr	02-Apr	03-Apr	04-Apr	05-Apr	06-Apr	Apr	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	36.1
Brooklands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	61.9
Newlands	5.5	0.0	0.0	0.0	0.0	0.0	0.0	5.5	109.5
Steenbras	7.5	0.0	0.0	0.0	0.0	0.0	0.0	7.5	81.3
Table Mountain (Woodhead)	0.3	0.0	0.0	0.0	5.0			5.3	125.0
Theewaterskloof	0.0	0.0	0.0	0.0	1.2	8.6		9.8	53.3
Tygerberg	1.2	0.0	0.0	0.0	0.0	0.0		1.2	35.7
Voëlvlei	0.0	0.0	0.0	0.0	0.0	0.0		0.0	40.2
Wemmershoek	0.2	0.0	0.0	0.0	0.0	0.0		0.2	67.8
Wynberg	0.0	0.0	0.0	0.0	0.0	0.0		0.0	62.9

Notes: *Total/cummulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

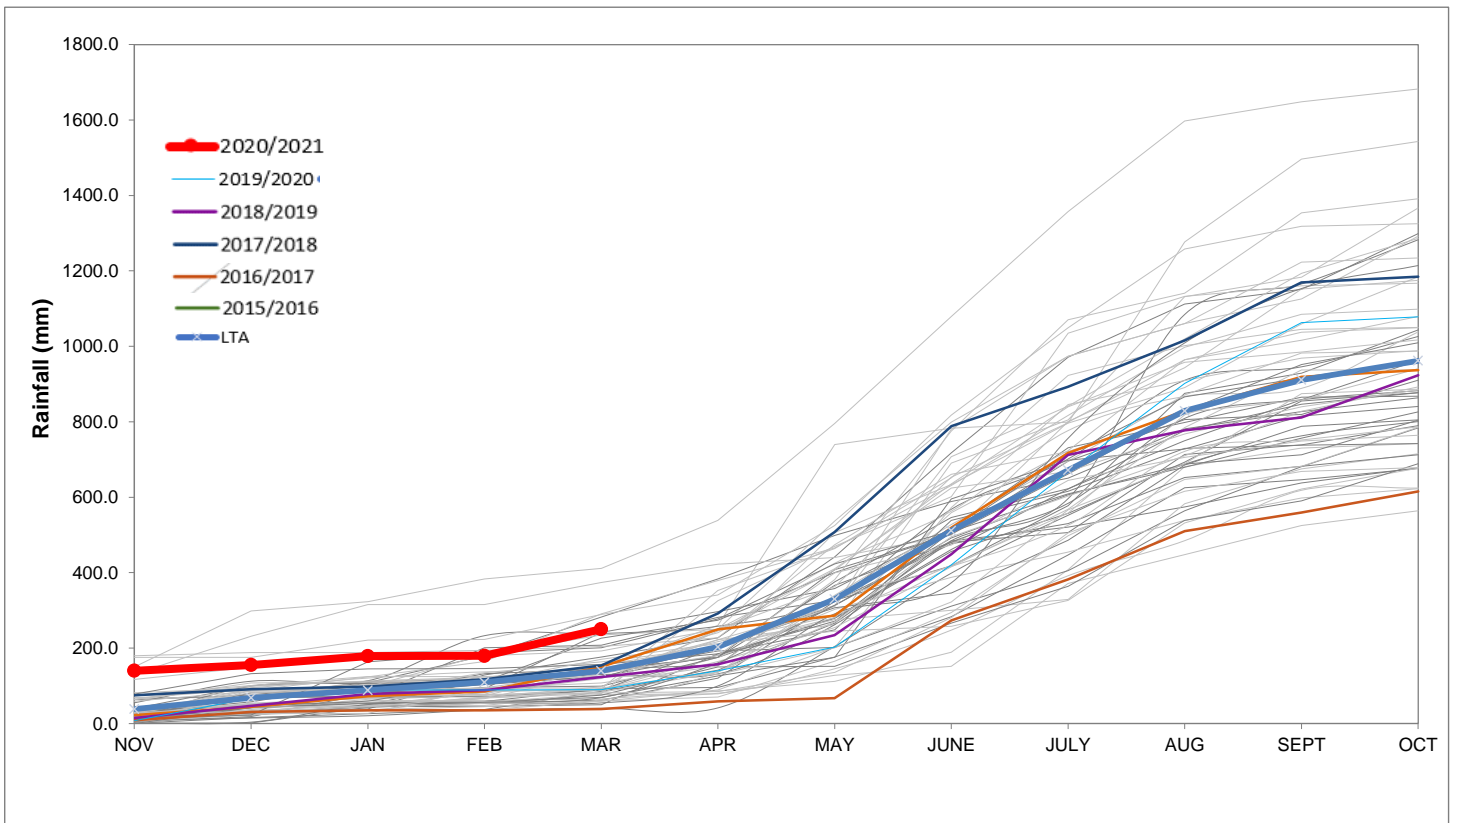

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98
Oct-20	99.17	98
Nov-20	99.17	98
Dec-20	99.14	98
Jan-21	99.16	98
Feb-21	99.12	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)