


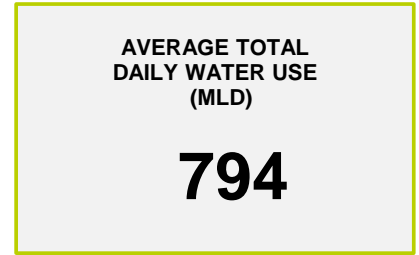


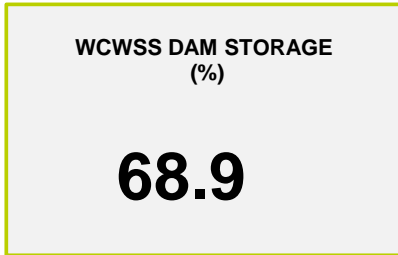


Headline Statistics

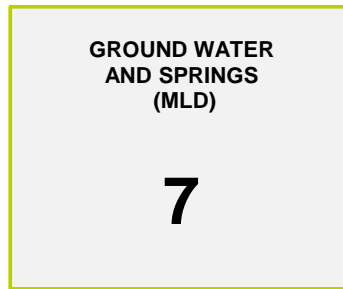

Water Production from Different Sources

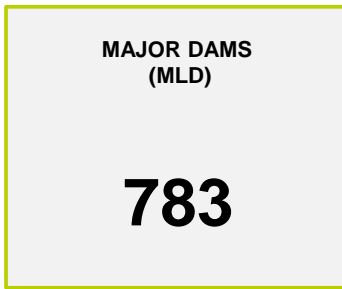

Overall Water Usage Trend (2010 - Present)

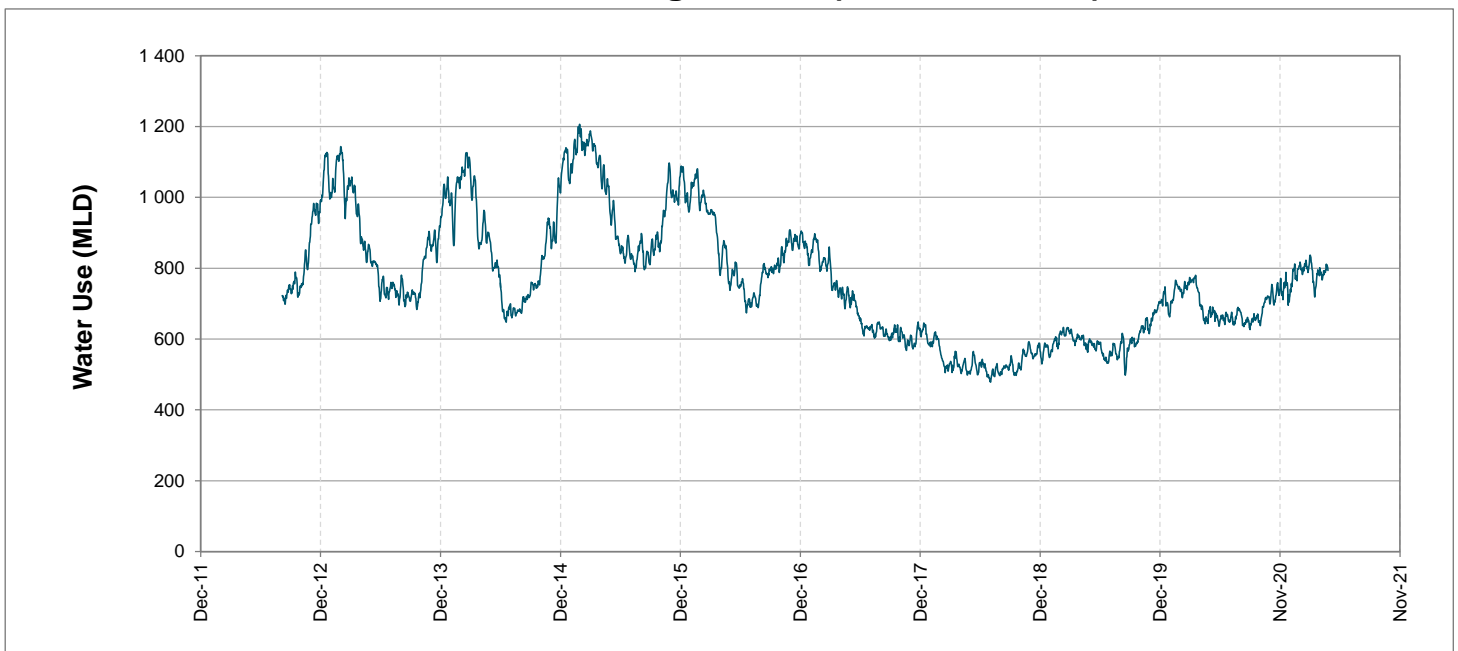

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **68.9%**


Weekly Change **-1.1%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	26 April 2021	Previous week	2020	2019	2018	2017
BERG RIVER	130 010	68.9	72.2	67.4	68.3	37.4	33.3
STEENBRAS LOWER	33 517	56.6	58.4	53.4	41.6	38.7	31.1
STEENBRAS UPPER	31 767	53.4	53.5	96.7	68.1	61.2	56.4
THEEWATERSKLOOF	480 188	73.7	74.7	52.0	37.0	10.3	17.4
VOËLVLEI	164 095	62.6	62.1	52.5	57.2	13.8	19.2
WEMMERSHOEK	58 644	62.3	64.4	49.0	48.1	45.4	35.9
TOTAL STORED	898 221	618 940	628 931	500 842	424 056	179 762	207 830
% STORAGE		68.9%	70.0%	55.8%	47.2%	20.0%	23.1%




WCWSS Storage Record (2008 - Present)

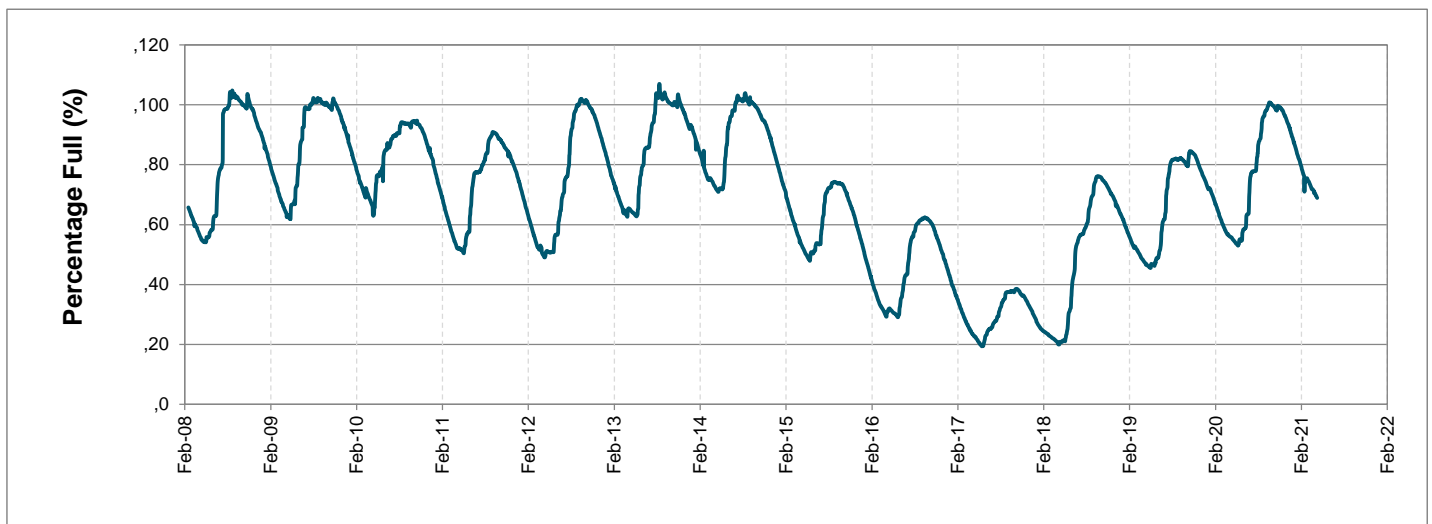

WCWSS Comparative Storage Graph

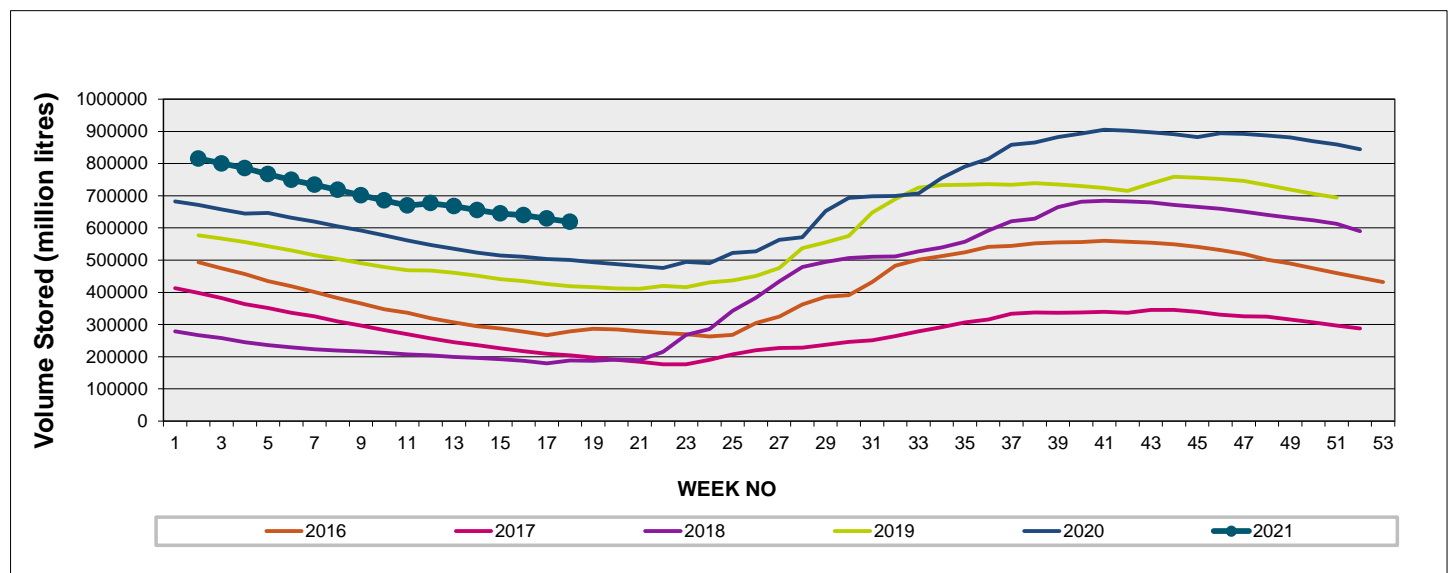

WCWSS Dam Storage and Water Use Tracking

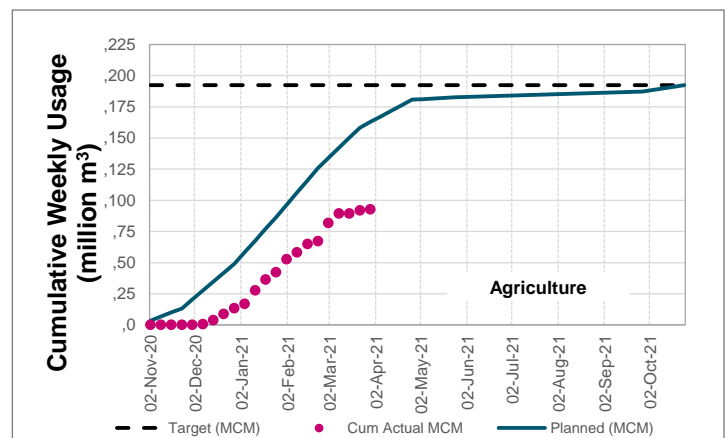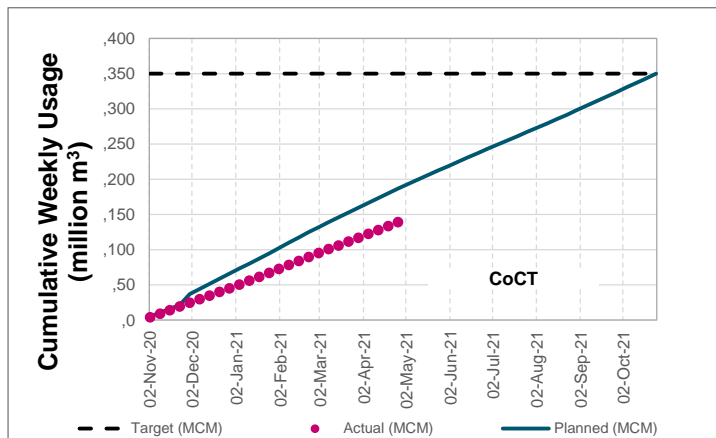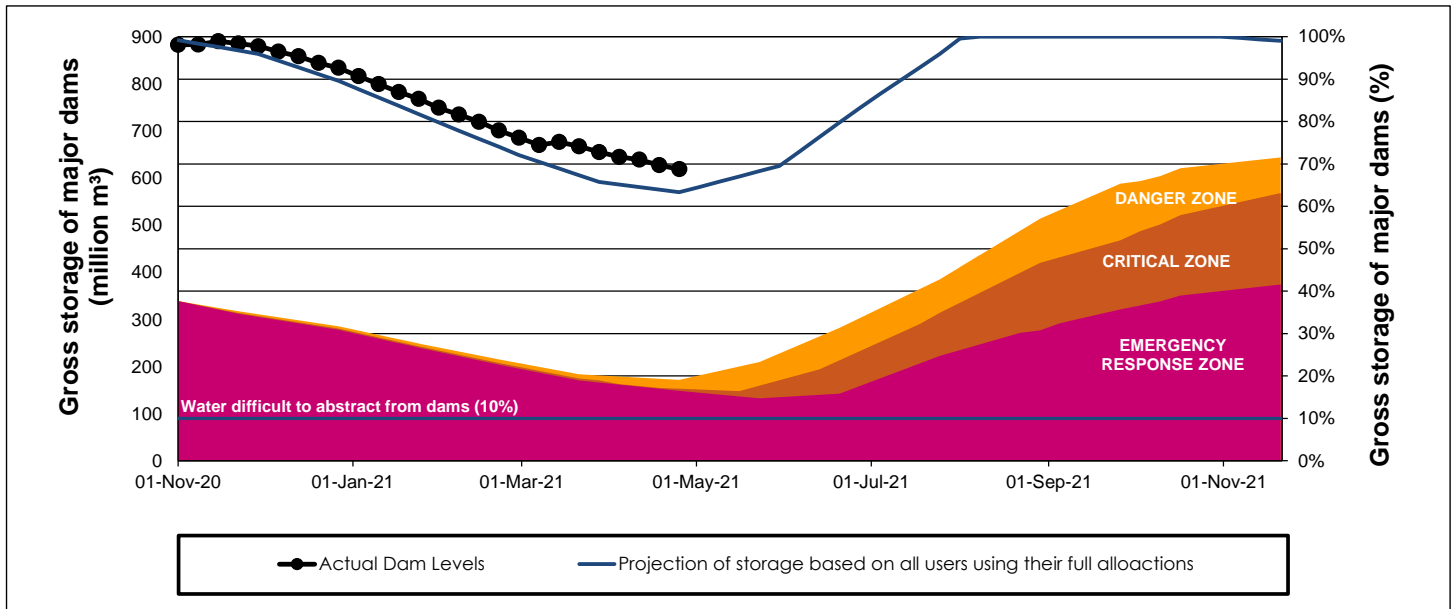

Water Stored in Minor Dams

Overall Percentage Full **43.1**

Weekly Change **-1.27**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	26 April 2021	Previous week	2020	2019	2018	2017
ALEXANDRA (Table Mountain)	126	0.0	0.0	33.8	0.0	63.4	30.6
DE VILLIERS (Table Mountain)	243	52.9	53.2	94.0	60.0	56.8	44.9
HELY-HUTCHINSON (Table Mount)	925	0.0	4.3	0.0	0.0	72.0	98.8
KLEINPLAATS (Simon's Town)	1 368	49.4	50.9	39.5	45.3	38.8	41.8
LAND-EN-ZEEZICHT (Helderberg)	451	68.0	68.3	58.8	97.3	89.4	77.8
LEWIS GAY (Simon's Town)	182	36.9	41.4	0.0	0.0	61.1	14.3
VICTORIA (Table Mountain)	128	0.0	0.0	74.3	0.0	38.4	71.7
WOODHEAD (Table Mountain)	954	76.7	75.4	98.1	51.5	57.6	72.3
Total Stored	4 377	1887.4	1943.2	2097.5	1686.0	2518.3	2781.9
Percentages stored		43.1	44.4	47.9	38.5	57.5	63.6


Rainfall Recorded

RAINFALL (mm)	20-Apr	21-Apr	22-Apr	23-Apr	24-Apr	25-Apr	26-Apr	Apr	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	36.1
Brooklands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	61.9
Newlands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5.5	109.5
Steenbras	0.0	0.0	0.0	0.0	0.0	0.0	0.0	7.5	81.3
Table Mountain (Woodhead)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5.3	125.0
Theewaterskloof	0.0	0.0	0.0	0.0	0.0	0.0	0.0	11.5	53.3
Tygerberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.2	35.7
Voëlvlei	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	40.2
Wemmershoek	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	67.8
Wynberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	62.9

Notes: *Total/cumulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

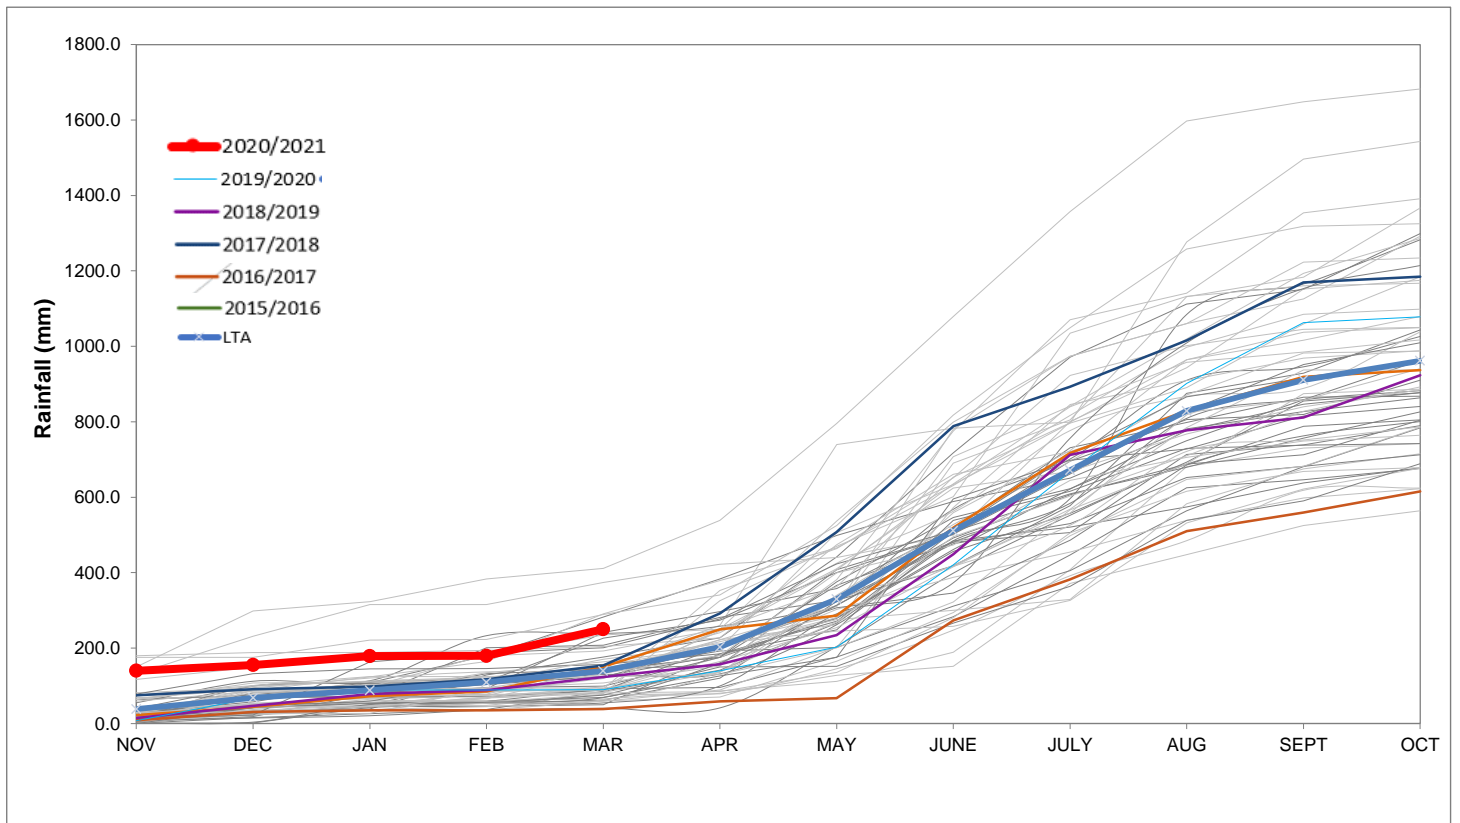

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98
Oct-20	99.17	98
Nov-20	99.17	98
Dec-20	99.14	98
Jan-21	99.16	98
Feb-21	99.12	98
Mar-21	99.08	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)