






## Headline Statistics

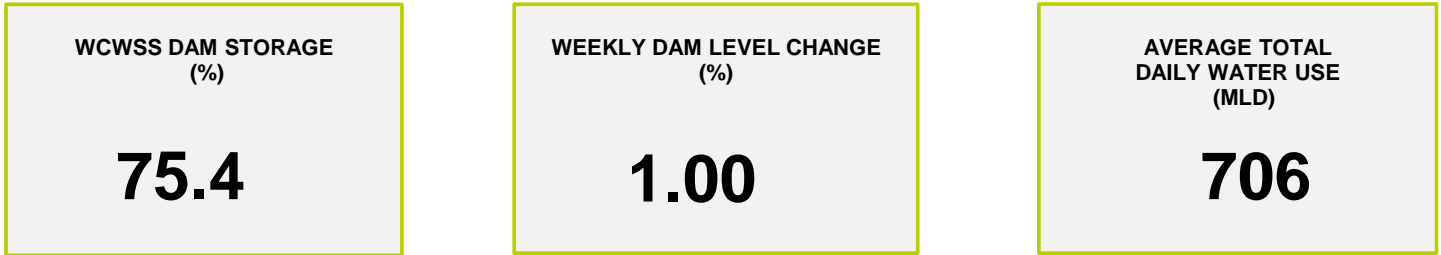

## Water Production from Different Sources

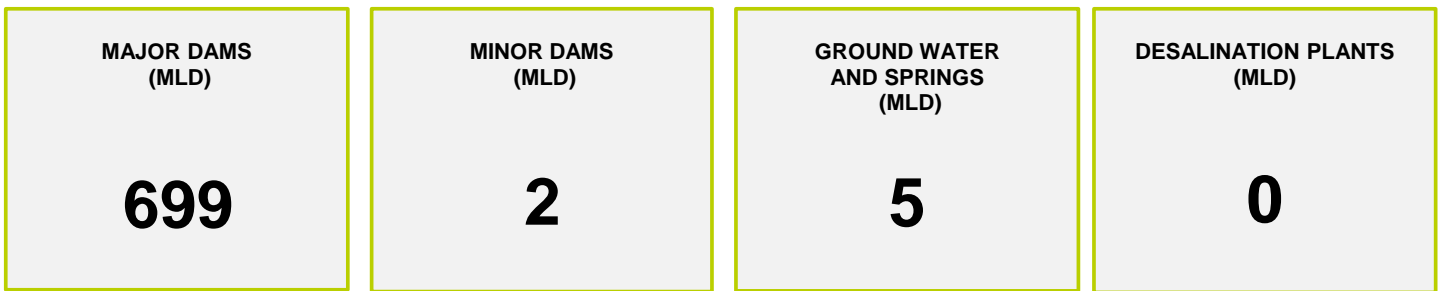

## Overall Water Usage Trend (2010 - Present)

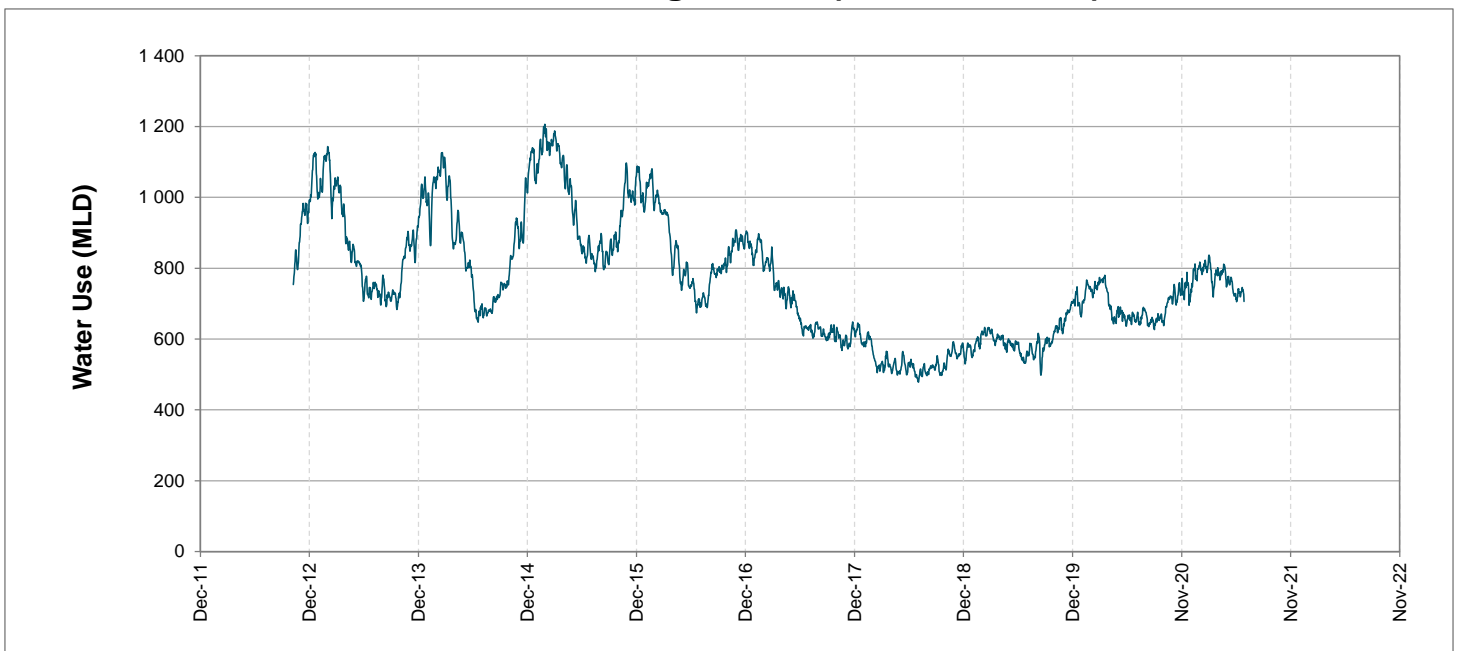

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


# Water Stored in Major Dams (WCWSS)

Overall Percentage Full **75.4%**


Weekly Change **1.0%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	28 June 2021	Previous week	2020	2019	2018	2017
BERG RIVER	130 010	89.7	86.5	80.8	76.7	69.6	36.6
STEENBRAS LOWER	33 517	61.6	58.2	50.4	41.4	47.4	29.8
STEENBRAS UPPER	31 767	60.1	59.0	100.3	67.7	95.1	60.1
THEEWATERSKLOOF	480 188	79.7	79.8	55.8	43.5	31.1	19.0
VOËLVLEI	164 095	61.8	60.6	55.0	57.7	39.2	19.4
WEMMERSHOEK	58 644	62.7	59.7	48.8	40.9	72.1	37.2
<b>TOTAL STORED</b>	<b>898 221</b>	<b>677 438</b>	<b>668 419</b>	<b>540 463</b>	<b>462 568</b>	<b>392 511</b>	<b>221 735</b>
<b>% STORAGE</b>		<b>75.4%</b>	<b>74.4%</b>	<b>60.2%</b>	<b>51.5%</b>	<b>43.7%</b>	<b>24.7%</b>




## WCWSS Storage Record (2008 - Present)

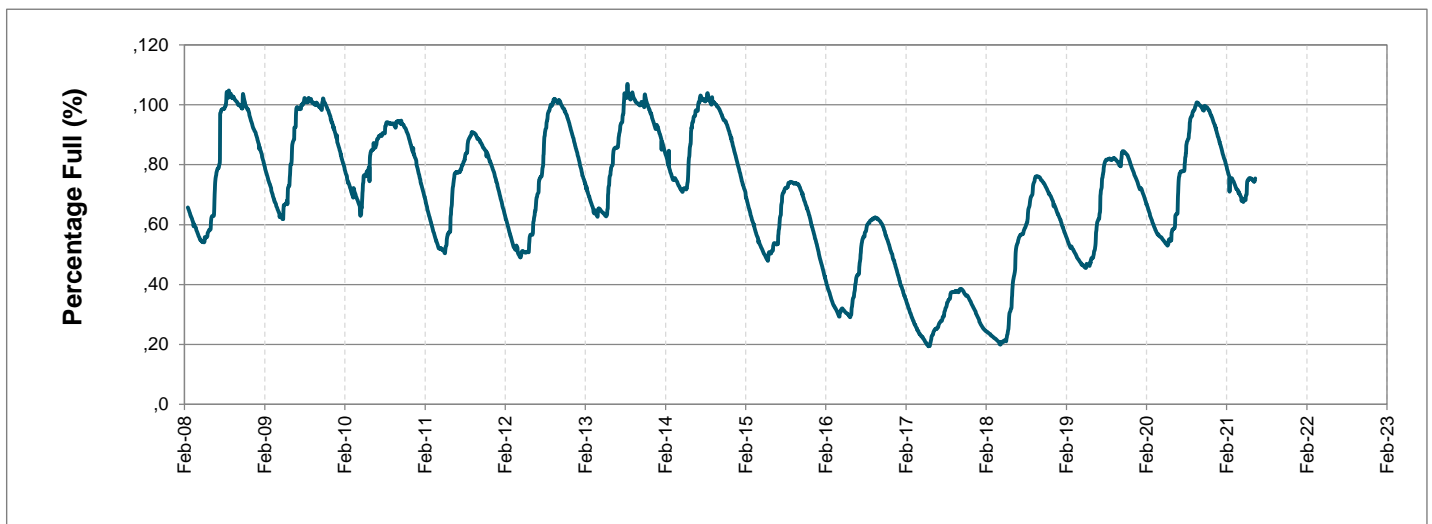

## WCWSS Comparative Storage Graph

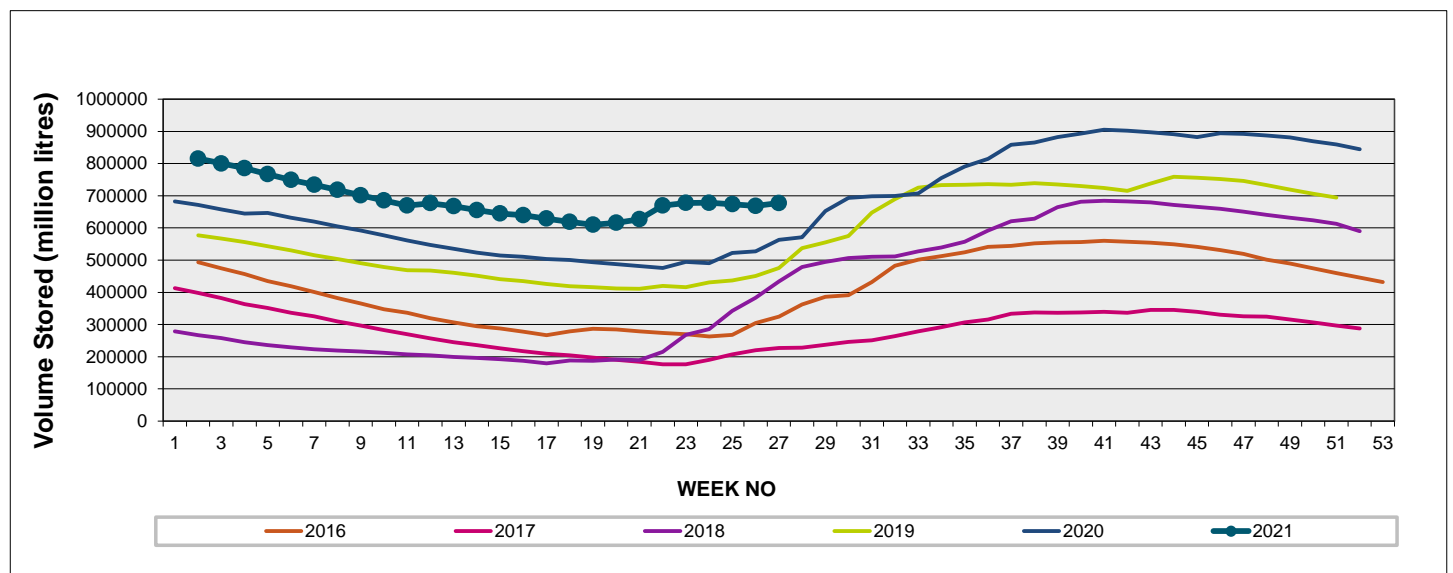

# WCWSS Dam Storage and Water Use Tracking

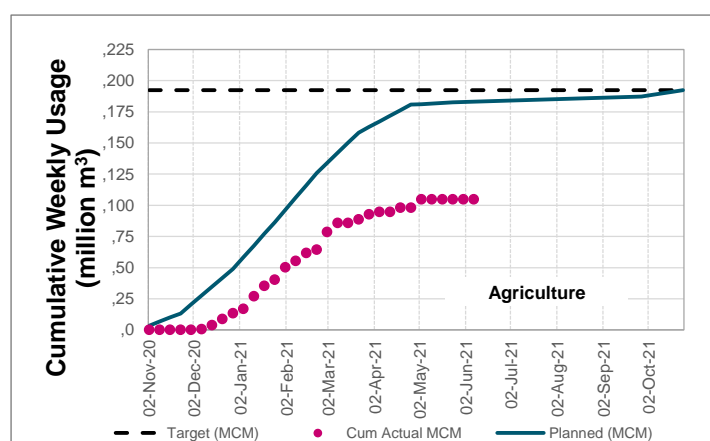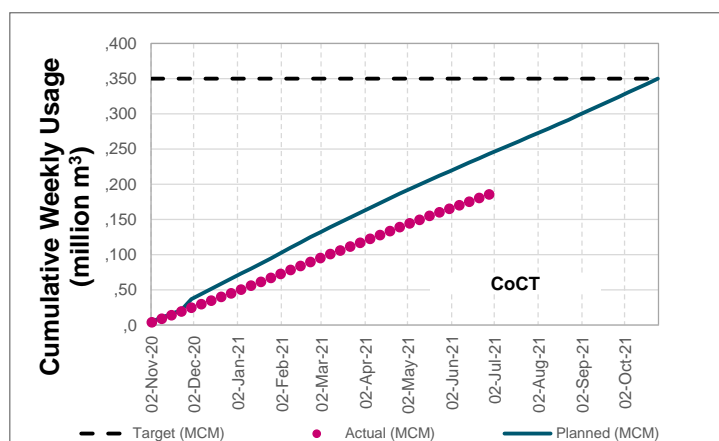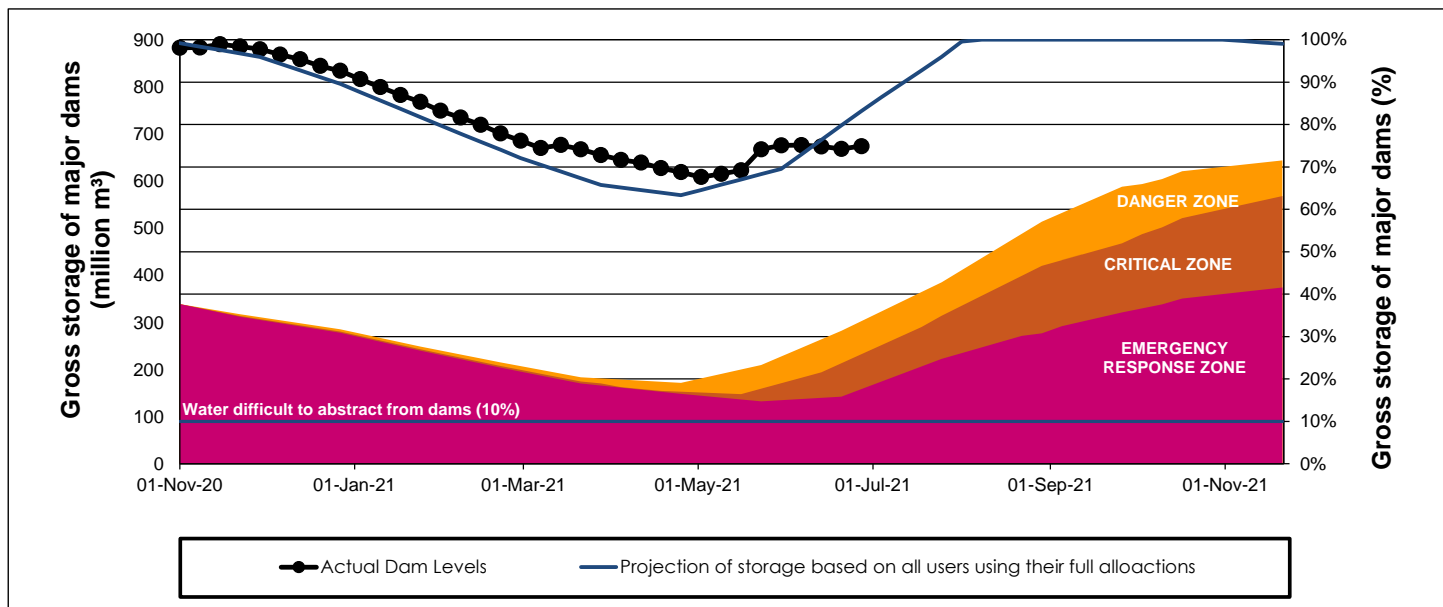

## Water Stored in Minor Dams

Overall Percentage Full **58.9**

Weekly Change **5.43**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	28 June 2021	Previous week	2020	2019	2018	2017
ALEXANDRA (Table Mountain)	126	15.3	12.0	49.3	11.7	89.5	41.6
DE VILLIERS (Table Mountain)	243	67.5	64.8	100.3	77.4	86.4	57.8
HELY-HUTCHINSON (Table Mount)	925	68.6	52.3	79.0	61.0	101.5	99.8
KLEINPLAATS (Simon's Town)	1 368	46.1	44.9	37.3	40.6	58.1	38.2
LAND-EN-ZEEZICHT (Helderberg)	451	69.0	65.4	69.8	89.5	90.0	68.4
LEWIS GAY (Simon's Town)	182	60.9	60.5	44.2	0.0	100.9	30.5
VICTORIA (Table Mountain)	128	27.5	21.6	101.9	33.0	69.8	95.0
WOODHEAD (Table Mountain)	954	72.7	69.1	100.0	70.9	99.8	95.2
<b>Total Stored</b>	<b>4 377</b>	<b>2576.8</b>	<b>2339.0</b>	<b>3015.5</b>	<b>2437.8</b>	<b>3661.8</b>	<b>3022.6</b>
<b>Percentages stored</b>		<b>58.9</b>	<b>53.4</b>	<b>68.9</b>	<b>55.7</b>	<b>83.7</b>	<b>69.1</b>


# Rainfall Recorded

RAINFALL (mm)	22-Jun	23-Jun	24-Jun	25-Jun	26-Jun	27-Jun	28-Jun	Jun	
								Total*	LT Average
Blackheath Upper	5.0	8.0	0.0	6.0	0.0	2.5		30.0	73.3
Brooklands	18.0	0.0	0.0	14.0	0.0	40.0		82.0	138.7
Newlands	46.5	3.0	0.0	30.0	4.0	32.0		148.5	291.0
Steenbras	18.0	1.6	0.0	28.0	0.3	24.0		85.7	156.0
Table Mountain (Woodhead)	30.0	4.0	0.4	24.5	4.0			117.5	240.5
Theewaterskloof	2.7	2.1	0.0	9.0	0.0	3.7		19.9	72.3
Tygerberg	5.2	14.9	0.0	7.6	1.2	2.4		39.6	93.8
Voëlvlei	1.4	0.9	0.0	13.0	0.6	0.0		18.4	115.6
Wemmershoek	9.8	11.5	0.0	26.9	0.0	13.9		67.9	189.6
Wynberg	29.0	0.0	0.0	26.0	0.0	24.5		88.2	175.2

Notes: \*Total/cummulative rainfall for month indicated above  
LT: Long Term

# Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

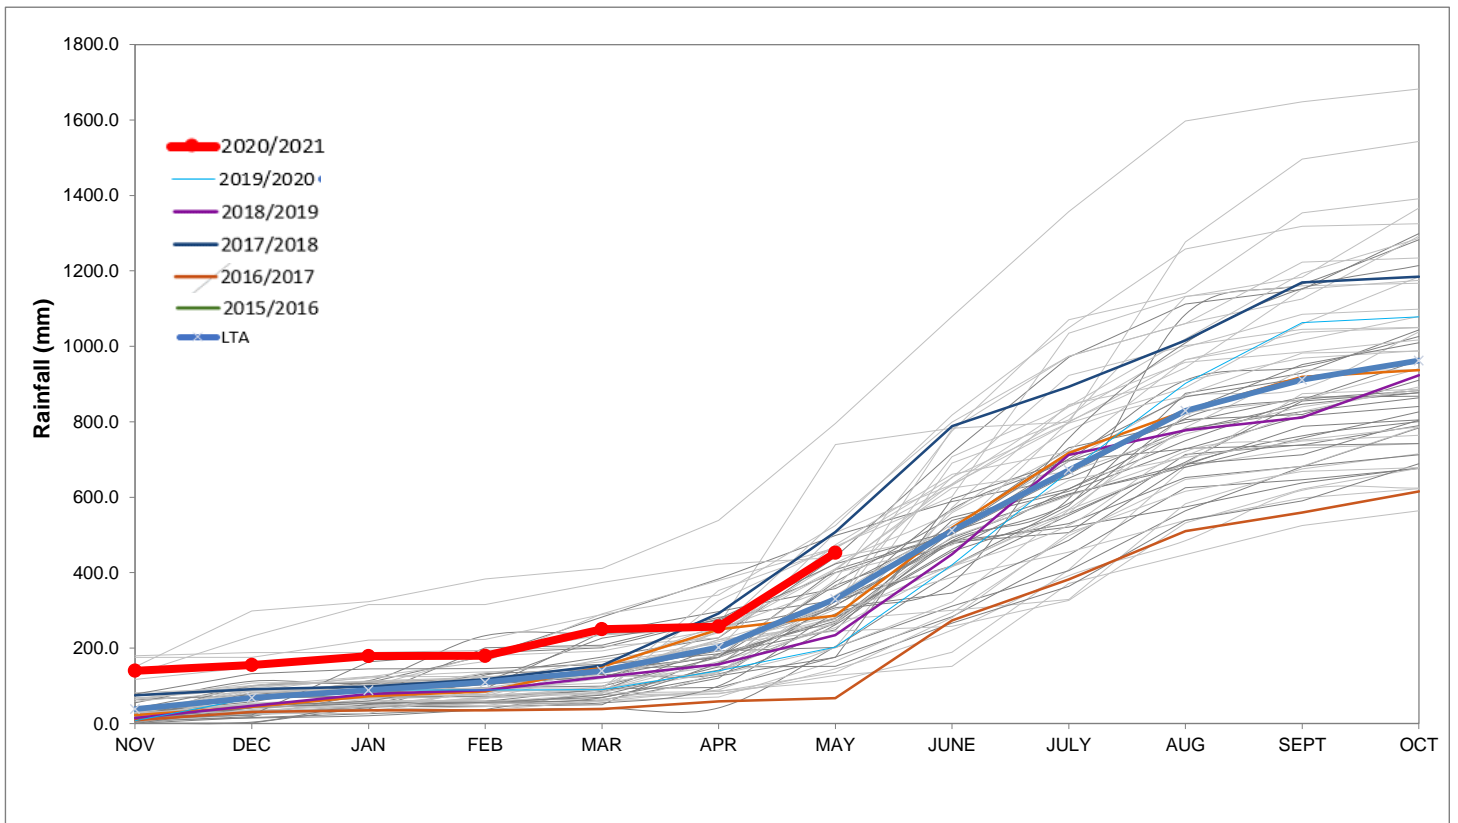

## Drinking Water Quality

### SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98
Oct-20	99.17	98
Nov-20	99.17	98
Dec-20	99.14	98
Jan-21	99.16	98
Feb-21	99.12	98
Mar-21	99.08	98
Apr-21	99.07	98
May-21	98.98	98

#### Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)