






Headline Statistics

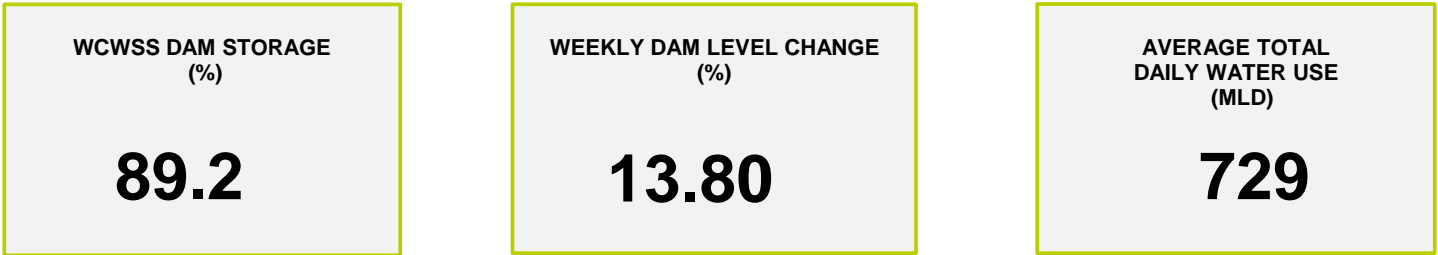

Water Production from Different Sources

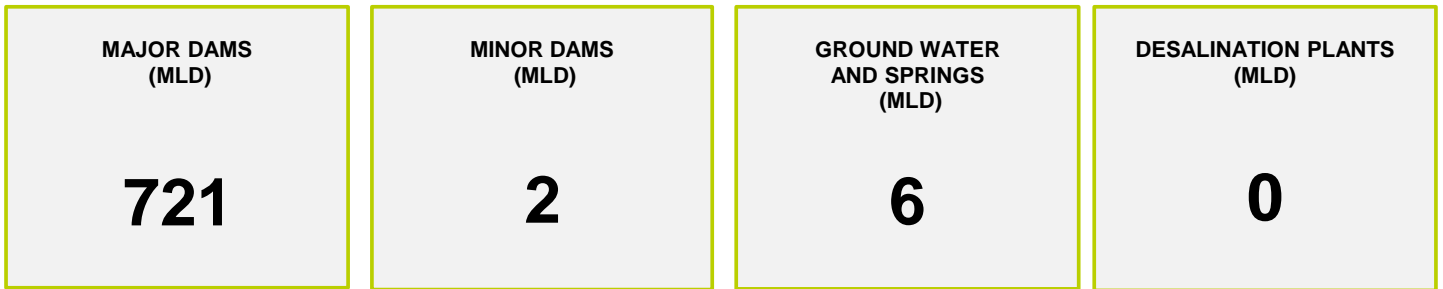

Overall Water Usage Trend (2010 - Present)

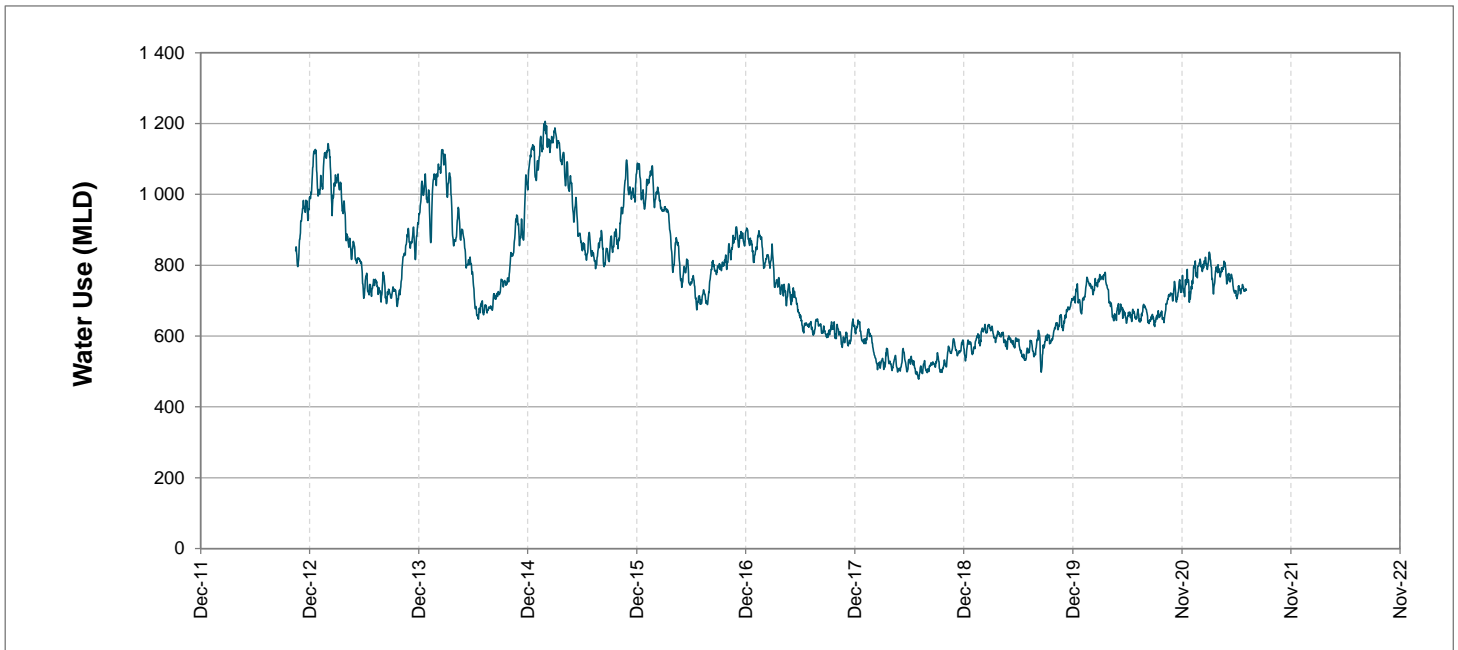

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **89.2%**


Weekly Change **13.8%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	05 July 2021	Previous week	2020	2019	2018	2017
BERG RIVER	130 010	101.3	89.7	82.4	87.0	81.8	36.9
STEENBRAS LOWER	33 517	76.3	61.6	55.6	49.5	55.5	29.3
STEENBRAS UPPER	31 767	69.8	60.1	101.3	72.1	99.8	66.2
THEEWATERSKLOOF	480 188	95.8	79.7	59.7	48.8	38.2	19.6
VOÉLVLEI	164 095	67.8	61.8	58.6	62.9	48.0	20.1
WEMMERSHOEK	58 644	86.5	62.7	50.5	48.7	82.3	36.5
TOTAL STORED	898 221	801 506	677 438	570 243	518 585	467 037	227 083
% STORAGE		89.2%	75.4%	63.5%	57.7%	52.0%	25.3%




WCWSS Storage Record (2008 - Present)

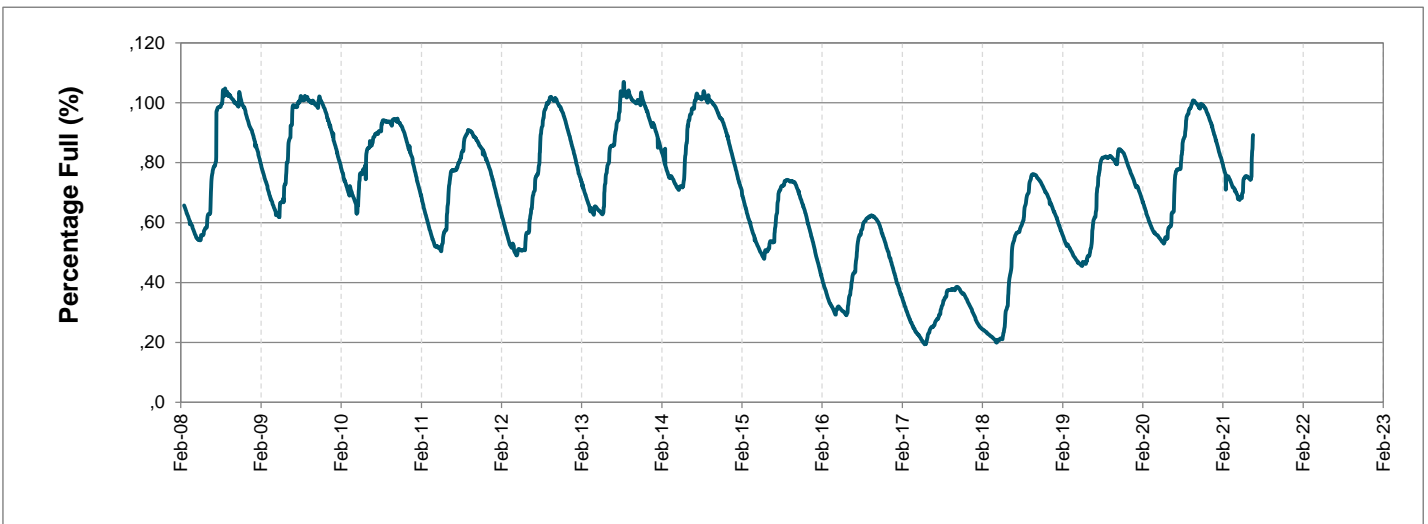

WCWSS Comparative Storage Graph

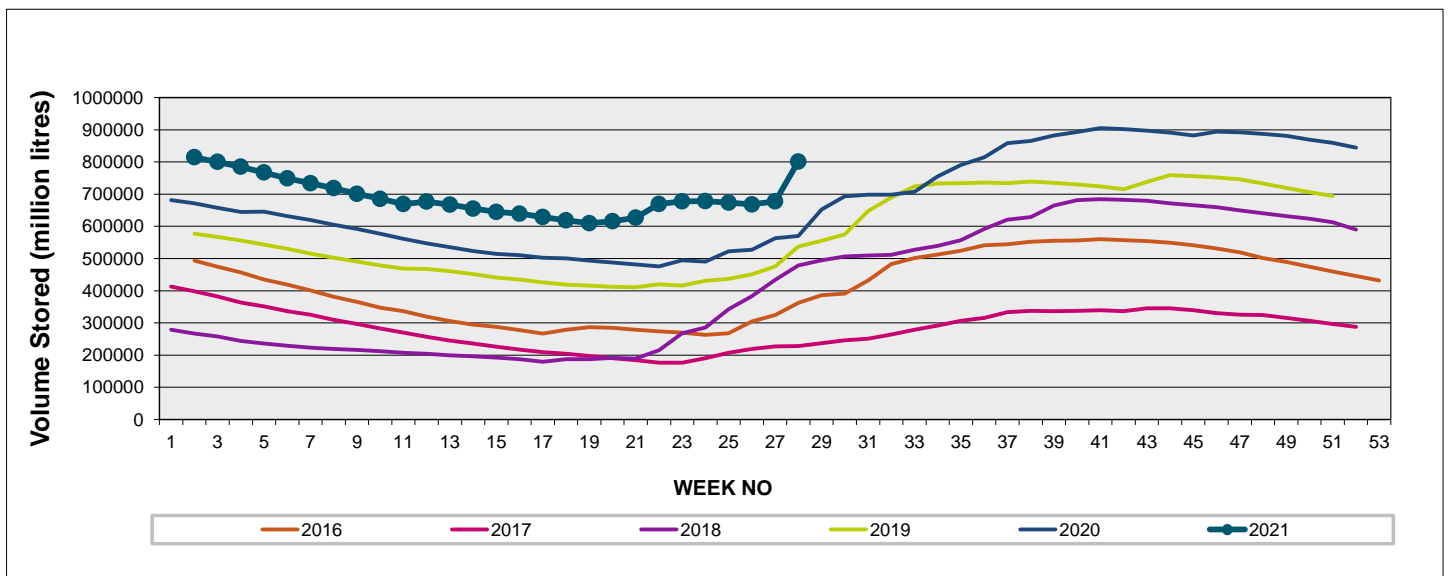

WCWSS Dam Storage and Water Use Tracking

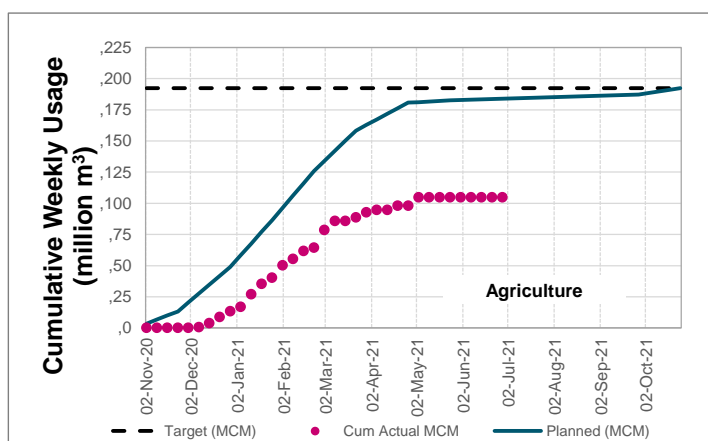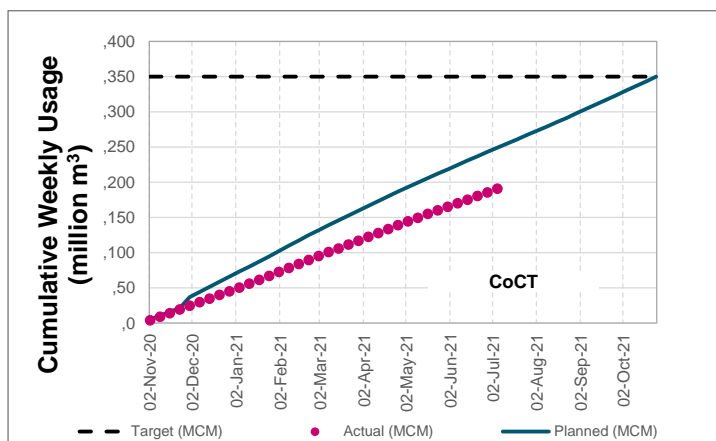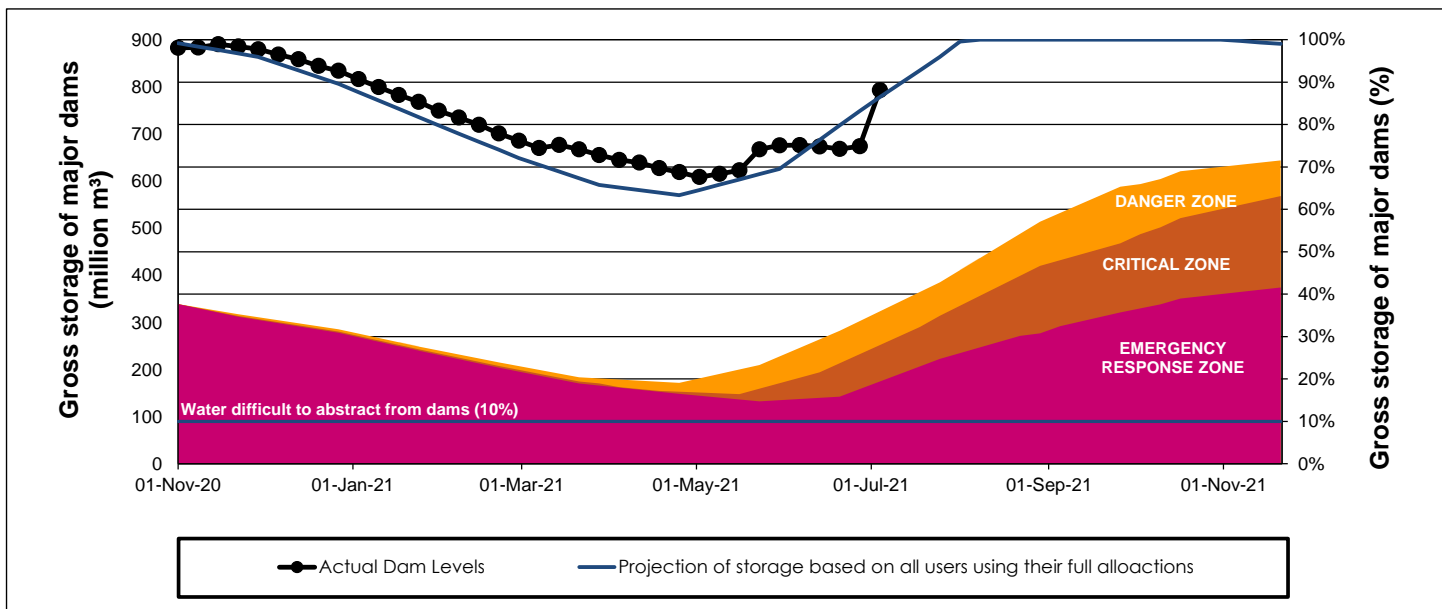

Water Stored in Minor Dams

Overall Percentage Full **82.6**

Weekly Change **23.71**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	05 July 2021	Previous week	2020	2019	2018	2017
ALEXANDRA (Table Mountain)	126	30.9	15.3	59.2	23.5	97.0	43.8
DE VILLIERS (Table Mountain)	243	88.3	67.5	100.2	93.6	100.0	61.0
HELY-HUTCHINSON (Table Mount)	925	101.2	68.6	89.3	100.0	101.0	100.3
KLEINPLAATS (Simon's Town)	1 368	63.5	46.1	41.8	43.6	68.0	39.4
LAND-EN-ZEEZICHT (Helderberg)	451	81.3	69.0	71.1	86.2	97.0	66.3
LEWIS GAY (Simon's Town)	182	100.9	60.9	63.3	0.0	100.9	42.0
VICTORIA (Table Mountain)	128	60.4	27.5	100.4	56.2	94.3	101.5
WOODHEAD (Table Mountain)	954	101.2	72.7	99.8	82.8	99.8	88.8
Total Stored	4 377	3614.8	2576.8	3215.8	3021.1	3893.0	3009.2
Percentages stored		82.6	58.9	73.5	69.0	88.9	68.8


Rainfall Recorded

RAINFALL (mm)	29-Jun	30-Jun	01-Jul	02-Jul	03-Jul	04-Jul	05-Jul	Jul	
								Total*	LT Average
Blackheath Upper	24.0	15.0	1.0	0.1	8.0	0.0		24.1	78.8
Brooklands	50.0	20.0	0.0	14.0	5.0	2.0		41.0	132.9
Newlands	42.0	73.5	6.5	18.0	42.0	2.0		142.0	289.5
Steenbras	38.5	28.0	0.6	0.5	15.0	1.5		45.6	157.8
Table Mountain (Woodhead)	55.0	57.0	4.0	26.5	9.5			97.0	244.5
Theewaterskloof	29.0	30.5	10.0	0.0	0.0	16.0		56.5	74.2
Tygerberg	23.5	21.8	0.9	0.0	9.8	0.0		32.5	93.3
Voëlvllei	16.0	32.0	10.0	0.0	18.0	0.0		60.0	101.1
Wemmershoek	45.3	90.6	4.0	12.3	11.4	0.5		118.8	172.8
Wynberg	42.0	58.0	2.0	7.5	31.5	1.4		100.4	186.4

Notes: *Total/cumulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

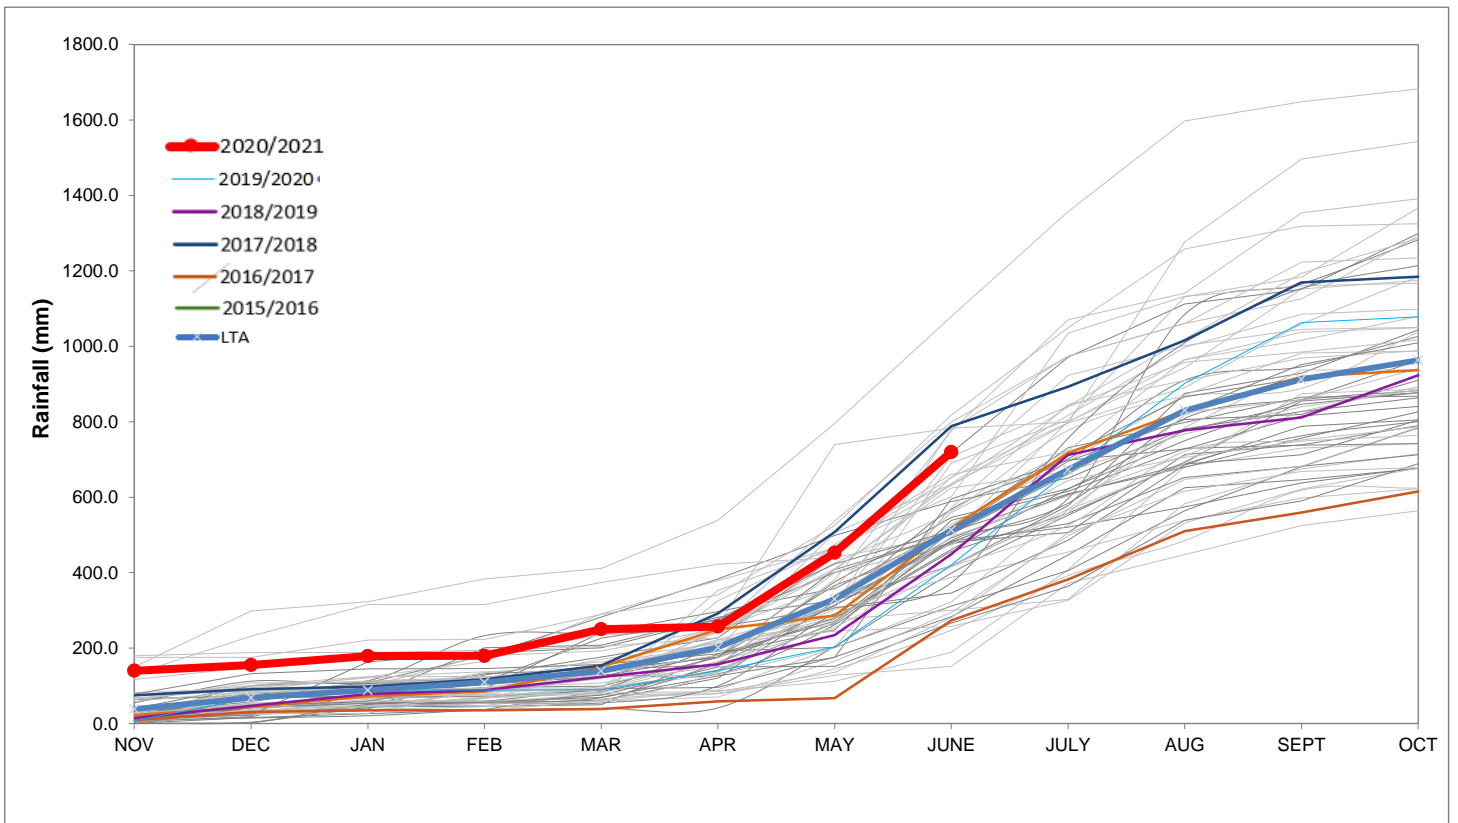

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98
Oct-20	99.17	98
Nov-20	99.17	98
Dec-20	99.14	98
Jan-21	99.16	98
Feb-21	99.12	98
Mar-21	99.08	98
Apr-21	99.07	98
May-21	98.98	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)