






Headline Statistics

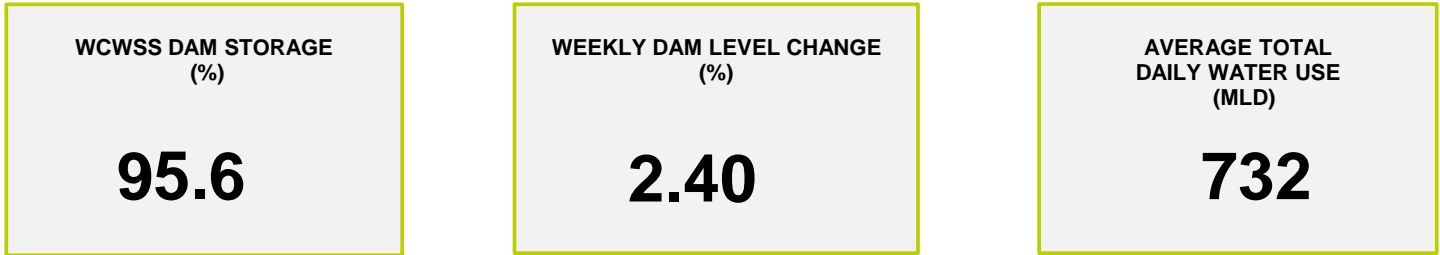

Water Production from Different Sources

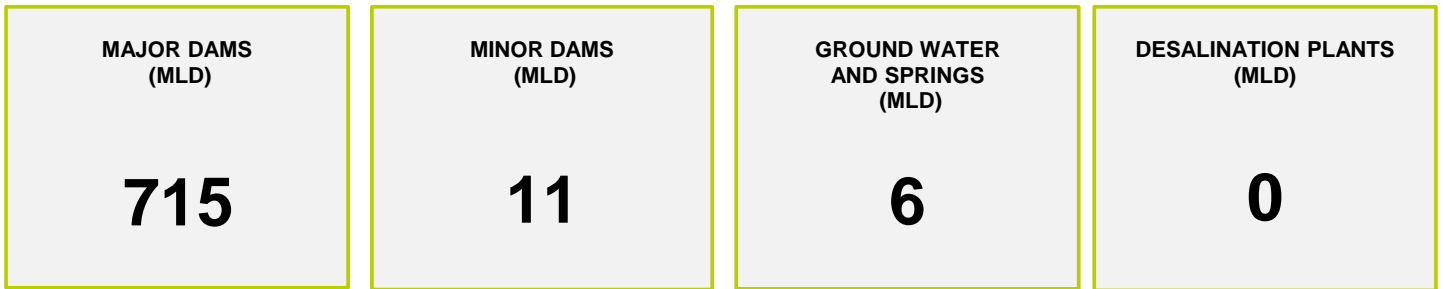

Overall Water Usage Trend (2010 - Present)

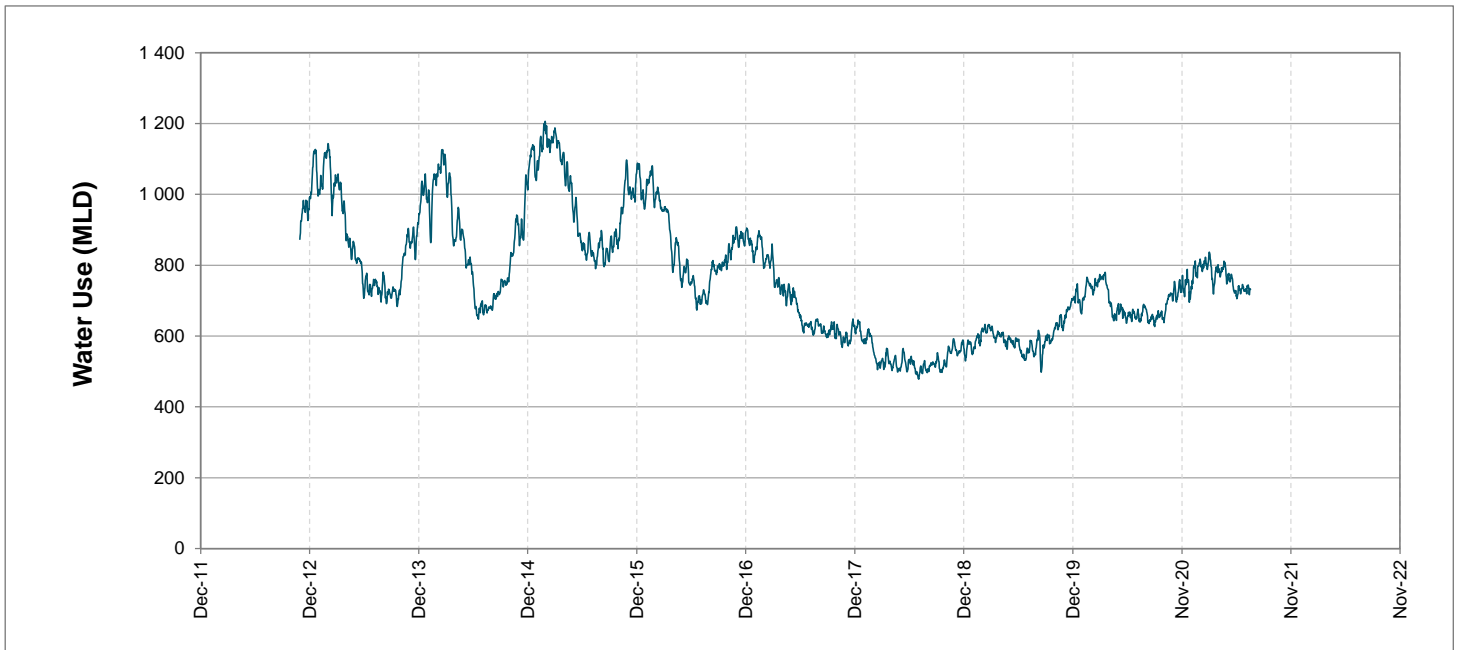

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **95.6%**


Weekly Change **2.4%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	19 July 2021	Previous week	2020	2019	2018	2017
BERG RIVER	130 010	100.4	100.6	97.9	91.9	85.4	39.1
STEENBRAS LOWER	33 517	85.0	79.5	76.7	56.1	55.7	29.3
STEENBRAS UPPER	31 767	78.1	73.3	103.0	95.3	99.6	74.1
THEEWATERSKLOOF	480 188	101.5	99.6	72.9	52.1	41.2	21.0
VOËLVLEI	164 095	80.7	76.0	70.0	66.8	56.1	21.2
WEMMERSHOEK	58 644	94.4	90.6	71.5	56.4	85.1	36.4
TOTAL STORED	898 221	858 931	836 732	692 818	561 464	501 136	241 220
% STORAGE		95.6%	93.2%	77.1%	62.5%	55.8%	26.9%




WCWSS Storage Record (2008 - Present)

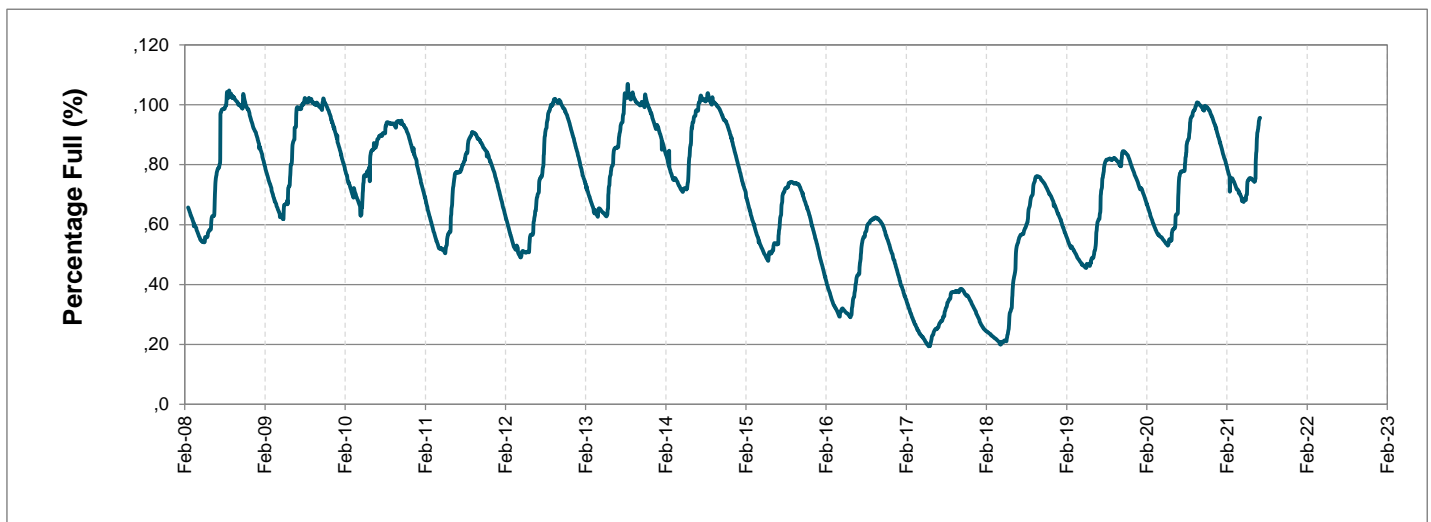

WCWSS Comparative Storage Graph

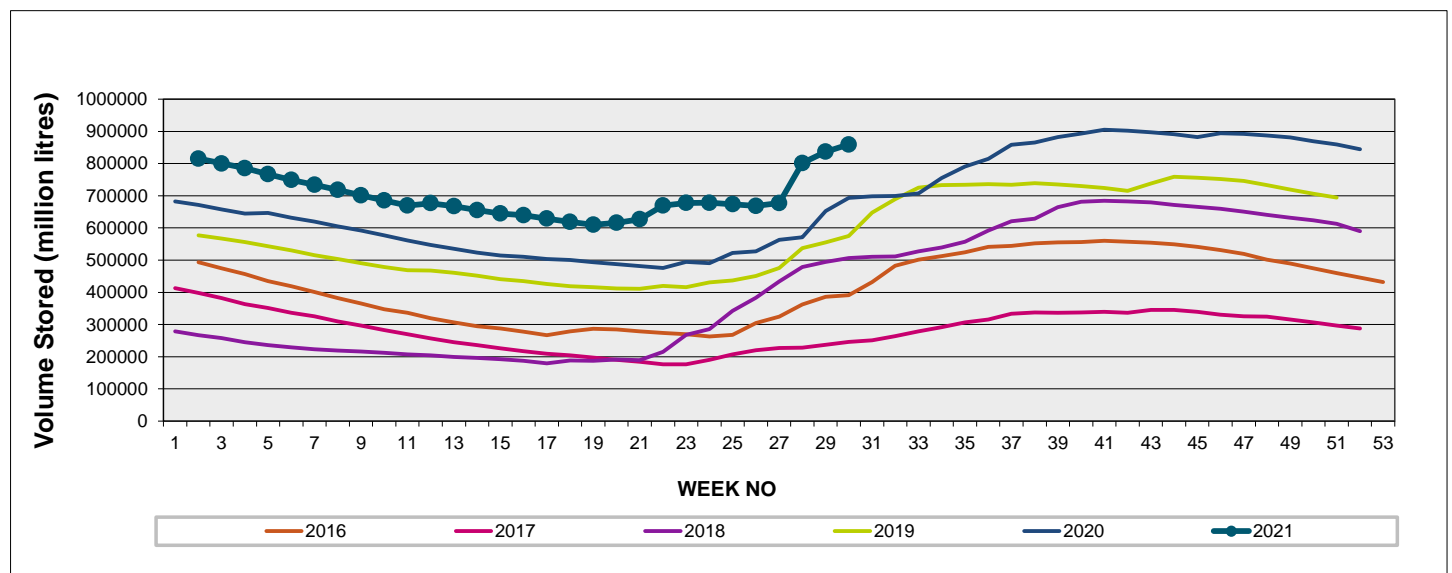

WCWSS Dam Storage and Water Use Tracking

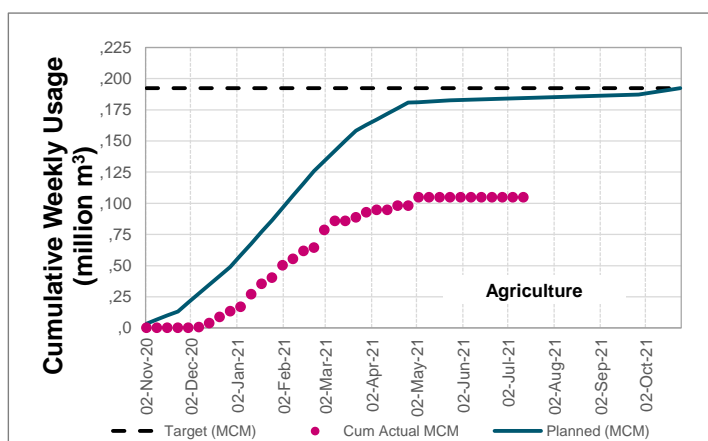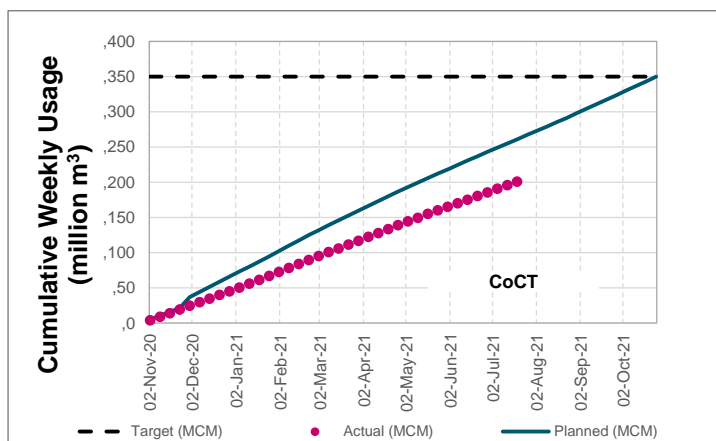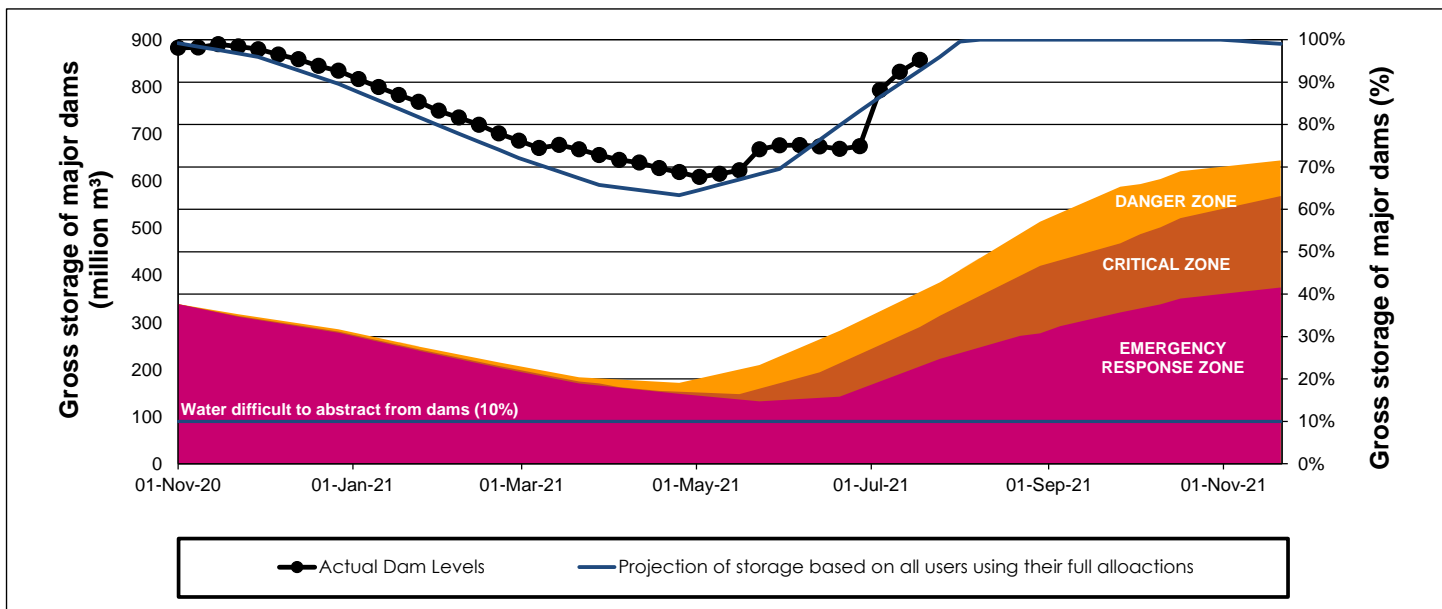

Water Stored in Minor Dams

Overall Percentage Full **89.6**

Weekly Change **4.37**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	19 July 2021	Previous week	2020	2019	2018	2017
ALEXANDRA (Table Mountain)	126	36.9	34.0	98.0	32.5	85.5	60.4
DE VILLIERS (Table Mountain)	243	96.9	92.9	100.2	100.3	99.3	64.8
HELY-HUTCHINSON (Table Mount)	925	99.7	99.7	100.0	100.8	100.2	100.0
KLEINPLAATS (Simon's Town)	1 368	84.2	71.5	58.0	57.2	77.3	40.0
LAND-EN-ZEEZICHT (Helderberg)	451	90.9	84.5	74.5	83.8	100.0	64.4
LEWIS GAY (Simon's Town)	182	100.9	100.9	101.3	38.4	87.4	74.7
VICTORIA (Table Mountain)	128	75.6	67.9	100.4	77.9	96.6	101.2
WOODHEAD (Table Mountain)	954	96.7	99.6	99.9	81.0	81.3	92.1
Total Stored	4 377	3920.7	3729.4	3658.3	3297.2	3808.2	3122.5
Percentages stored		89.6	85.2	83.6	75.3	87.0	71.3


Rainfall Recorded

RAINFALL (mm)	13-Jul	14-Jul	15-Jul	16-Jul	17-Jul	18-Jul	19-Jul	Jul	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	0.0	0.0	0.0	0.0	66.1	78.8
Brooklands	3.0	0.0	0.0	0.0	0.0	0.0	0.0	119.0	132.9
Newlands	5.5	0.0	0.0	0.0	0.0	0.0	0.0	232.5	289.5
Steenbras	2.3	0.0	0.0	0.0	0.0	0.0	0.0	145.2	157.8
Table Mountain (Woodhead)	4.0	4.0	0.0	0.0	0.0	0.0	0.0	195.0	244.5
Theewaterskloof	2.1	0.0	0.0	0.0	0.0	0.0	0.0	108.0	74.2
Tygerberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	77.4	93.3
Voëlvlei	0.0	0.0	0.0	0.0	0.0	0.0	0.0	96.0	101.1
Wemmershoek	0.8	0.0	0.0	0.0	0.0	0.0	0.0	186.9	172.8
Wynberg	1.4	0.0	0.0	0.0	0.0	0.0	0.0	182.9	186.4

Notes: *Total/cumulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

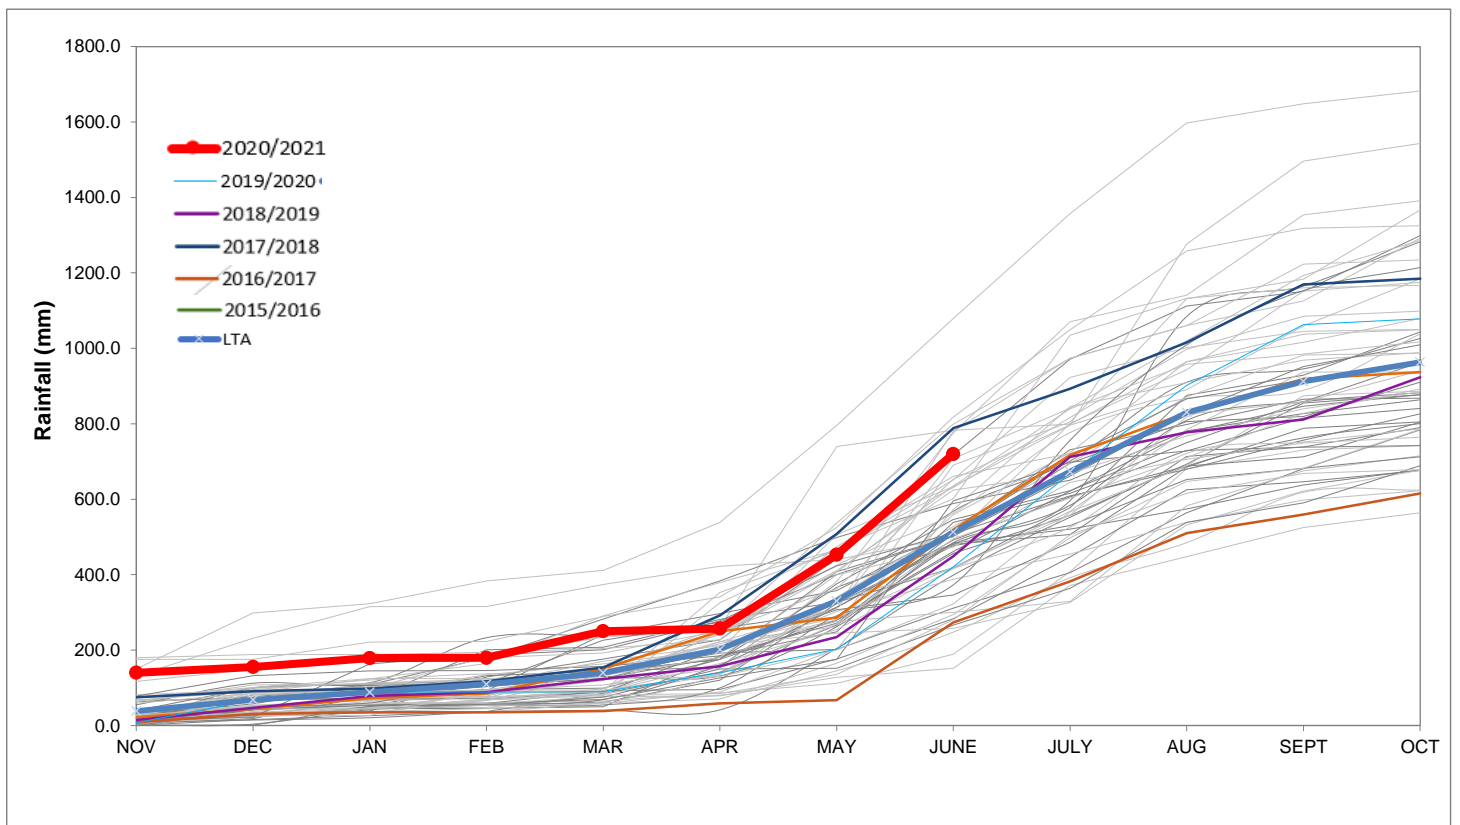

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98
Oct-20	99.17	98
Nov-20	99.17	98
Dec-20	99.14	98
Jan-21	99.16	98
Feb-21	99.12	98
Mar-21	99.08	98
Apr-21	99.07	98
May-21	98.98	98
Jun-21	99.11	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)