


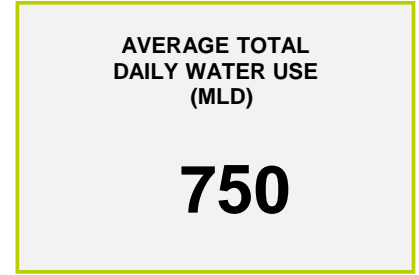
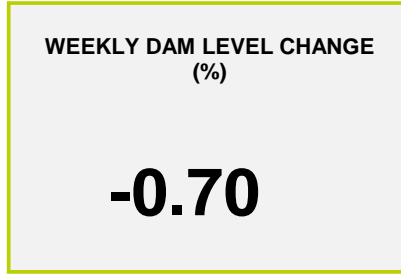


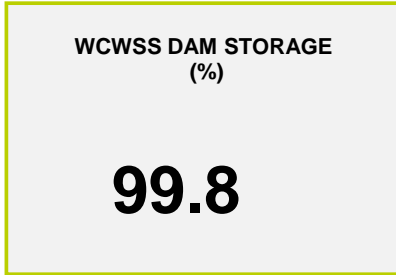


Headline Statistics

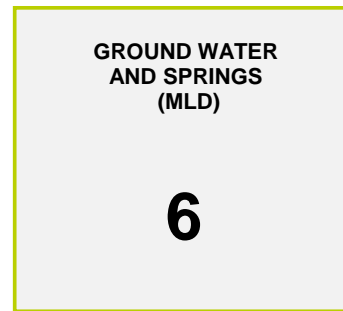

Water Production from Different Sources

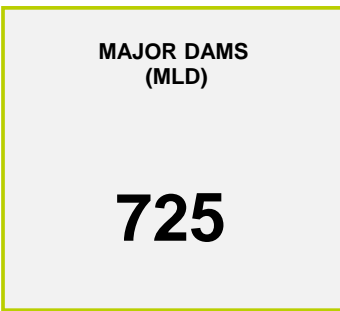

Overall Water Usage Trend (2010 - Present)

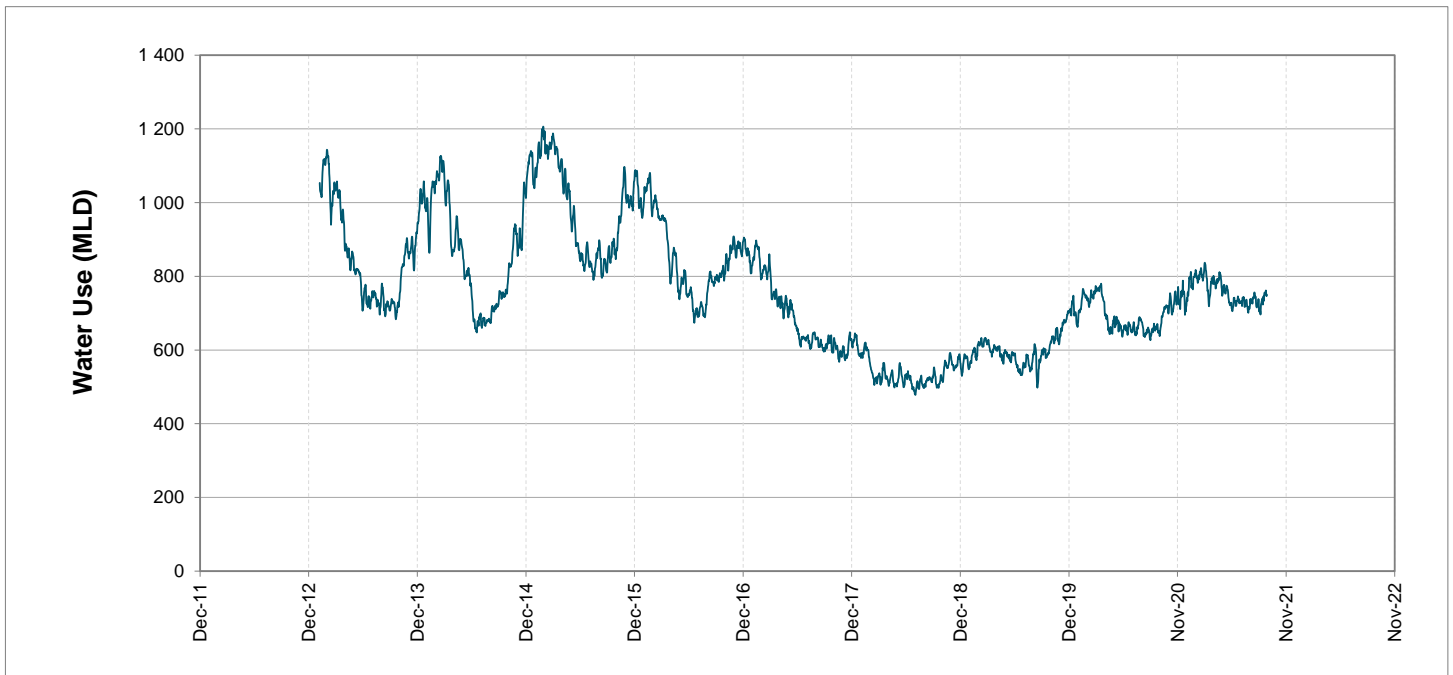

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **99.8%**


Weekly Change **-0.7%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	27 September 2021	Previous week	2020	2019	2018	2017
BERG RIVER	130 010	100.0	100.0	100.8	99.4	99.8	64.4
STEENBRAS LOWER	33 517	98.4	99.5	101.7	98.8	91.5	46.5
STEENBRAS UPPER	31 767	97.3	96.8	97.5	89.4	92.5	100.8
THEEWATERSKLOOF	480 188	100.2	100.8	99.3	72.2	56.4	28.5
VOËLVLEI	164 095	99.7	100.9	97.6	88.6	93.0	26.7
WEMMERSHOEK	58 644	98.9	99.7	98.2	92.0	94.7	44.6
TOTAL STORED	898 221	896 705	902 425	890 534	736 575	668 857	338 123
% STORAGE		99.8%	100.5%	99.1%	82.0%	74.5%	37.6%




WCWSS Storage Record (2008 - Present)

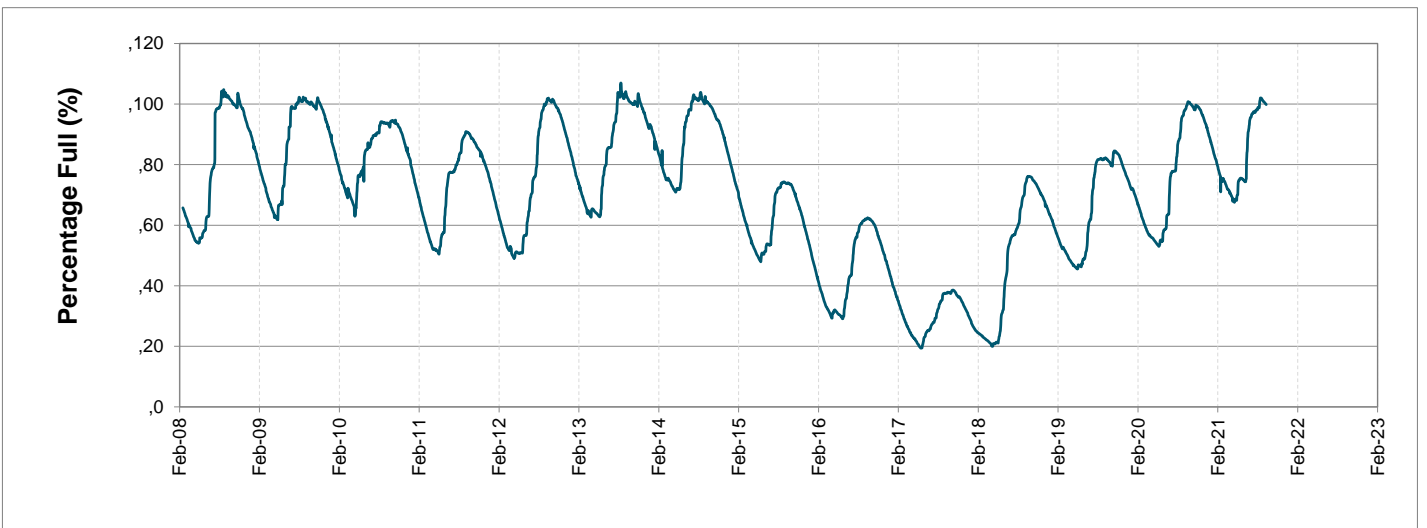

WCWSS Comparative Storage Graph

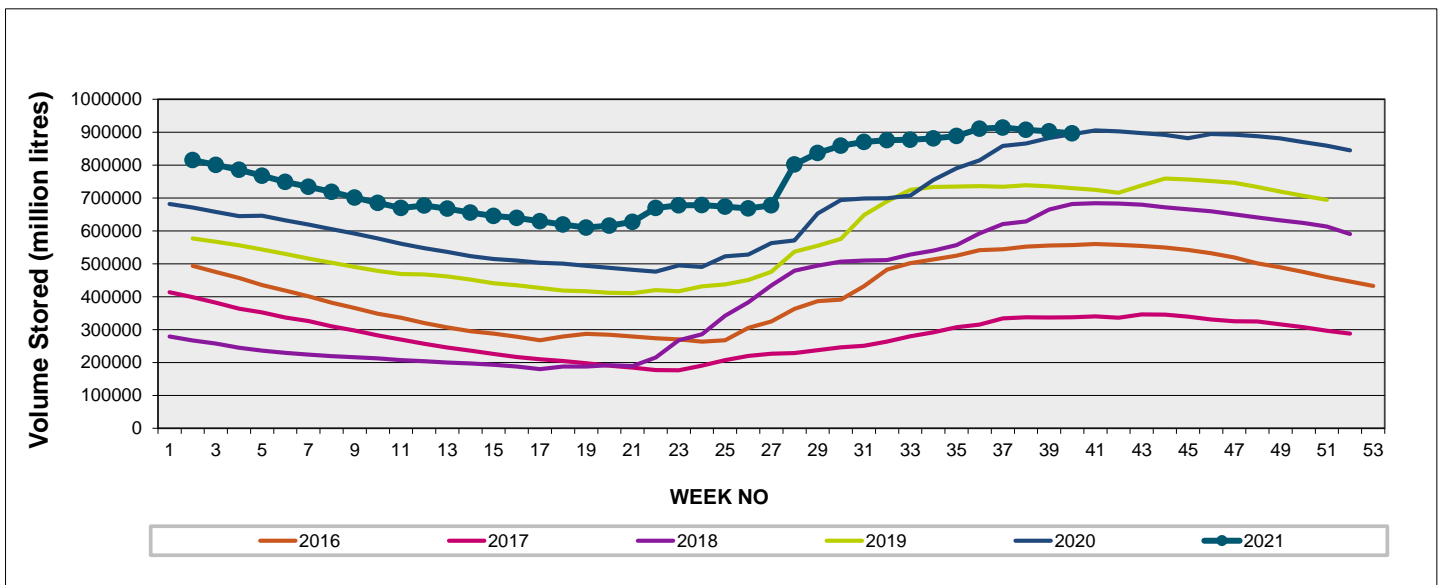

WCWSS Dam Storage and Water Use Tracking

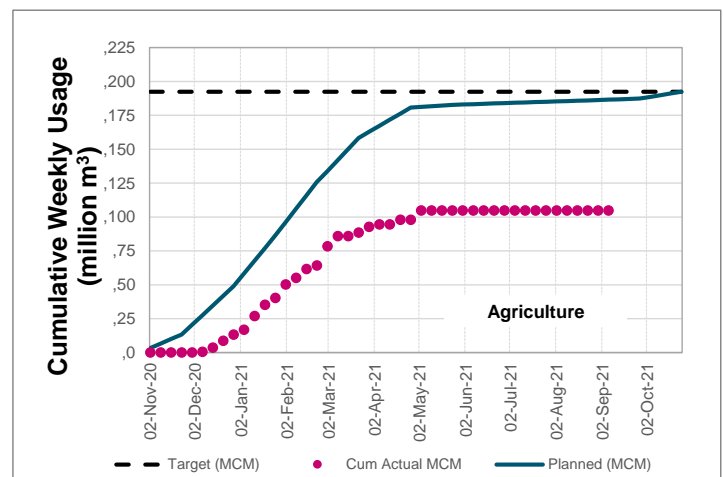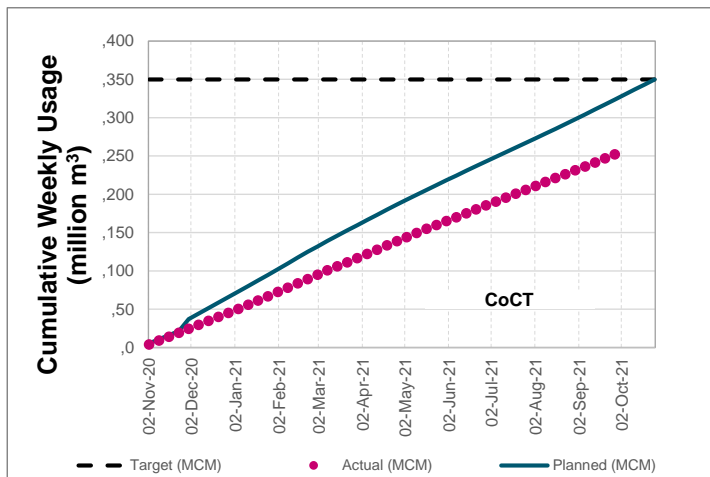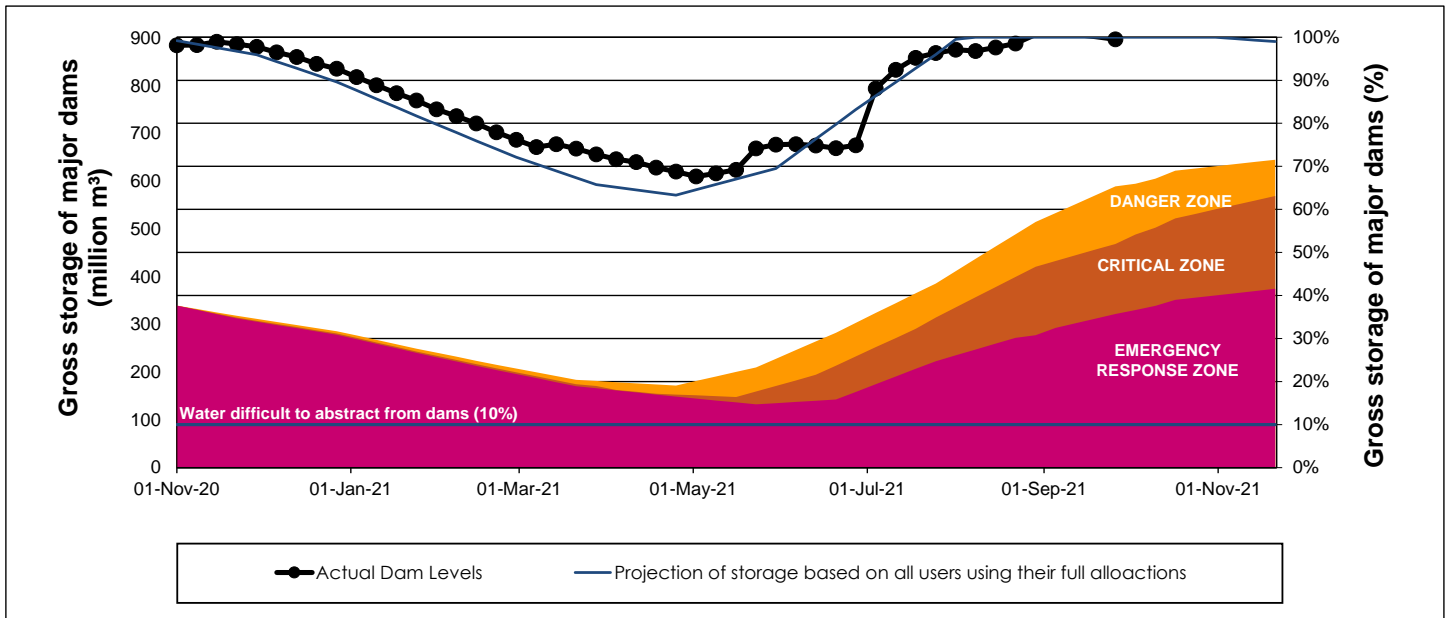

Water Stored in Minor Dams

Overall Percentage Full **93.7**

Weekly Change **-2.07**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	27 September 2021	Previous week	2020	2019	2018	2017
ALEXANDRA (Table Mountain)	126	70.2	71.9	100.0	55.0	97.6	77.6
DE VILLIERS (Table Mountain)	243	96.2	98.6	100.2	99.1	100.0	91.7
HELY-HUTCHINSON (Table Mount)	925	99.7	99.3	100.7	100.0	100.7	100.2
KLEINPLAATS (Simon's Town)	1 368	99.8	100.0	100.2	83.8	99.6	70.2
LAND-EN-ZEEZICHT (Helderberg)	451	100.0	100.0	93.9	83.4	100.0	92.4
LEWIS GAY (Simon's Town)	182	97.2	96.7	93.0	73.2	100.9	86.5
VICTORIA (Table Mountain)	128	100.0	100.4	101.5	100.0	101.9	100.4
WOODHEAD (Table Mountain)	954	82.8	91.5	100.2	92.8	70.2	83.9
Total Stored	4 377	4102.3	4192.7	4299.1	3859.7	4043.2	3678.6
Percentages stored		93.7	95.8	98.2	88.2	92.4	84.0


Rainfall Recorded

RAINFALL (mm)	21-Sep	22-Sep	23-Sep	24-Sep	25-Sep	26-Sep	27-Sep	Sep	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	0.0	0.0	0.0	0.0	12.5	43.5
Brooklands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	34.0	85.7
Newlands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	75.1	168.3
Steenbras	0.0	0.0	0.0	0.0	0.0	0.0	0.0	17.5	83.6
Table Mountain (Woodhead)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	90.5	147.2
Theewaterskloof	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5.2	41.1
Tygerberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6.9	47.0
Voëlvlei	0.0	0.0	0.0	0.0	0.0	0.0	0.0	13.3	45.1
Wemmershoek	0.0	0.0	0.0	0.0	0.0	0.0	0.0	17.7	90.3
Wynberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	36.7	97.8

Notes: *Total/cummulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

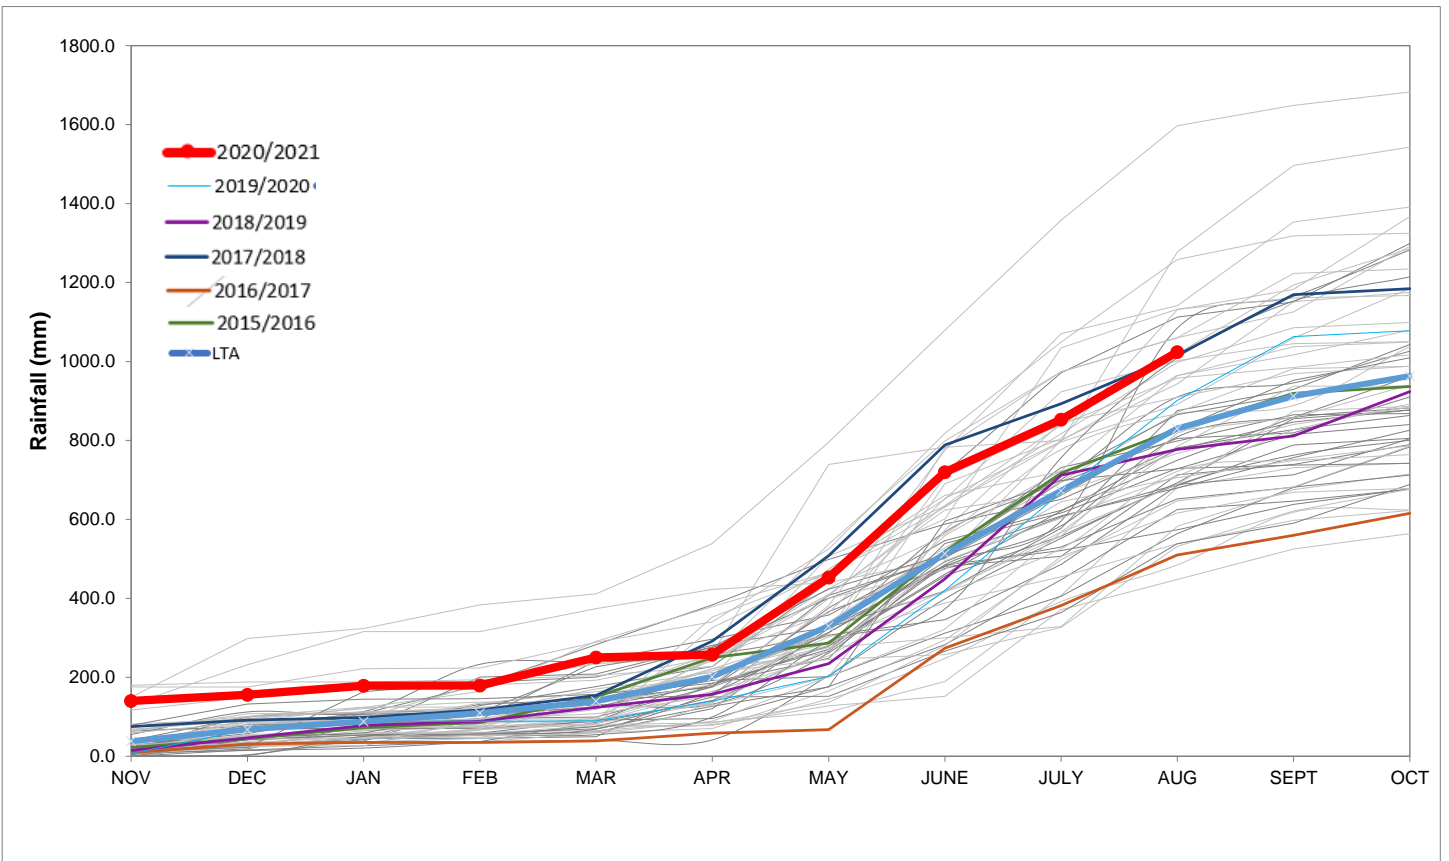

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Jun-20	99.19	98
Jul-20	99.22	98
Aug-20	99.21	98
Sep-20	99.20	98
Oct-20	99.17	98
Nov-20	99.17	98
Dec-20	99.14	98
Jan-21	99.16	98
Feb-21	99.12	98
Mar-21	99.08	98
Apr-21	99.07	98
May-21	98.98	98
Jun-21	99.11	98
Jul-21	99.10	98
Aug-21	99.12	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.