



Headline Statistics

WCWSS DAM STORAGE
(%)

63.2

WEEKLY DAM LEVEL CHANGE
(%)

2.90

AVERAGE TOTAL
DAILY WATER USE
(MLD)

831

Water Resource Status

WATER RESOURCE STATUS	MEANING OF CURRENT STATUS
Wise Water Use	Although the water resource status is "wise water use", it is important to continue using water wisely. Note: The Water Resource status is updated every three (3) months. It will next be updated in August.

Water Production from Different Sources

MAJOR DAMS
(MLD)

817


MINOR DAMS
(MLD)

14

GROUND WATER
AND SPRINGS
(MLD)

0

Overall Water Usage Trend (2010 - Present)

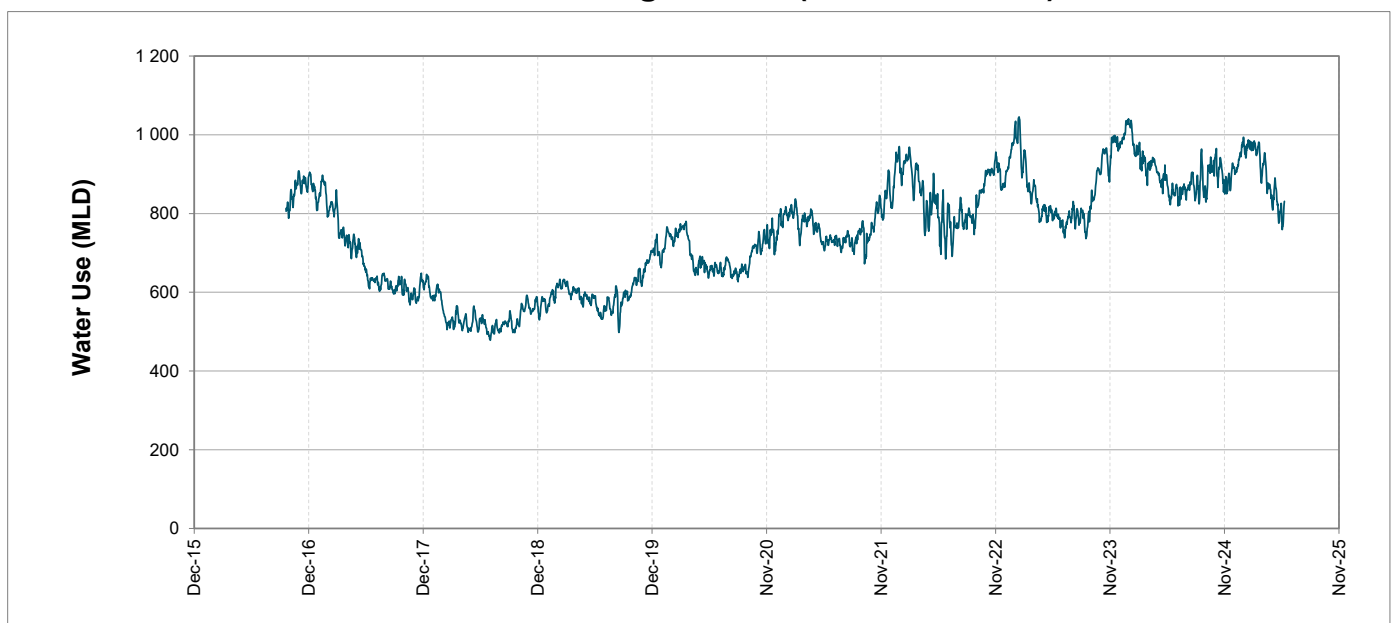

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full 63.2%


Weekly Change 2.9%

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	09 June 2025	Previous week	2024	2023	2022	2021
BERG RIVER	130 010	73.5	68.1	82.1	104.4	69.9	86.5
STEENBRAS LOWER	33 517	46.0	42.0	68.1	89.5	60.2	61.6
STEENBRAS UPPER	31 767	90.6	89.5	88.1	98.6	82.7	57.3
THEEWATERSKLOOF	480 188	62.1	59.1	61.3	74.3	67.2	81.0
VOËLVLEI	164 095	58.2	58.2	54.3	47.6	56.1	61.6
WEMMERSHOEK	58 644	58.9	53.3	69.9	92.5	48.2	61.6
TOTAL STORED	898 221	567 781	541 419	582 136	685 995	580 299	677 212
% STORAGE		63.2%	60.3%	64.8%	76.4%	64.6%	75.4%




WCWSS Storage Record (2008 - Present)

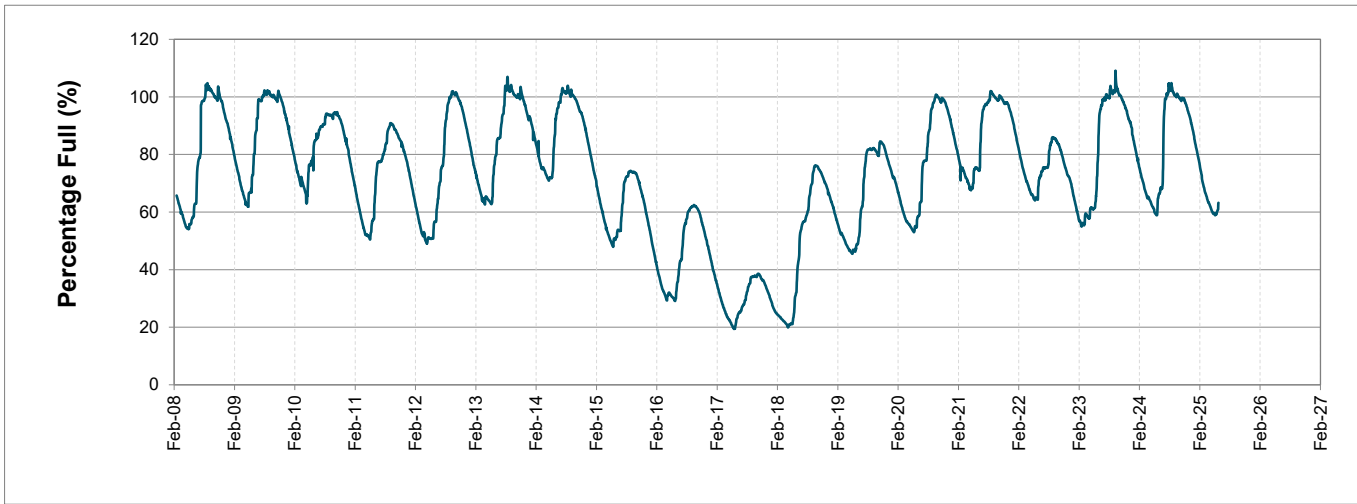

WCWSS Comparative Storage Graph

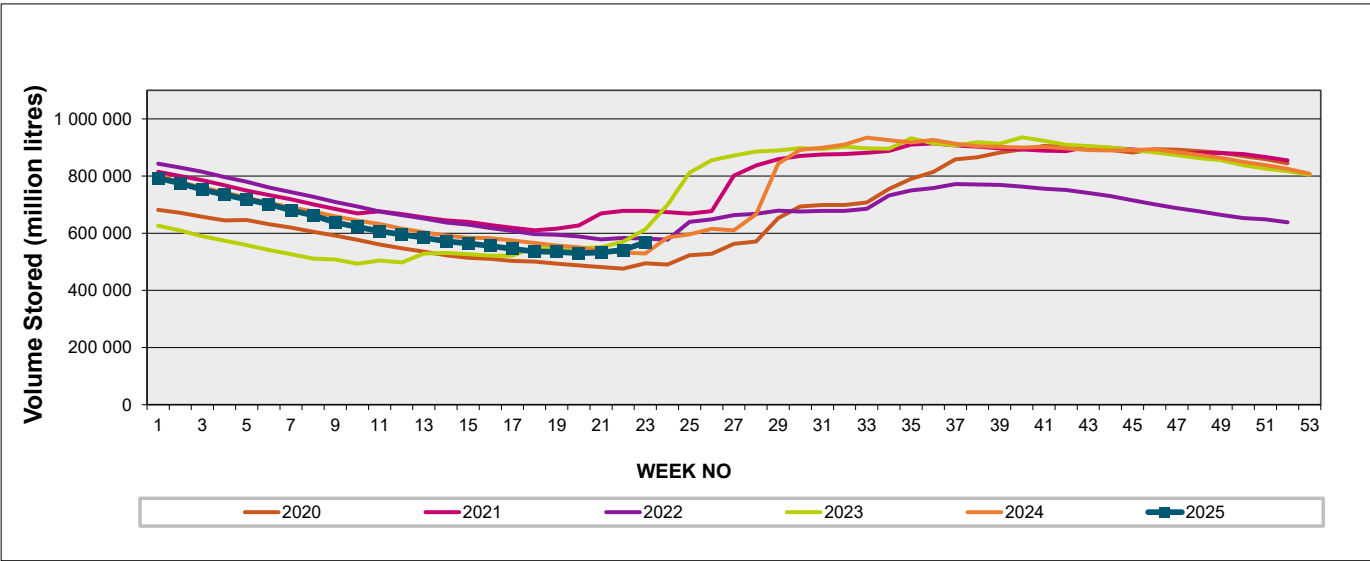

Projected WCWSS Dam Storage Levels

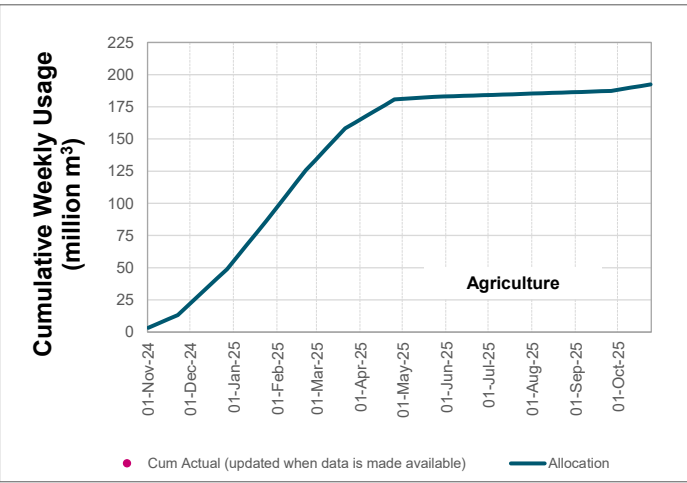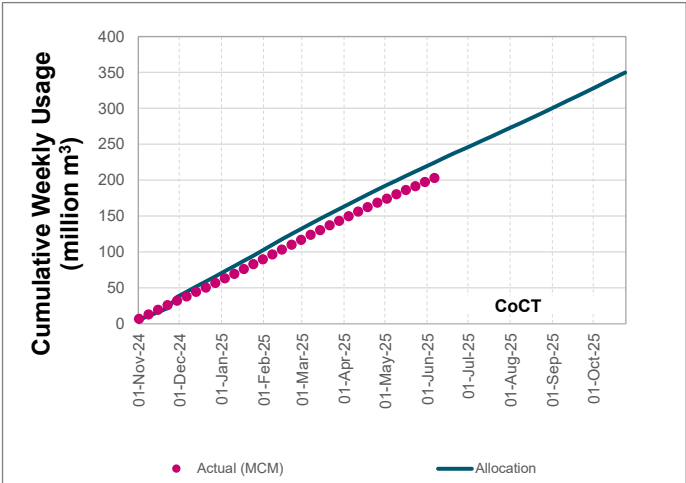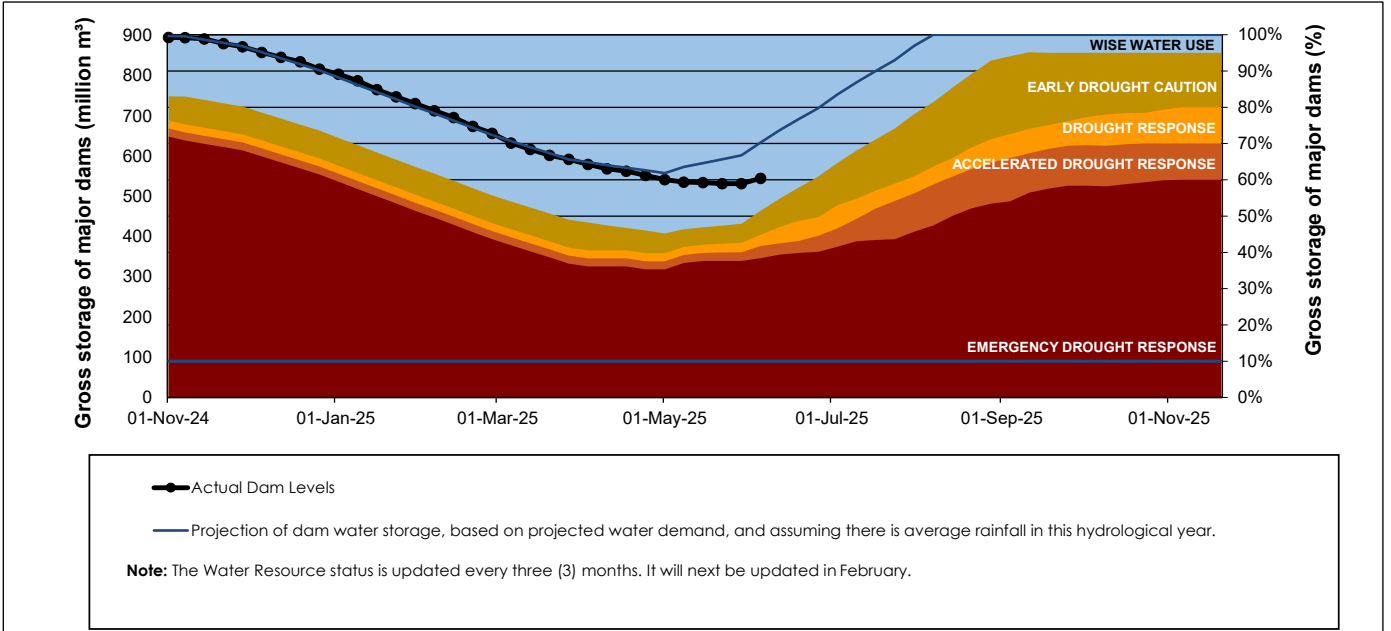

Water Stored in Minor Dams

Overall Percentage Full 42.9

Weekly Change 5.27

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	09 June 2025	Previous week	2024	2023	2022	2021
ALEXANDRA (Table Mountain)	126	34.1	23.6	46.6	98.0	60.0	11.4
DE VILLIERS (Table Mountain)	243	92.3	83.7	99.3	100.3	76.9	64.4
HELY-HUTCHINSON (Table Mount)	925	37.4	18.3	25.8	101.2	59.7	50.1
KLEINPLAATS (Simon's Town)	1 368	6.6	5.1	41.2	35.2	39.8	46.1
LAND-EN-ZEEZICHT (Helderberg)	451	74.8	74.4	100.0	93.2	73.1	64.6
LEWIS GAY (Simon's Town)	182	100.9	91.7	36.4	100.9	10.2	61.7
VICTORIA (Table Mountain)	128	0.0	0.0	104.2	101.5	67.3	21.1
WOODHEAD (Table Mountain)	954	68.5	70.5	71.3	101.3	67.5	67.9
Total Stored	4 377	1878.4	1647.9	2426.1	3476.0	2430.0	2320.1
Percentages stored		42.9	37.7	55.4	79.4	55.5	53.0


Rainfall Recorded

RAINFALL (mm)	02-Jun	03-Jun	04-Jun	05-Jun	06-Jun	07-Jun	08-Jun	Jun	
								Total*	LT Average
Blackheath Upper	0.0	2.0	0.0	0.0	5.5	30.0	0.0	37.5	73.3
Brooklands	10.0	4.0	0.0	0.0	25.0	20.0	10.0	69.0	138.7
Newlands	4.0	5.0	0.0	0.0	32.0	48.0	4.5	93.5	291.0
Steenbras	1.5	24.0	0.0	0.0	6.5	32.9	2.7	67.6	156.0
Table Mountain (Woodhead)	1.7	0.7	0.0	0.0	ND	ND	ND	3.5	240.5
Theewaterskloof	0.0	0.0	0.0	0.0	2.6	26.1	2.2	30.9	72.3
Tygerberg	0.0	8.8	0.0	0.0	7.0	22.0	0.0	37.8	93.8
Voëlvlei	0.0	2.0	0.0	0.0	3.0	36.0	0.5	41.5	115.6
Wemmershoek	0.4	6.5	0.0	0.0	36.4	38.0	0.7	82.0	189.6
Wynberg	0.7	3.4	0.0	0.0	27.0	34.0	5.5	70.6	175.2

Notes: *Total/cummulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

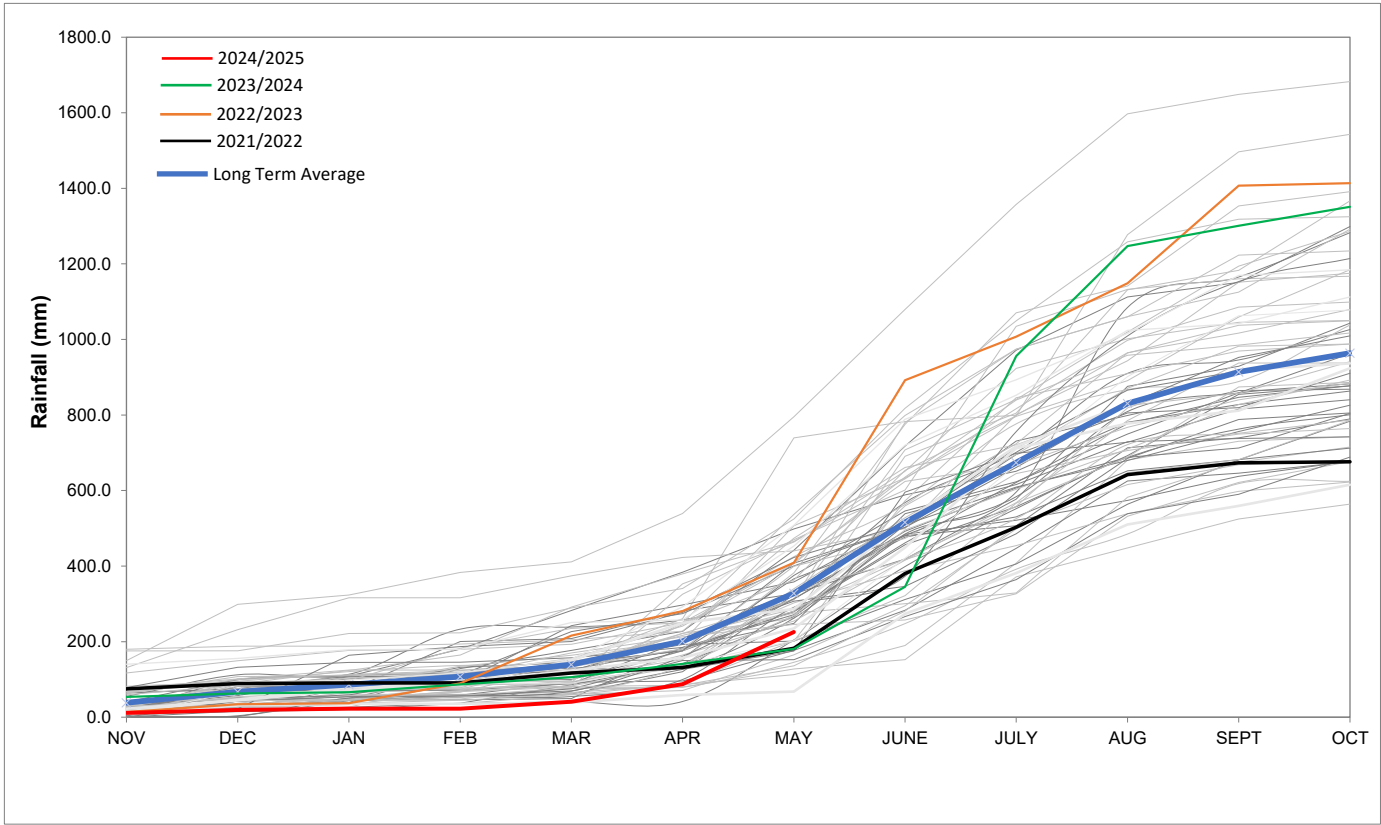

Drinking Water Quality

SAMPLE PASS RATE		
Month	Water Quality Compliance (%)	Target (%)
Nov-21	99.11	98
Dec-21	99.09	98
Jan-22	99.04	98
Feb-22	99.04	98
Mar-22	98.99	98
Apr-22	98.96	98
May-22	98.90	98
Jun-22	98.96	98
Jul-22	99.46	99
Aug-22	99.47	99
Sep-22	99.46	99.00
Oct-22	99.47	99.00
Nov-22	99.45	99.00
Dec-22	99.36	99.00
Jan-23	99.36	99.00
Feb-23	99.35	99.00
Mar-23	99.29	99.00
Apr-23	99.24	99.00
May-23	99.24	99.00
Jun-23	99.18	99.00
Jul-23	99.19	99.00
Aug-23	99.14	99.00
Sep-23	99.10	99.00
Oct-23	99.10	99.00
Nov-23	99.04	99.00
Dec-23	99.15	99.00
Jan-24	99.16	99.00
Feb-24	99.12	99.00
Mar-24	99.16	99.00
Apr-24	99.20	99.00
May-24	99.21	99.00
Jun-24	99.26	99.00
Jul-24	99.27	99.00
Aug-24	99.31	99.00
Sep-24	99.33	99.00
Oct-24	99.37	99.00
Nov-24	99.42	99.00
Dec-24	99.42	99.00
Jan-25	99.48	99.00
Feb-25	99.57	99.00
Mar-25	99.61	99.00

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 99%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.