CITY OF CAPE TOWN
ISIXEKO SASEKAPA
STAD KAAPSTAD

WEEKLY WATER DASHBOARD

08 June 2026

Headline Statistics

WCWSS DAM STORAGE (%)	WEEKLY DAM LEVEL CHANGE (%)	AVERAGE TOTAL DAILY WATER USE (MLD)*	AVERAGE WATER USE PER PERSON (l/d)**
72.8	0.40	934	160

* The total daily water usage is the total water provided by the City of Cape Town and includes water provided to Stellenbosch and Drakenstein Municipalities
** The average per person water use is the average for the City of Cape Town only and is estimated as Total Water Use / Population. Summer demands are expected to be higher than the yearly average due to the increased use of water for outdoor irrigation. Average water use per person over the last 12 months was approximately 160 l/d


Water Resource Status

WATER RESOURCE STATUS	MEANING OF CURRENT STATUS
Water Wise Use	Exceptional rainfall during May 2026 resulted in a 20% recovery in Western Cape Water Supply System (WCWSS) storage within one week, increasing the likelihood of the system reaching full supply capacity by November 2026. Rainfall intensities in several catchment areas were extreme and should be regarded as an anomalous event. As rainfall patterns remain unpredictable, it is important to continue to be water wise. Use water responsibly to sustain supply. The next WCWSS Water Resource Status update will be published in July 2026.

Water Production from Different Sources

MAJOR DAMS (MLD)	MINOR DAMS (MLD)	GROUND WATER AND SPRINGS (MLD)
917	3	14

Overal Water Usage Trend (2010 - Present)

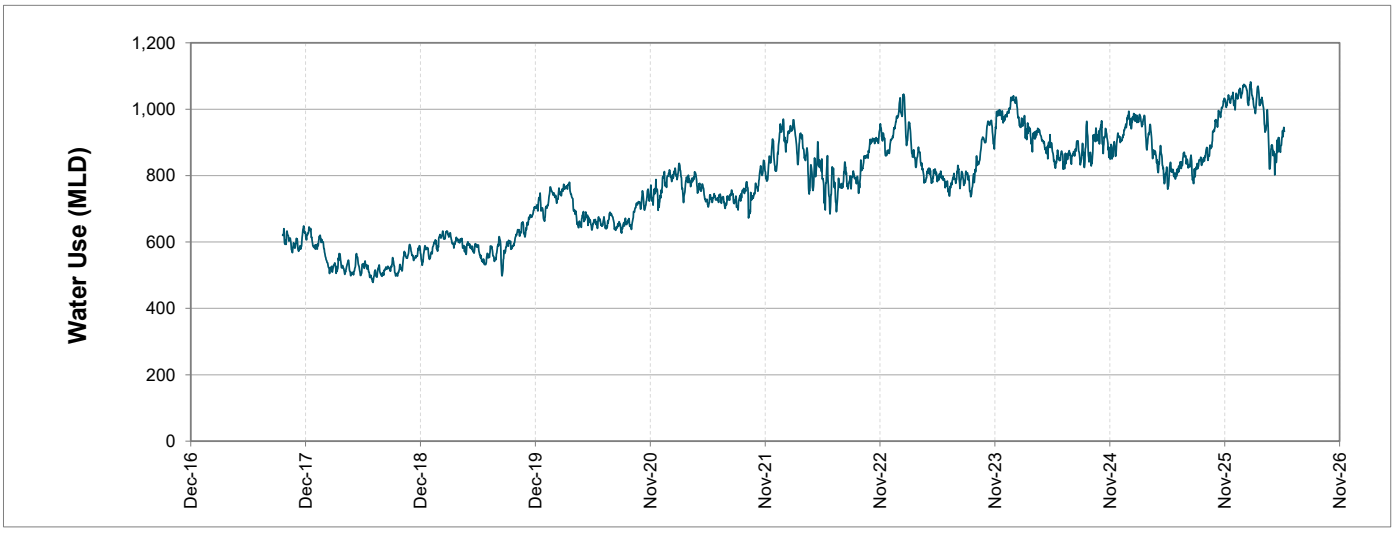

WCWSS means Western Cape Water Supply System
MLD means million litres per day
More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full	72.8%


Weekly Change	0.4%

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	Ml	08 June 2026	Previous week	2025	2024	2023	2022
BERG RIVER	130,010	76.9	76.4	72.7	81.9	103.1	69.9
STEENBRAS LOWER	33,517	49.5	52.4	44.5	68.1	86.8	60.3
STEENBRAS UPPER	31,767	82.5	81.5	91.3	87.6	100.3	82.9
THEEWATERSKLOOF	480,188	74.4	73.7	61.8	61.1	69.6	67.2
VOËLVLEI	164,095	59.2	59.3	58.2	53.2	47.4	56.2
WEMMERSHOEK	58,644	97.8	96.7	57.8	69.4	87.0	48.4
TOTAL STORED	898,221	654,285	650,560	564,798	578,642	657,775	580,660
% STORAGE		72.8%	72.4%	62.9%	64.4%	73.2%	64.6%


WCWSS Storage Record (2008 - Present)

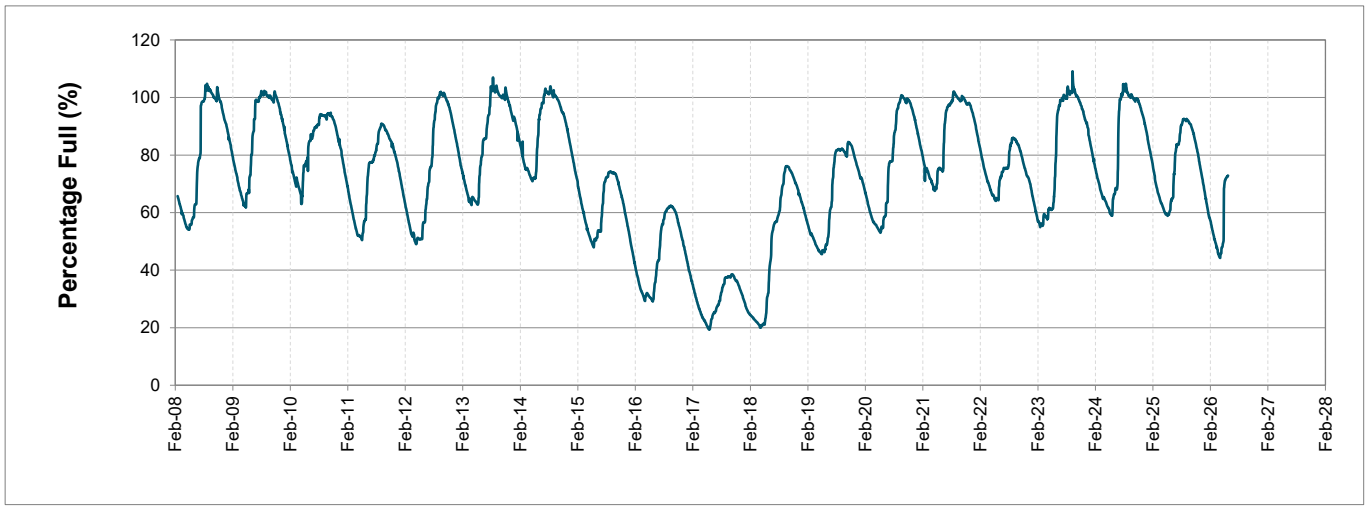

WCWSS Comparative Storage Graph

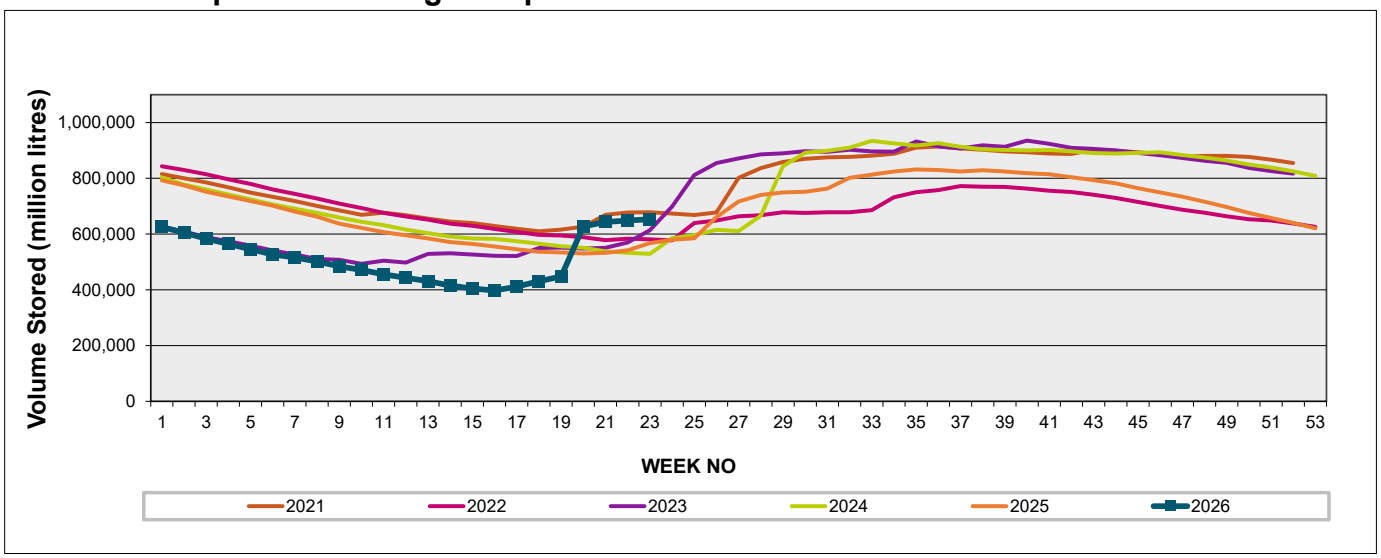


Projected WCWSS Dam Storage Levels

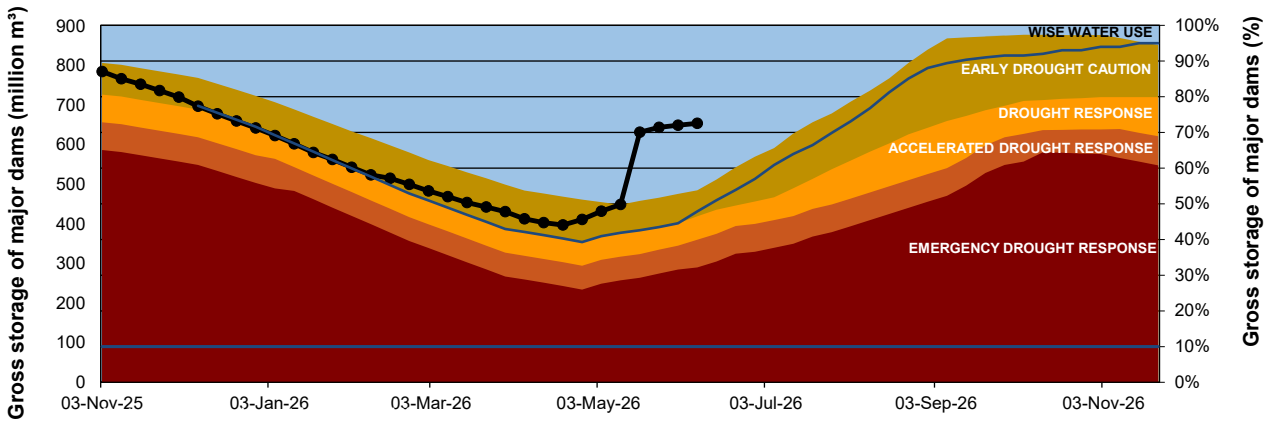


Actual Dam Levels

Projection of dam water storage, based on projected water demand, and assuming there is average rainfall in this hydrological year.

Note: The Water Resource status is updated every three (3) months. It will next be updated in February.

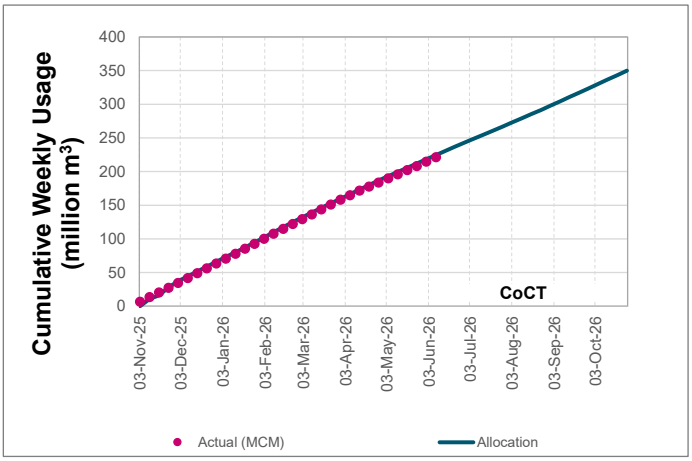

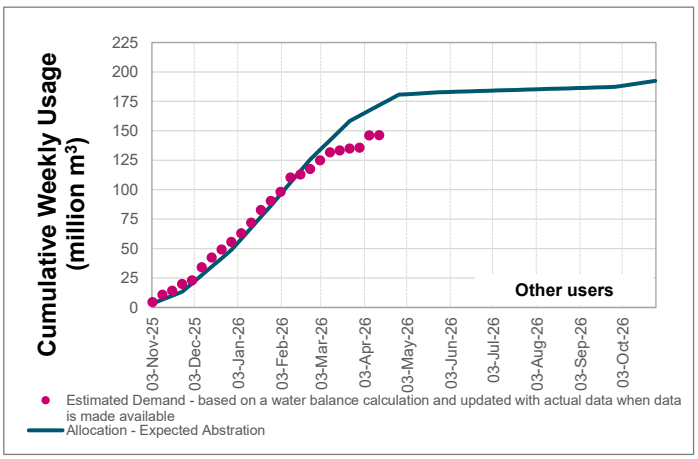

Water Stored in Minor Dams

Overall Percentage Full	N/D

Weekly Change	N/D

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	08 June 2026	Previous week	2025	2024	2023	2022
ALEXANDRA (Table Mountain)	126	48.2	51.0	31.8	46.5	98.3	60.0
DE VILLIERS (Table Mountain)	243	99.0	100.2	94.8	99.3	101.6	76.9
HELY-HUTCHINSON (Table Mount	925	58.5	75.2	58.7	28.7	100.3	59.7
KLEINPLAATS (Simon's Town)	1,368	31.7	31.5	5.1	41.2	32.8	39.4
LAND-EN-ZEEZICHT (Helderberg)	451	94.0	93.0	74.8	100.0	91.3	73.3
LEWIS GAY (Simon's Town)	182	95.4	93.6	99.0	32.7	100.9	9.2
VICTORIA (Table Mountain)	128	99.3	99.6	0.0	101.2	101.9	67.3
WOODHEAD (Table Mountain)	954	59.9	59.3	69.3	67.3	99.9	67.5
Total Stored	**4,377**	**2401.6**	**2707.2**	**2062.6**	**2405.0**	**3418.1**	**2424.3**
Percentages stored		**54.9**	**61.9**	**47.1**	**54.9**	**78.1**	**55.4**


Rainfall Recorded

RAINFALL (mm)	1-Jun	2-Jun	3-Jun	4-Jun	5-Jun	6-Jun	7-Jun	Jun	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.0	73.3
Brooklands	0.0	0.0	4.0	0.0	0.0	0.0	0.0	4.0	138.7
Newlands	0.0	2.5	0.0	0.0	0.0	0.0	0.0	8.0	291.0
Steenbras	1.5	1.5	1.5	0.0	0.0	0.0	0.0	4.5	156.0
Table Mountain (Woodhead)	5.0	0.2	0.0	0.0	0.0	0.0	0.0	5.2	240.5
Theewaterskloof	0.0	0.0	26.0	0.0	0.0	0.0	0.0	28.7	72.3
Tygerberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3.3	93.8
Voëlvlei	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	115.6
Wemmershoek	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	189.6
Wynberg	0.0	2.5	0.0	0.0	0.0	0.0	0.0	2.5	175.2

Notes:
*Total/cummulative rainfall for month indicated above
**LT: Long Term
***Readings taken at approximately 8am daily except for Newlands which is taken at 12:00 daily

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountainous location

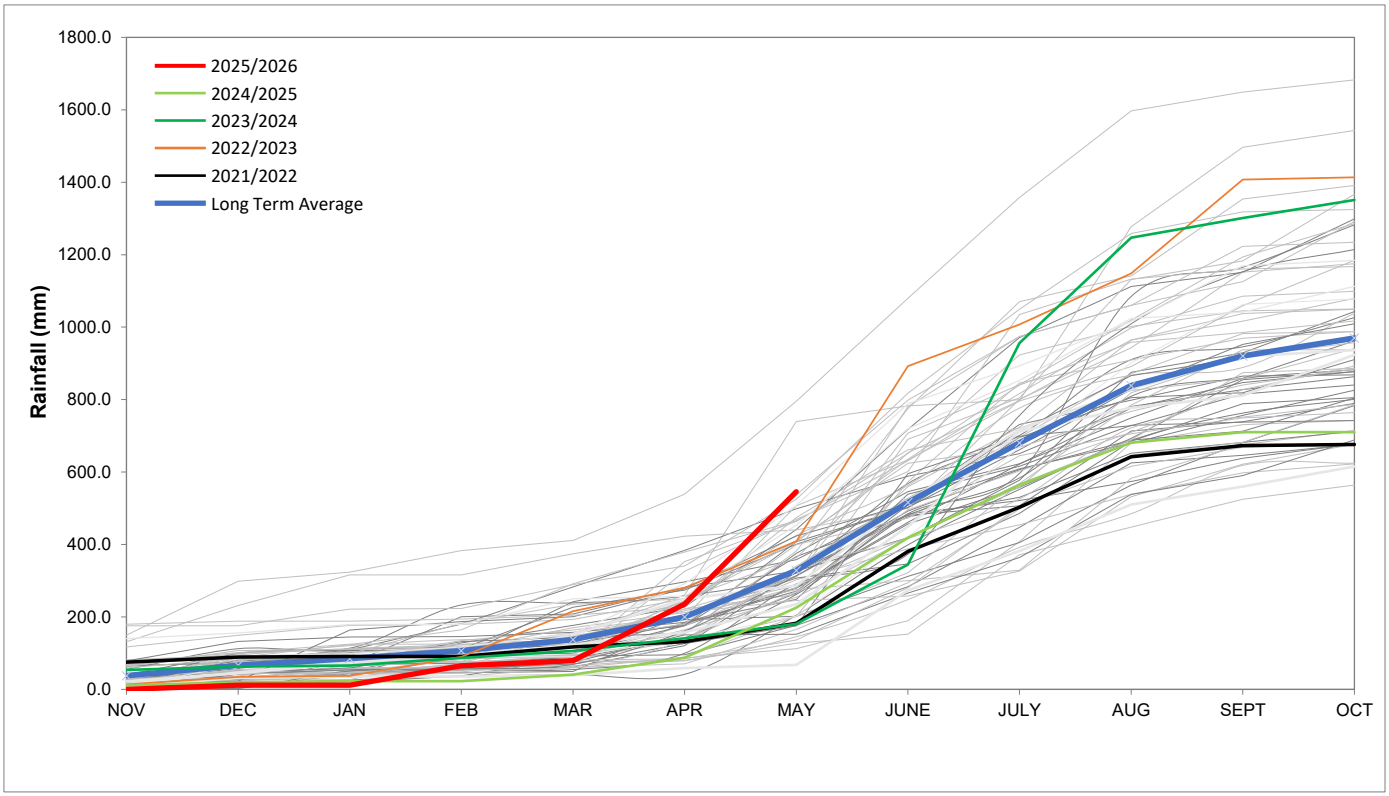

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Jan-22	99.04	98.00
Feb-22	99.04	98.00
Mar-22	98.99	98.00
Apr-22	98.96	98.00
May-22	98.90	98.00
Jun-22	98.96	98.00
Jul-22	99.46	98.50
Aug-22	99.47	98.50
Sep-22	99.46	99.00
Oct-22	99.47	99.00
Nov-22	99.45	99.00
Dec-22	99.36	99.00
Jan-23	99.36	99.00
Feb-23	99.35	99.00
Mar-23	99.29	99.00
Apr-23	99.24	99.00
May-23	99.24	99.00
Jun-23	99.18	99.00
Jul-23	99.19	99.00
Aug-23	99.14	99.00
Sep-23	99.10	99.00
Oct-23	99.10	99.00
Nov-23	99.04	99.00
Dec-23	99.15	99.00
Jan-24	99.16	99.00
Feb-24	99.12	99.00
Mar-24	99.16	99.00
Apr-24	99.20	99.00
May-24	99.21	99.00
Jun-24	99.26	99.00
Jul-24	99.27	99.00
Aug-24	99.31	99.00
Sep-24	99.33	99.00
Oct-24	99.37	99.00
Nov-24	99.42	99.00
Dec-24	99.42	99.00
Jan-25	99.48	99.00
Feb-25	99.57	99.00
Mar-25	99.61	99.00
Apr-25	99.65	99.00
May-25	99.66	99.00
Jun-25	99.62	99.00
Jul-25	99.69	99.00
Aug-25	99.69	99.00
Sep-25	99.70	99.00
Oct-25	99.70	99.00
Nov-25	99.72	99.00
Dec-25	99.72	99.00
Jan-26	99.72	99.00
Feb-26	99.70	99.00

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 99%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.